



REPORT REFERENCE:

SA – 7868-1

NOISE IMPACT ASSESSMENT
INSTALLATION OF A NEW KITCHEN EXTRACT

British Standard 4142:2014+A1:2019

CLIENT:

Slidaway Ventilation Ltd

SITE:

44 High Street,
Gravesend,
DA11 0AY

SURVEY DATE:

5th – 10th September 2024

Report By

A handwritten signature in black ink, appearing to be 'B. J. Scrivener', written over a white background within a rectangular box.

Mr. B. J. Scrivener MIOA.

Sound Advice Acoustics Ltd

2 West Links, Tollgate, Chandlers Ford, Hampshire, SO53 3TG

Tel: 02380 641357

soundadviceacoustics.co.uk

1	EXECUTIVE SUMMARY	5
1.1	INSTRUCTION	5
1.2	SCOPE OF REPORT.....	5
1.3	MEASURED BACKGROUND NOISE LEVELS	5
1.4	PROPOSED PLANT	5
1.5	MITIGATION MEASURES.....	6
1.6	ASSESSMENT.....	6
1.6.1	<i>Daytime (07:00 – 23:00) Assessment with no Attenuation.....</i>	<i>6</i>
1.7	CONCLUSIONS.....	6
1.8	NPPF 2023.....	6
1.9	PLANNING APPROVAL RECOMMENDATION	7
2	INTRODUCTION.....	8
2.1	INSTRUCTION	8
2.2	AMBIENT AND BACKGROUND MEASUREMENTS	8
2.3	BS 4142: 2014+A1:2019	8
2.4	NATIONAL PLANNING POLICY FRAMEWORK 2023 & NOISE POLICY STATEMENT FOR ENGLAND 2010	9
2.5	“SIGNIFICANT ADVERSE” AND “ADVERSE”	9
2.6	NOEL – NO OBSERVED EFFECT LEVEL	9
2.7	LOAEL – LOWEST OBSERVED ADVERSE EFFECT LEVEL	9
2.8	SOAEL – SIGNIFICANT OBSERVED ADVERSE EFFECT LEVEL	9
3	SITE LOCATION.....	10
3.1	POSITION OF SITE IN WIDER AREA.....	10
3.2	ASSESSMENT POSITION AND BACKGROUND POSITION.....	10
3.3	PROPOSED LAYOUT	11
4	RESULTS.....	12
4.1	DOWNLOADED RESULTS.....	12
4.1.1	<i>07:00 – 07:00 5th – 6th September 2024.....</i>	<i>12</i>
4.1.2	<i>07:00 – 07:00 6th – 7th September 2024.....</i>	<i>12</i>
4.1.3	<i>07:00 – 07:00 7th – 8th September 2024.....</i>	<i>12</i>
4.1.4	<i>07:00 – 07:00 8th – 9th September 2024.....</i>	<i>12</i>
4.1.5	<i>07:00 – 07:00 9th – 10th September 2024.....</i>	<i>12</i>
4.2	RESULTS SUMMARY.....	13
5	APPARATUS	14
5.1	EQUIPMENT CALIBRATION	14
5.2	POSITION 1.....	14
6	CALCULATIONS	15
6.1	PROPOSED PLANT	15

6.2	PROPOSED LAYOUT	15
6.3	CALCULATED EXTRACT LEVELS @ NOISE NEAREST SENSITIVE PREMISES.....	16
6.4	MITIGATION MEASURES.....	16
7	BS 4142:2014+A1:2019 NOISE ASSESSMENT	17
7.1	SCOPE OF BRITISH STANDARD 4142: 2014	17
7.2	TERMS AND DEFINITIONS	17
7.3	ASSESSMENT POSITION	17
7.4	CALCULATIONS	17
7.5	EQUIVALENT POSITION.....	17
7.6	RATING LEVELS (CHARACTER CORRECTION)	18
7.7	SUBJECTIVE METHOD	18
7.8	ASSESSMENT CRITERION.....	19
7.9	NOISE METER FLOOR	19
7.10	BS 4142:2014+A1:2019 PENALTIES	19
7.11	ASSESSMENTS	20
7.11.1	Daytime (07:00 – 23:00)	20
7.12	TONAL PENALTY	21
7.13	INTERMITTENCY PENALTY	21
7.14	ASSESSMENT CONCLUSION	21
8	NPPF & NPSE.....	22
9	CONCLUSIONS.....	23
9.1	MEASURED BACKGROUND NOISE LEVELS	23
9.2	PROPOSED PLANT	23
9.3	MITIGATION MEASURES.....	23
9.4	ASSESSMENT.....	24
9.4.1	Daytime (07:00 – 23:00) Assessment with no Attenuation.....	24
9.5	CONCLUSIONS	24
9.6	NPPF 2023	24
9.7	PLANNING APPROVAL RECOMMENDATION	24
10	APPENDIX A – UNCERTAINTY BUDGET	25
10.1	SCOPE	25
10.2	UNCERTAINTY OF MEASURED VALUES.....	25
10.3	UNCERTAINTY IN CALCULATIONS	26
10.4	UNCERTAINTY FROM OTHER FACTORS.....	26
10.5	COMBINED REPORTED EXPANDED UNCERTAINTY	26
11	APPENDIX B – RESULTS	27
11.1	5 TH – 6 TH SEPTEMBER 2024	27

11.2	6 TH – 7 TH SEPTEMBER 2024	28
11.3	7 TH – 8 TH SEPTEMBER 2024	29
11.4	8 TH – 9 TH SEPTEMBER 2024	30
11.5	9 TH – 10 TH SEPTEMBER 2024	31
12	APPENDIX C – WEATHER CONDITIONS	32
12.1	5 TH – 10 TH SEPTEMBER 2024	32
13	APPENDIX D – BS 4142:2019+A1:2019 INFORMATION	33
13.1	PROFESSIONAL COMPETENCE	33
13.2	SITE STATUS.....	33
13.3	MEASUREMENT INFORMATION – LOCATION 1.....	33

1 EXECUTIVE SUMMARY

1.1 Instruction

Sound Advice Acoustics Ltd have been instructed by Slidaway Ventilation Ltd to undertake a background noise survey at the existing premises at 44 High Street, Gravesend, DA11 0AY to understand the level of impact at the existing site in relation to a new kitchen extract being installed and calculate the resultant noise level at the nearest affected windows at the development and carry out assessments to BS 4142:2014+A1:2019.

1.2 Scope of Report

The measurements have been undertaken in accordance with British Standard 4142:2014 +A1:2019 and ISO 1996 – Part 2: 2017 to establish if the proposed site has a demonstrable adverse effect in terms of noise that outweigh the benefits of the development. This report aims to establish the following:

- Existing background noise levels at the residential façade (L_{A90});
- Noise levels from the Proposed Plant (L_{Aeq});
- Impact on the nearest noise sensitive property.
- Mitigation Levels if Required

1.3 Measured Background Noise Levels

Continuous background noise measurements were undertaken between the 5th – 10th September 2024 at the Assessment Position 1. The day time background noise levels between 07:00 and 23:00 was found to be $L_{A90,1 \text{ hour}}$ 44 dB. This background noise level has been assessed during daytime hours only as the proposed kitchen extract will only operate during daytime hours.

Daytime Equivalent Existing Background Noise Levels (07:00 – 23:00)	Measured Levels at Assessment Position 1	$L_{A90, t}$ 44 dB
---	--	--------------------

1.4 Proposed Plant

The following kitchen extract fan is to be located internally, generally as detailed on the drawing within this report. The fan unit has the following sound power data supplied by the manufacturer. There will be two bends within the extraction ductwork along a 12m run. This will terminate externally at high level.

Kitchen Extract Fan	Octave Band Centre Frequency (Hz) Sound Power Level L_{WA} dB								L_w dB(A)
	63	125	250	500	1.0k	2.0k	4.0k	8.0k	
Silent Box Fan AMF-560/1	52	57	69	70	70	69	65	56	76

1.5 Mitigation Measures

It is proposed that an inline attenuator is installed directly after the fan unit as detailed on the drawings within this report. This attenuator, or any alternatively selected, must achieve the following sound reduction values:-

Attenuator Selection	Octave Band Centre Frequency (Hz)							
	63	125	250	500	1.0k	2.0k	4.0k	8.0k
Attenuator CP01-M40-1200mm	5	8	13	22	30	27	17	12

1.6 Assessment

1.6.1 Daytime (07:00 – 23:00) Assessment with no Attenuation

Rating Level	38 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1 \text{ hour}}$	44 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-6 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014+A1:2019 [1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-6 dB		
Conclusion	The assessment level is 'Low Impact'		

1.7 Conclusions

The operation of the proposed internal kitchen extract fan has been assessed to establish if the proposed unit will have a demonstrable adverse effect in terms of noise that outweigh the benefits of the development. Measurements have been undertaken in accordance with British Standard 4142:2014+A1:2019 and ISO 1996 – Part 2: 2017. This report has established the existing background noise levels at the closest residential façade to the proposed kitchen extract and the assessment of the impact of the operation on nearby residential properties directly above. The resulting emissions from the site running on a worst case scenario show no conflict with 'low impact' criteria and give a strong indication that complaint and impact on the local amenity is unlikely provided the recommended acoustic works are implemented as detailed within this report.

1.8 NPPF 2023

National Planning Policy Framework 2023 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

1.9 Planning Approval Recommendation

Based on the calculations and assessments made within this report it is the professional opinion of Sound Advice Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2023, NPPF & NPSE and that, with regards to sound, planning permission can be granted.

2 INTRODUCTION

2.1 Instruction

Sound Advice Acoustics Ltd have been instructed by Slidaway Ventilation Ltd to undertake a background noise survey at the existing premises at 44 High Street, Gravesend, DA11 0AY to understand the level of impact at the existing site in relation to a new kitchen extract being installed and calculate the resultant noise level at the nearest affected windows at the development and carry out assessments to BS 4142:2014+A1:2019.

The purpose of this assessment is to ensure the acoustic protection of noise sensitive premises closest to the proposed new kitchen extract. Noise sensitive premises are not restricted to residential dwellings as offices can be affected by unwanted external noise. However, the accommodation units directly above the site have been identified as the nearest noise sensitive and therefore all calculations and assessments are to be made to these positions.

2.2 Ambient and Background Measurements

External noise levels are to be recorded over, what has been considered for the site, an average / typical time period in order to assess the daytime noise levels. Levels have been recorded over more than one day in order to ensure the uncertainty of measurement aspects of BS 4142:2014+A1:2019 have been satisfied and that the data recorded is representative for the purpose of a robust assessment.

2.3 BS 4142: 2014+A1:2019

British Standard 4142:2014+A:2019 is to be adopted for the basis of this background noise level assessment. A BS 4142:2014+A1:2019 noise assessment will be carried out in order to demonstrate the proposed acoustic impact the proposed kitchen extract could have on the nearest affected residential and make suitable recommendations in order to demonstrate that these units will not have a significant and demonstrable adverse impact on the nearest noise sensitive premises in accordance with the National Planning Policy Framework, once remedial works are completed. BS 4142:2014+A1:2019 supersedes the 2014 version and has been developed to move more in-line with The National Planning Policy Framework 2023 (NPPF) and the Noise Policy Statement for England 2010 (NPSE).

2.4 National Planning Policy Framework 2023 & Noise Policy Statement for England 2010

References and evaluations are to be made to the National Planning Policy Framework 2023 (NPPF) and the Noise Policy Statement for England 2010 (NPSE). The purpose of this document is to include all aspects of environmental noise within assessments i.e. environmental noise, neighbour noise and neighbourhood noise. Noise is to be considered alongside other relevant issues relating to the site and should not be considered in isolation, according to the NPSE.

There are several key phrases within the NPSE aims and these are discussed below.

2.5 “Significant adverse” and “adverse”

There are two established concepts from toxicology that are currently being applied to noise impacts, for example, by the World Health Organisation. They are:

2.6 NOEL – No Observed Effect Level

This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

2.7 LOAEL – Lowest Observed Adverse Effect Level

This is the level above which adverse effects on health and quality of life can be detected.

Extending these concepts for the purpose of this NPSE leads to the concept of a significant observed adverse effect level.

2.8 SOAEL – Significant Observed Adverse Effect Level

This is the level above which significant adverse effects on health and quality of life occur.

It is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations. Consequently, the SOAEL is likely to be different for different noise sources, for different receptors and at different times. It is acknowledged that further research is required to increase our understanding of what may constitute a significant adverse impact on health and quality of life from noise. However, not having specific SOAEL values in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

3 SITE LOCATION


3.1 Position of Site in Wider Area

The site is located in Gravesend.



3.2 Assessment Position and Background Position

Continuous measurements were undertaken at the assessment position between the 5th – 10th September 2024. Measurement was undertaken at ground floor level at the representative nearest noise sensitive premises / receptor in accordance with ISO1996 part 2: 2017.

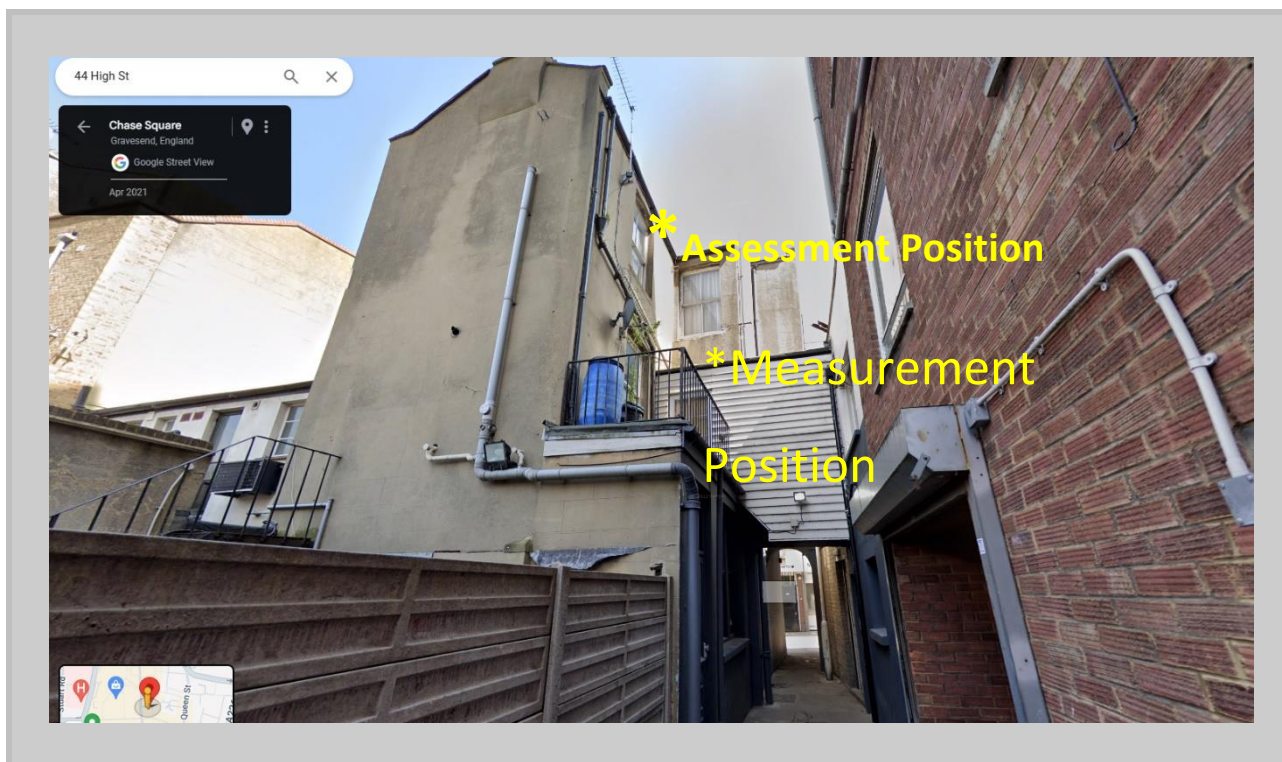

3.3 Proposed Layout



Proposed Layout

4 RESULTS

4.1 Downloaded Results

4.1.1 07:00 – 07:00 5th – 6th September 2024

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	55.0	99.6	51.0	59.1	56.5	54.8	50.7	50.4	47.6	40.2	30.4	16.9
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	48.1	76.4	41.0	52.1	51.9	49.4	44.5	43.3	39.3	33.2	24.9	12.3

4.1.2 07:00 – 07:00 6th – 7th September 2024

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	53.9	81.3	48.0	59.3	56.0	53.8	50.5	49.8	45.3	37.8	29.1	16.3
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	47.1	74.3	41.0	53.5	51.8	47.5	44.1	42.9	37.1	29.2	21.2	9.8

4.1.3 07:00 – 07:00 7th – 8th September 2024

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	53.2	86.5	44.0	58.8	56.0	53.7	50.2	48.9	44.1	36.8	27.0	16.6
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	54.0	86.0	42.0	55.2	55.0	53.8	49.7	47.9	46.3	43.5	39.0	28.3

4.1.4 07:00 – 07:00 8th – 9th September 2024

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	55.6	83.7	44.0	58.7	56.6	54.5	51.0	50.5	48.5	44.2	38.5	26.7
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	48.1	75.3	41.0	53.6	51.6	48.8	44.8	43.5	39.0	33.2	25.8	13.4

4.1.5 07:00 – 07:00 9th – 10th September 2024

NOISE LEVEL SUMMARY ASSESSMENT			Octave Band Centre Frequency (Hz)									
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LA90 1 HOUR & Corresponding LAeq 1 HOUR	55.0	88.3	51.0	59.5	56.3	54.3	51.5	50.9	46.8	40.4	31.0	15.9
NIGHT TIME 23:00 - 07:00 LA90 15 MIN & Corresponding LAeq 15 MIN	48.1	76.5	42.0	55.0	52.9	49.6	45.1	43.7	37.8	29.4	20.1	9.1

4.2 Results Summary

Continuous background noise measurements were undertaken between the 5th – 10th September 2024 at the Assessment Position 1. The day time background noise levels between 07:00 and 23:00 was found to be $L_{A90,1 \text{ hour}}$ 44 dB. This background noise level has been assessed during daytime hours only as the proposed kitchen extract will only operate during daytime hours.

Daytime Equivalent Existing Background Noise Levels (07:00 – 23:00)	Measured Levels at Assessment Position 1	$L_{A90, t}$ 44 dB
---	--	--------------------

5 APPARATUS

5.1 Equipment Calibration

The equipment was calibrated using a sound pressure level of 114.0 dB at an octave band centre frequency of 1000Hz with reference to $2 \times 10^{-5} \text{ Nm}^{-2}$ before and after the tests and the equipment set to have no inaccuracy greater than 0.2 dB.

All the following equipment was calibrated in accordance with the laboratory accreditation requirements of the United Kingdom Accreditation Service (UKAS) on the following dates. Calibration schedules are implemented within Sound Advice Acoustics Ltd in accordance with UKAS directive LAB 23.

5.2 Position 1

Description	Make	Type	Serial No.	Calibration Intervals	Cert No	Last Calibrated	Next Due Calibration
Integrated Sound Level Meter	Rion	Nl-52	242696	2 Years	TCRT23-1453	23.06.2023	23.06.2025
Microphone (With Windshield)	Rion	Uc-59	6178	2 Years		23.06.2023	23.06.2025
Microphone Pre – Amplifier	Rion	Nh-25	32724	2 Years		23.06.2023	23.06.2025

The noise meter was calibrated before and after the assessment period and found to be within the tolerance of the manufacturer's guidance. Full Calibration certificates are available upon request.

6 CALCULATIONS

6.1 Proposed Plant

The following kitchen extract fan is to be located internally, generally as detailed on the drawing within this report. The fan unit has the following sound power data supplied by the manufacturer. There will be two bends within the extraction ductwork along a 12m run. This will terminate externally at high level.

Kitchen Extract Fan	Octave Band Centre Frequency (Hz) Sound Power Level L_{WA} dB								Lw dB(A)
	63	125	250	500	1.0k	2.0k	4.0k	8.0k	
Silent Box Fan AMF-560/1	52	57	69	70	70	69	65	56	76

6.2 Proposed Layout



6.3 Calculated Extract Levels @ Noise Nearest Sensitive Premises.

Proposed Kitchen Inlet	Octave Band Centre Frequency (Hz)								dB(A)
	63	125	250	500	1.0k	2.0k	4.0k	8.0k	
Silent Box Fan AMF-560/1	52	57	69	70	70	69	65	56	76
Attenuator CP01-M40-1200mm	-5	-8	-13	-22	-30	-27	-17	-12	
Directivity	0	-2	-6	-15	-30	-30	-30	-30	
Duct Length	-1	-1	-1	-2	-3	-3	-3	-3	
End Reflection Loss	-12	-7	-3	-1	0	0	0	0	
Lw to Lp Conversion	11	11	11	11	11	11	11	11	
Calculated Discharge Levels	23	28	35	19	-4	-2	4	0	36
Distance Correction to NSP 2m	-6	-6	-6	-6	-6	-6	-6	-6	
Reflection at NSP	3	3	3	3	3	3	3	3	
Calculated Noise Level at NSP	20	25	32	16	-7	-5	1	-3	33

6.4 Mitigation Measures

It is proposed that an inline attenuator is installed directly after the fan unit as detailed on the drawings within this report. This attenuator, or any alternatively selected, must achieve the following sound reduction values:-

Attenuator Selection	Octave Band Centre Frequency (Hz)							
	63	125	250	500	1.0k	2.0k	4.0k	8.0k
Attenuator CP01-M40-1200mm	5	8	13	22	30	27	17	12

Based on these recommendations, the following assessments can be made:-

7 BS 4142:2014+A1:2019 NOISE ASSESSMENT

7.1 Scope of British Standard 4142: 2014

In the assessment of the existing surrounding commercial premises, consideration has been given to the scope of British Standard 4142:2014+A1:2019, which in section 1, details applicability of this standard to rating assessing sound of an industrial and/or commercial nature. It is considered appropriate that both the background noise levels and the rating noise levels obtained fall within the scope of British Standard 4142:2014+A1:2019 by using outdoor sound levels to assess the effect of sound on local residents.

7.2 Terms and Definitions

Symbol	Term	Definition
AP	Assessment Position	Position externally at the façade property under investigation at which the assessment is undertaken which is usually 1m from the 1 st floor bedroom window.
EP	Equivalent Position	Position at which the background noise levels are measured if there is no access to the assessment position or if source under investigation is audible.
$L_s = L_{Aeq, T}$	Specific Level	The average continuous equivalent sound pressure level of the source at the assessment position.
$L_{Ar, Tr}$	Rating Level	The average continuous equivalent sound pressure level of the source at the assessment position with a correction to account for the characteristic features.
$L_r = L_{Aeq, T}$	Residual Level	The average continuous equivalent sound pressure level at the assessment position without the source operating.
$L_{A90, T}$	Background Level	The sound pressure level that is not exceeded 90% of the time at the assessment position.
$L_a = L_{Aeq, T}$	Ambient Level	The totally encompassing sound at the assessment position including the residual and specific noise.

7.3 Assessment Position

The assessment position 1 was established as the residential window 2m from the high level discharge.

7.4 Calculations

The specific noise levels are calculated at the assessment position located at the residential property using the calculations detailed within ISO 9613 Part 1 and 2: 1996. These calculations take the manufacturers sound power levels into account for a variety of factors including source directivity, distance, atmospheric absorption, ground absorption and the effects of any barriers and determine the resultant noise levels at the assessment position.

7.5 Equivalent Position

The background noise levels were measured at the equivalent position, chosen as it most represented the closest noise sensitive façade, located within the existing garden area between 07:00 on 5th September 2024 and 07:00 on 10th September 2024.

7.6 Rating Levels (Character Correction)

It is appropriate to add a character correction where there is a new source that cannot be measured in line with BS 4142:2014+A1:2019. There are 3 methods for approaching this.

- a) Subjective method
- b) Objective method (for tonality)
- c) Reference method

7.7 Subjective Method

The subjective method establishes a rating penalty that is added to the specific noise level if any of the following is present at the assessment position. If a tone is expected to be present a character correction of 0 dB to 6 dB is added depending on how perceptible it is at noise sensitive locations.

BS 4142:2014+A1:2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Tonality Ranging from not tonal to prominently tonal	Not tonal	+0
	Just perceptible	+2
	Clearly perceptible	+4
	Highly perceptible	+6

If the source is expected to be impulsive a character correction of 0 dB to 9 dB is added depending on how perceptible it is at noise sensitive locations.

BS 4142:2014+A1:2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Impulsivity Considering both the rapidity and any overall change in sound levels	Not impulsive	+0
	Just perceptible	+3
	Clearly perceptible	+6
	Highly perceptible	+9

When the sound features are neither tonal nor impulsive, a character correction of +3 is added for the readily distinctive quality against the acoustic environment or for the intermittency of the source.

BS 4142:2014+A1:2019 – Section 9.2 Subjective Method	Perceptibility to noise sensitive facades	Correction
Readily Distinctive	Is not present	+0
	Is present	+3
Intermittency	Is not present	+0
	Is present	+3

7.8 Assessment Criterion

The significance of the resulting noise on the residential property depends on the margin by which it exceeds the background noise levels. British Standard 4142:2014+A1:2019 provides the following guidance within section 11.

Difference	Assessment of Impact
+10 dB	Indication of a significant adverse impact
+5 dB	Indication of an adverse impact
+0 dB	Indication of low impact

7.9 Noise Meter Floor

BS 4142:2014+A1:2019 suggests that Care is necessary in circumstances where background sound levels are low to ensure that self-generated and electrical noise within the measurement system does not unduly influence reported values, which might be the case if the measured background sound levels are less than 10 dB above the noise floor of the measuring system. The floor of a typical class 1 noise meter is in the region of 14 dB(A) and therefore measurements of less than 24 dB(A) should be assessed with care.

7.10 BS 4142:2014+A1:2019 Penalties

Whilst BS 4142:2014+A1:2019 allows receptor assessments to be made to achieve levels equal to prevailing background noise levels, it also ensures that appropriate and more stringent penalties are applied to the specific noise level to ensure the correct level of protection for the local residents.

7.11 Assessments

7.11.1 Daytime (07:00 – 23:00).

Rating Industrial Noise affecting Mixed Industrial and Residential Areas			British Standard 4142:2014+A1:2019 Daytime (07:00 to 23:00)
Assessment Position			Accommodation Directly Above
Background Position			At the assessment position
Item	Calculation	Clause	Commentary
Specific Noise Level $L_{Aeq,1\text{ hour}}$	33 dB	7	Calculated using ISO 9613:1996 ^[3] .
Tonality	+2 dB	8.1	Tonality Characteristic
Impulsivity	+3 dB	8.1	Impulsive Characteristic
Rating Level	38 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1\text{ hour}}$	44 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-6 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014+A1:2019 ^[1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-6 dB		
Conclusion	The assessment level is 'Low Impact'		

7.12 Tonal Penalty

A +2 dB penalty has been applied to the specific noise level to allow for any minor tonal elements that may be present from the proposed plant.

7.13 Intermittency Penalty

A +3 dB penalty has been applied to the specific noise level to allow for any intermittent elements that may be present from the proposed kitchen extract.

7.14 Assessment Conclusion

It can be seen from the above assessments that with the proposed new kitchen extract in operational, an assessment conclusion of 'Low Impact' could be expected during the daytime, provided the proposed inline attenuator is installed as close to the building termination as possible, and achieves the minimum static insertion loss detailed within this report.

8 NPPF & NPSE

The National Planning Policy Framework 2023 (NPPF) and assessments to the Noise Policy Statement for England 2010 (NPSE) should be made in conjunction with each other. Paragraphs 185 - 188 of the National Planning Policy Framework 2023 (NPPF) states the following:

Paragraph 185 Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) Mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development – and avoid noise giving rise to significant adverse impacts on health and the quality of life.
- b) Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.

Paragraph 186 Planning policies and decisions should sustain and contribute towards compliance with relevant limit values or national objectives for pollutants. So far as possible these opportunities should be considered at the plan-making stage, to ensure a strategic approach and limit the need for issues to be reconsidered when determining individual applications.

Paragraph 187 Planning policies and decisions should ensure that new development can be integrated effectively with existing businesses and community facilities (such as places of worship, pubs, music venues and sports clubs). Existing businesses and facilities should not have unreasonable restrictions placed on them as a result of development permitted after they were established. Where the operation of an existing business or community facility could have a significant adverse effect on new development (including changes of use) in its vicinity, the applicant (or 'agent of change') should be required to provide suitable mitigation before the development has been completed.

Paragraph 188 The focus of planning policies and decisions should be on whether proposed development is an acceptable use of land, rather than the control of processes or emissions (where these are subject to separate pollution control regimes). Planning decisions should assume that these regimes will operate effectively. Equally, where a planning decision has been made on a particular development, the planning issues should not be revisited through the permitting regimes operated by pollution control authorities.

The Noise Policy Statement for England gives various levels of effect as detailed within this report.

With the specifications achieved within this report, the development can be implemented within the guidelines of the aforementioned documents and ensure a conclusion of **NOEL – No Observed Effect Level**. This is the level below which no effect can be detected. In simple terms, below this level, there is no detectable effect on health and quality of life due to the noise.

9 CONCLUSIONS

9.1 Measured Background Noise Levels

Continuous background noise measurements were undertaken between the 5th – 10th September 2024 at the Assessment Position 1. The day time background noise levels between 07:00 and 23:00 was found to be $L_{A90,1 \text{ hour}}$ 44 dB. This background noise level has been assessed during daytime hours only as the proposed kitchen extract will only operate during daytime hours.

Daytime Equivalent Existing Background Noise Levels (07:00 – 23:00)	Measured Levels at Assessment Position 1	$L_{A90, t}$ 44 dB
---	--	--------------------

9.2 Proposed Plant

The following kitchen extract fan is to be located internally, generally as detailed on the drawing within this report. The fan unit has the following sound power data supplied by the manufacturer. There will be two bends within the extraction ductwork along a 12m run. This will terminate externally at high level.

Kitchen Extract Fan	Octave Band Centre Frequency (Hz) Sound Power Level L_{WA} dB								L_w dB(A)
	63	125	250	500	1.0k	2.0k	4.0k	8.0k	
Silent Box Fan AMF-560/1	52	57	69	70	70	69	65	56	76

9.3 Mitigation Measures

It is proposed that an inline attenuator is installed directly after the fan unit as detailed on the drawings within this report. This attenuator, or any alternatively selected, must achieve the following sound reduction values:-

Attenuator Selection	Octave Band Centre Frequency (Hz)							
	63	125	250	500	1.0k	2.0k	4.0k	8.0k
Attenuator CP01- M40-1200mm	5	8	13	22	30	27	17	12

9.4 Assessment

9.4.1 Daytime (07:00 – 23:00) Assessment with no Attenuation

Rating Level	38 dB	9.1	The acoustic feature correction is added to the specific noise level
Background Noise Level $L_{A90,1 \text{ hour}}$	44 dB	8.1	Modal Background Noise Level (07:00 – 23:00)
Assessment Level	-6 dB	11	The background level is subtracted from the rating level.
Conclusion BS 4142:2014+A1:2019 [1]	+10 dB Significant Adverse Effects, +5 dB Adverse Effects, +0 dB Low Impact		
Assessment	-6 dB		
Conclusion	The assessment level is 'Low Impact'		

9.5 Conclusions

The operation of the proposed internal kitchen extract fan has been assessed to establish if the proposed unit will have a demonstrable adverse effect in terms of noise that outweigh the benefits of the development. Measurements have been undertaken in accordance with British Standard 4142:2014+A1:2019 and ISO 1996 – Part 2: 2017. This report has established the existing background noise levels at the closest residential façade to the proposed kitchen extract and the assessment of the impact of the operation on nearby residential properties directly above. The resulting emissions from the site running on a worst case scenario show no conflict with 'low impact' criteria and give a strong indication that complaint and impact on the local amenity is unlikely provided the recommended acoustic works are implemented as detailed within this report.

9.6 NPPF 2023

National Planning Policy Framework 2023 suggests that planning permission should be granted unless any adverse impacts of doing so would significantly and demonstrably outweigh the benefits, when assessed against the policies in the framework taken as a whole, or specific policies in the framework indicate the application should be restricted.

9.7 Planning Approval Recommendation

Based on the calculations and assessments made within this report it is the professional opinion of Sound Advice Acoustics Ltd that the proposed development can demonstrate compliance with the National Planning Policy Framework 2023, NPPF & NPSE and that, with regards to sound, planning permission can be granted.

10 APPENDIX A – UNCERTAINTY BUDGET

10.1 Scope

British Standard 4142:2014+A1:2019 entitled “*Uncertainty*” requires the following:

“Consider the level of uncertainty in the data and associated calculations. Where the level of uncertainty could affect the conclusion, take reasonably practicable steps to reduce the level of uncertainty. Report the level and potential effects of uncertainty.”

Annex B of British Standard 4142:2014+A1:2019 entitled “consideration of uncertainty and good practice for reducing uncertainty” makes reference to the University of Salford publication entitled “A Good Practice Guide on the Source and Magnitude of Uncertainty arising in the Practical Measurement of Environmental Noise” edition 1a dated May 2007.

10.2 Uncertainty of Measured Values

Ref	Source of Uncertainty Section 10.2 British Standard 4142:2014+A1:2019	Value dB(A)	Distribution (Divisor)	Uncertainty dB(A)
a	Variability and complexity of sound source	0.50	$\sqrt{2}$	0.35
b	Variability and complexity of residual sound	0.00	$\sqrt{3}$	0.00
c	Residual sound present in specific sound	0.00	$\sqrt{3}$	0.00
d	Background noise position selection	0.10	$\sqrt{3}$	0.06
e	Distance between source and receiver	0.15	$\sqrt{2}$	0.11
f	Number of measurements taken (5 Days)	0.10	$\sqrt{3}$	0.06
g	Measurement time interval variation	0.00	$\sqrt{2}$	0.00
h	Range of times measurements taken	0.10	$\sqrt{3}$	0.06
i	Suitable weather conditions during measurements	0.20	$\sqrt{3}$	0.12
j	Application of British Standard 4142:2014+A1:2019	0.10	$\sqrt{2}$	0.07
k	Rounding of each measurement	0.05	$\sqrt{3}$	0.03
l	Instrumentation – Calibration	1.20	$\sqrt{3}$	0.69
Reported Expanded Uncertainty (95% confidence, convergence k = 2)				1.61

10.3 Uncertainty in Calculations

Ref	Source of Uncertainty Section 10.2 British Standard 4142:2014+A1:2019	Value dB(A)	Distribution (Divisor)	Uncertainty dB(A)
a	Impact of measured sound level on calculations	0.00	$\sqrt{2}$	0.00
b	Assumption on sound power level of source	0.00	$\sqrt{3}$	0.00
c	Uncertainty of calculation method (ISO 9613)	0.20	$\sqrt{3}$	0.12
d	Model fit against real world conditions	0.10	$\sqrt{3}$	0.06
e	Error in the calculation process	0.15	$\sqrt{2}$	0.11
Reported Expanded Uncertainty (95% confidence, convergence k = 2)				0.33

10.4 Uncertainty from Other Factors

Ref	Source of Uncertainty Section 10.2 British Standard 4142:2014+A1:2019	Value dB(A)	Distribution (Divisor)	Uncertainty dB(A)
a	Standing waves or interference patterns	0.15	$\sqrt{3}$	0.09
b	Approximation of sound source to a point source	0.10	$\sqrt{3}$	0.06
c	Maintenance and repair of source over 15 years	0.50	$\sqrt{3}$	0.29
Reported Expanded Uncertainty (95% confidence, convergence k = 2)				0.61

10.5 Combined Reported Expanded Uncertainty

Ref	Source of Uncertainty Section 10.2 British Standard 4142:2014+A1:2019	Value dB(A)	Distribution (Divisor)	Uncertainty dB(A)
a	Section 7.1.2. Uncertainty of measured values	2.7	$\sqrt{2}$	1.14
b	Section 7.1.3. Uncertainty of calculations	2.7	$\sqrt{2}$	0.23
c	Section 7.1.4. Uncertainty from other factors	2.7	$\sqrt{2}$	0.43
Combined Reported Expanded Uncertainty (95% confidence, convergence k = 2)				2.55

It should be noted that the uncertainty calculations have assumed a Type B uncertainty.


11 APPENDIX B – RESULTS

11.1 5th – 6th September 2024

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmaz 16 HOUR	55.0	99.6	51.0	59.1	56.5	54.8	50.7	50.4	47.6	40.2	30.4	16.9
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmaz 8 HOUR	48.1	76.4	41.0	52.1	51.9	49.4	44.5	43.3	39.3	33.2	24.9	12.3

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	52.5	49.1	48.5	58.4	54.6	52.3	49.3	49.0	42.6	33.4	24.5	11.9
08:00 - 09:00	55.4	85.5	50.4	60.2	57.2	54.7	51.4	51.5	47.3	39.9	28.9	13.9
09:00 - 10:00	54.4	81.1	50.9	60.2	57.0	55.1	51.1	50.0	45.1	38.4	28.7	15.8
10:00 - 11:00	55.7	84.4	51.4	60.3	57.1	56.7	52.0	51.0	47.5	40.4	29.8	14.0
11:00 - 12:00	59.8	97.3	51.1	60.7	59.8	58.3	53.7	54.7	53.9	47.3	34.9	17.8
12:00 - 13:00	55.5	79.8	51.2	61.3	57.1	56.5	51.5	50.1	48.8	37.4	28.3	14.8
13:00 - 14:00	54.2	71.4	50.5	60.1	57.0	55.4	51.2	49.7	44.7	36.3	26.4	12.6
14:00 - 15:00	58.3	99.6	49.8	58.4	55.5	53.8	50.8	53.7	53.1	45.7	37.2	24.6
15:00 - 16:00	53.2	69.8	47.7	58.2	54.8	52.3	49.2	49.2	45.4	38.4	30.6	15.9
16:00 - 17:00	54.9	79.5	48.6	59.5	58.2	57.7	52.1	49.9	45.5	37.4	29.2	14.8
17:00 - 18:00	53.8	72.8	47.6	59.3	56.4	53.8	50.4	49.6	45.3	37.8	28.9	14.7
18:00 - 19:00	53.6	75.3	47.0	59.0	57.1	54.8	50.2	49.1	45.1	37.5	30.2	20.0
19:00 - 20:00	53.0	75.3	46.3	58.6	55.9	52.8	50.1	48.8	44.0	36.5	27.7	14.5
20:00 - 21:00	51.2	74.7	44.8	56.0	53.9	50.9	48.3	47.0	42.4	34.3	24.7	13.3
21:00 - 22:00	53.2	83.3	44.0	55.7	54.3	53.2	50.2	49.2	44.2	37.1	27.6	14.3
22:00 - 23:00	47.7	64.9	42.2	53.7	52.5	49.5	44.1	43.0	38.2	30.3	21.8	10.4

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmaz	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	47.8	65.4	42.1	53.1	52.1	48.8	43.7	43.7	38.7	30.7	24.4	10.8
23:15 - 23:30	46.2	69.2	41.1	49.8	50.9	47.6	44.1	41.2	34.7	26.6	15.8	8.5
23:30 - 23:45	44.8	62.2	41.0	50.1	50.2	45.7	40.8	40.2	35.9	27.9	18.9	9.9
23:45 - 00:00	44.9	61.7	40.9	50.3	50.1	46.6	40.9	40.4	35.5	27.4	18.5	9.1
00:00 - 00:15	45.5	66.0	41.3	49.7	50.2	45.8	41.7	41.3	36.6	28.4	18.3	9.1
00:15 - 00:30	48.2	73.3	40.9	50.4	49.7	46.2	44.3	45.1	39.3	31.9	19.9	9.3
00:30 - 00:45	44.7	64.6	40.2	49.3	50.8	47.5	40.0	40.2	34.7	26.2	17.3	9.0
00:45 - 01:00	43.8	62.5	40.3	48.2	49.5	45.1	39.5	39.4	34.2	27.3	18.1	9.0
01:00 - 01:15	43.8	61.3	39.7	49.0	49.8	45.0	39.4	39.2	34.6	27.2	17.5	8.8
01:15 - 01:30	41.5	49.5	40.2	45.9	48.6	43.6	37.5	36.1	31.6	24.6	14.5	8.6
01:30 - 01:45	43.3	60.0	40.8	47.6	49.4	45.3	39.4	37.6	34.7	27.2	17.4	11.9
01:45 - 02:00	41.2	55.1	38.6	46.4	48.7	43.2	37.4	35.8	31.2	24.2	14.4	8.6
02:00 - 02:15	41.6	56.3	38.5	46.0	47.8	43.0	37.4	36.7	32.3	25.8	16.1	8.7
02:15 - 02:30	40.1	53.5	38.3	46.2	46.9	43.0	35.6	34.5	30.8	24.4	14.3	8.5
02:30 - 02:45	41.4	49.8	39.6	46.5	49.0	43.4	37.1	36.1	31.9	25.2	14.9	8.6
02:45 - 03:00	42.0	49.4	40.5	46.2	49.1	43.8	37.6	37.0	32.7	25.7	15.0	8.6
03:00 - 03:15	46.2	65.8	40.4	50.1	50.1	45.6	42.9	41.8	37.5	30.4	21.6	10.3
03:15 - 03:30	42.5	55.6	40.0	47.2	49.4	44.5	37.8	37.4	33.6	26.2	15.3	8.8
03:30 - 03:45	42.1	53.6	40.4	48.0	48.8	43.7	37.2	37.2	33.3	25.9	15.1	8.7
03:45 - 04:00	42.9	52.3	40.9	46.9	50.5	44.3	37.6	37.9	34.1	26.5	15.6	8.7
04:00 - 04:15	43.4	60.2	41.0	48.9	50.0	44.5	38.6	38.7	34.9	27.2	16.2	8.7
04:15 - 04:30	46.5	63.8	41.1	52.1	50.6	49.4	41.7	40.9	37.6	31.2	25.2	11.1
04:30 - 04:45	48.7	65.6	45.1	49.1	51.1	51.8	44.6	43.6	39.2	31.5	26.5	11.7
04:45 - 05:00	46.9	66.1	42.3	50.9	51.7	46.6	44.2	41.8	38.4	32.3	23.2	10.6
05:00 - 05:15	50.7	74.8	42.7	54.5	54.2	50.8	47.8	45.6	42.4	36.9	27.1	13.1
05:15 - 05:30	52.2	72.7	47.3	57.7	57.9	53.4	47.5	45.9	44.0	41.1	33.7	20.9
05:30 - 05:45	53.7	75.1	46.2	56.2	54.7	53.4	50.7	49.4	44.9	38.9	30.5	16.7
05:45 - 06:00	54.1	73.2	44.1	58.1	57.2	57.9	51.4	47.6	43.9	38.0	29.2	14.1
06:00 - 06:15	49.2	76.4	43.4	50.6	52.7	49.9	46.4	44.7	39.9	32.8	24.6	12.1
06:15 - 06:30	51.4	68.5	44.4	55.1	53.0	52.7	47.1	47.1	43.0	35.8	28.0	13.1
06:30 - 06:45	51.2	69.1	44.5	54.7	53.6	52.3	47.2	47.1	42.2	35.0	26.4	12.4
06:45 - 07:00	53.2	72.2	44.7	57.8	54.6	52.3	48.9	48.6	46.0	39.7	31.5	17.1

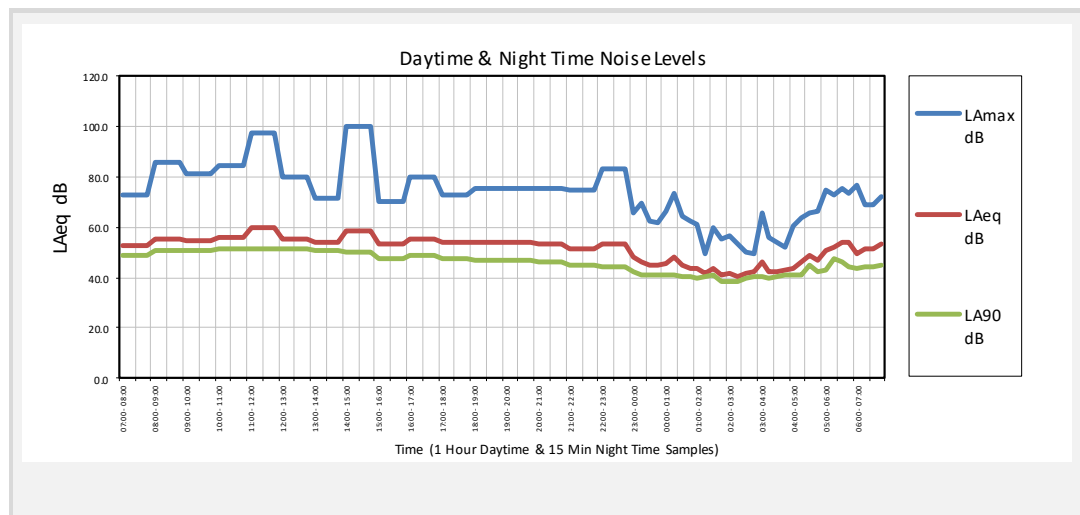


11.2 6th – 7th September 2024

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmx 16 HOUR	53.9	81.3	48.0	59.3	56.0	53.8	50.5	49.8	45.3	37.8	29.1	16.3
NIGHTTIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmx 8 HOUR	47.1	74.3	41.0	53.5	51.8	47.5	44.1	42.9	37.1	29.2	21.2	9.8

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	51.3	74.7	45.6	56.1	54.0	51.1	47.6	47.1	43.1	35.7	27.9	13.8
08:00 - 09:00	54.9	81.3	49.4	59.0	55.8	54.8	51.9	50.7	46.2	39.1	31.3	17.4
09:00 - 10:00	54.4	80.4	48.1	59.3	57.4	57.7	51.7	49.2	44.7	37.1	29.2	19.6
10:00 - 11:00	53.7	74.5	48.1	59.4	56.2	53.8	50.3	49.5	45.1	37.4	28.3	17.8
11:00 - 12:00	54.0	75.9	47.1	60.7	57.0	53.5	50.6	50.0	45.3	37.6	29.2	15.8
12:00 - 13:00	53.4	73.8	47.5	58.4	55.3	53.1	49.9	49.1	45.2	38.9	30.4	17.4
13:00 - 14:00	54.0	78.8	47.7	58.7	55.2	53.1	50.4	49.9	45.7	39.1	31.7	18.2
14:00 - 15:00	54.8	74.9	48.9	60.2	56.9	54.6	51.1	50.5	46.9	39.1	30.4	18.2
15:00 - 16:00	54.7	77.2	48.2	60.3	56.5	54.2	51.9	50.6	46.0	38.5	29.1	14.6
16:00 - 17:00	54.3	80.1	47.8	60.6	57.0	54.1	50.6	50.5	45.3	37.2	28.2	17.5
17:00 - 18:00	54.3	78.1	48.3	59.6	56.4	54.0	51.1	50.4	45.6	37.8	28.7	15.3
18:00 - 19:00	54.5	73.3	49.2	615	57.4	53.6	50.9	50.3	46.0	39.7	29.7	14.8
19:00 - 20:00	54.4	72.5	47.6	59.2	55.7	53.3	51.4	50.5	45.6	38.1	28.1	14.6
20:00 - 21:00	52.1	80.0	46.1	59.1	54.8	51.1	48.7	48.1	43.6	36.1	26.1	12.3
21:00 - 22:00	54.1	77.3	44.7	57.1	53.9	51.3	48.9	51.3	46.4	35.0	25.1	13.7
22:00 - 23:00	50.5	78.6	43.9	55.8	53.2	51.7	47.6	45.9	41.2	33.9	25.9	11.6

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	50.3	72.0	44.6	55.9	55.5	51.1	47.3	46.1	40.0	31.3	22.3	9.5
23:15 - 23:30	50.1	70.0	44.0	56.7	52.1	47.9	46.6	45.7	41.2	37.8	33.1	17.0
23:30 - 23:45	50.2	72.2	42.8	53.3	51.3	48.2	48.2	46.1	40.9	32.1	21.9	10.1
23:45 - 00:00	49.0	68.2	43.5	53.7	515	48.9	46.1	45.0	39.6	30.3	20.3	9.4
00:00 - 00:15	50.1	68.9	43.1	54.5	515	49.8	46.6	46.5	41.1	32.8	22.8	9.9
00:15 - 00:30	48.3	74.3	43.2	52.9	50.1	47.2	46.5	44.4	37.5	27.7	17.5	8.7
00:30 - 00:45	49.3	69.4	43.1	53.7	514	48.0	46.6	45.7	39.8	31.1	21.1	9.0
00:45 - 01:00	49.5	69.3	42.4	58.2	59.3	52.6	45.1	43.9	38.1	29.7	20.0	9.3
01:00 - 01:15	45.4	63.3	41.6	52.2	49.4	46.0	42.4	41.7	35.1	25.8	16.2	8.8
01:15 - 01:30	45.2	618	40.9	52.7	48.8	45.6	42.1	414	35.2	26.2	16.7	8.5
01:30 - 01:45	46.9	67.3	413	52.8	516	50.5	44.0	42.0	35.6	26.4	16.1	8.4
01:45 - 02:00	43.9	612	40.7	54.2	48.4	44.2	40.3	39.3	34.6	30.1	22.9	8.5
02:00 - 02:15	45.1	67.8	416	54.8	52.8	44.9	43.2	39.7	33.7	26.4	14.0	8.3
02:15 - 02:30	47.2	66.3	419	54.3	52.0	45.5	45.6	42.8	36.7	28.6	17.9	9.6
02:30 - 02:45	43.8	60.3	414	53.9	48.2	44.4	416	39.6	32.4	23.9	14.6	8.3
02:45 - 03:00	43.7	64.7	40.2	49.8	47.9	43.7	418	39.5	32.7	23.8	14.6	8.4
03:00 - 03:15	45.1	65.5	411	49.2	48.2	45.5	43.2	40.8	34.0	24.9	15.1	8.5
03:15 - 03:30	47.9	69.6	418	50.6	50.6	48.1	44.3	44.6	38.0	27.4	17.0	9.8
03:30 - 03:45	45.8	69.2	417	516	50.3	45.9	42.3	42.6	35.1	24.8	14.9	8.3
03:45 - 04:00	44.4	63.6	40.7	50.0	48.6	45.3	414	40.5	34.0	24.6	15.1	9.1
04:00 - 04:15	46.0	63.7	411	50.6	49.5	46.3	43.1	42.0	36.2	26.5	16.9	8.5
04:15 - 04:30	43.6	57.8	411	50.6	49.9	45.4	40.6	38.9	33.0	24.7	14.4	8.3
04:30 - 04:45	44.6	62.5	416	51.1	49.9	45.9	413	40.5	33.9	24.8	15.5	8.4
04:45 - 05:00	45.1	63.5	40.9	52.8	50.0	46.3	415	413	34.5	24.3	15.0	8.4
05:00 - 05:15	43.6	55.1	417	53.3	50.8	46.0	40.8	38.2	31.9	24.1	14.1	8.2
05:15 - 05:30	44.5	66.4	411	519	52.7	46.2	40.8	39.6	33.3	24.9	15.4	8.4
05:30 - 05:45	46.1	65.2	410	52.7	50.3	46.6	42.7	42.2	36.5	27.9	18.0	8.7
05:45 - 06:00	44.6	64.3	418	50.4	49.6	46.0	40.8	40.1	35.1	28.8	18.3	8.5
06:00 - 06:15	42.3	50.7	40.8	50.9	49.5	44.5	39.2	37.1	31.2	23.6	14.3	8.3
06:15 - 06:30	48.9	68.5	42.7	58.0	53.1	49.1	44.8	45.0	40.1	315	212	9.6
06:30 - 06:45	47.0	69.3	42.7	515	518	47.1	44.3	42.6	37.9	29.4	20.4	9.2
06:45 - 07:00	48.3	63.8	43.5	54.0	53.5	48.8	45.4	44.2	38.3	28.3	19.1	13.8

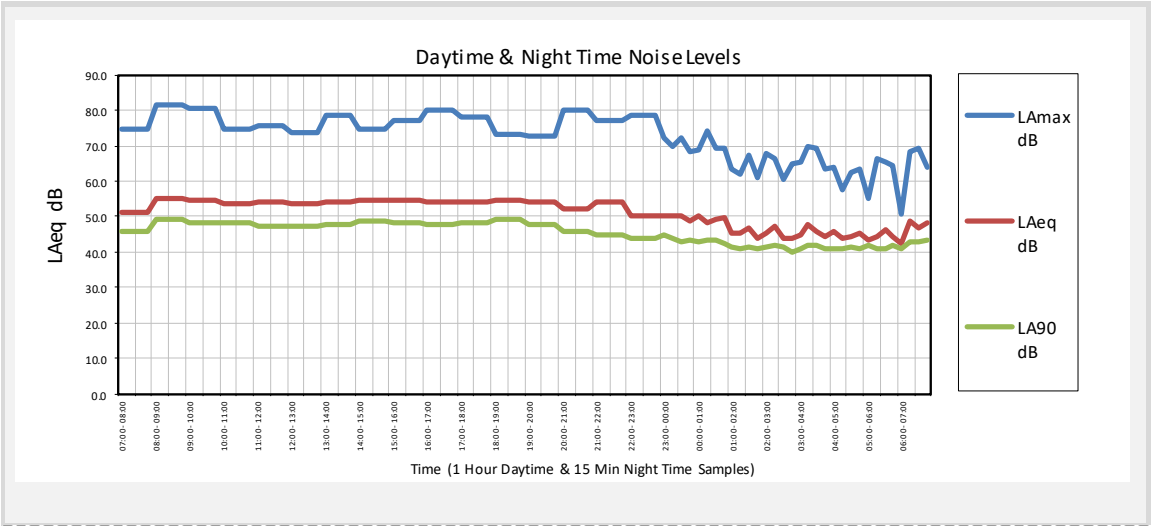


11.3 7th – 8th September 2024

NOISE LEVEL SUMMARY ASSESSMENT						Octave Band Centre Frequency (Hz)						
Date / Time	LAeq	LAmix	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Cor r esponding LAmix 16 HOUR	53.2	86.5	44.0	58.8	56.0	53.7	50.2	48.9	44.1	36.8	27.0	16.6
NIGHT TIME 23:00 - 07:00 LAeq 8 HOUR & Cor r esponding LAmix 8 HOUR	54.0	86.0	42.0	55.2	55.0	53.8	49.7	47.9	46.3	43.5	39.0	28.3

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	L _{Aeq}	L _{Amax}	L _{A90}	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	49.0	71.5	43.5	54.3	53.3	49.7	45.9	44.7	39.8	31.1	21.7	10.8
08:00 - 09:00	51.1	76.2	44.2	55.7	56.9	52.6	47.6	46.2	41.6	34.7	24.3	10.5
09:00 - 10:00	52.4	76.4	45.4	57.3	54.7	52.2	49.6	48.1	43.3	36.3	27.2	12.8
10:00 - 11:00	53.2	79.3	46.7	58.9	55.6	52.6	49.8	49.3	44.8	36.1	27.1	12.8
11:00 - 12:00	53.8	75.1	47.0	59.1	56.1	53.6	51.3	49.4	44.8	38.6	29.2	15.1
12:00 - 13:00	54.0	72.1	47.9	59.9	58.1	53.6	51.0	49.7	45.1	37.4	28.5	14.2
13:00 - 14:00	54.6	85.3	49.5	59.6	56.9	55.6	51.2	50.4	45.0	36.9	27.7	14.8
14:00 - 15:00	55.2	86.5	49.5	58.2	56.8	56.7	52.3	51.2	44.6	37.2	28.3	14.5
15:00 - 16:00	54.5	77.4	50.2	60.9	57.0	56.3	51.8	49.2	44.7	37.6	28.2	12.9
16:00 - 17:00	54.8	76.7	49.8	60.8	56.5	55.6	51.9	50.1	46.1	37.7	28.4	16.1
17:00 - 18:00	53.9	73.9	48.6	62.0	56.5	54.4	50.6	49.6	45.1	37.3	27.5	12.5
18:00 - 19:00	53.0	75.7	45.6	60.0	57.5	52.7	49.6	48.5	43.6	39.2	26.8	14.2
19:00 - 20:00	53.3	73.2	45.2	58.5	55.8	53.2	50.3	49.2	44.5	37.3	28.9	16.4
20:00 - 21:00	52.2	79.9	44.6	56.7	53.7	51.6	48.7	48.2	44.2	34.5	23.3	11.0
21:00 - 22:00	50.7	80.3	44.3	55.7	52.9	50.7	47.4	46.6	41.9	33.7	22.4	11.3
22:00 - 23:00	51.4	74.5	42.7	55.8	53.5	51.2	48.8	46.9	42.9	37.3	24.5	11.5

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	L _{Aeq}	L _{Amax}	L _{A90}	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	46.8	62.2	41.6	53.7	50.6	46.7	43.6	42.8	37.6	28.7	19.5	9.0
23:15 - 23:30	49.4	67.9	42.3	54.8	56.0	49.5	46.5	45.0	39.6	31.5	21.6	11.1
23:30 - 23:45	48.6	71.0	41.7	52.9	50.3	48.6	48.0	43.8	37.6	28.2	17.7	9.3
23:45 - 00:00	45.0	69.0	41.6	60.1	50.3	45.2	41.9	40.3	35.3	30.4	17.6	8.5
00:00 - 00:15	45.7	64.3	41.5	52.5	49.7	45.8	43.2	41.8	35.4	26.3	16.0	8.6
00:15 - 00:30	46.2	69.1	40.6	52.3	49.4	45.9	42.4	42.3	37.7	28.9	19.2	9.0
00:30 - 00:45	45.0	64.6	40.5	52.4	48.8	45.9	42.3	40.7	35.2	26.4	16.5	8.9
00:45 - 01:00	45.8	63.0	40.8	52.5	51.6	47.8	42.5	40.7	35.8	28.0	18.4	8.8
01:00 - 01:15	43.6	59.6	40.2	52.4	49.0	46.2	40.8	38.6	33.2	25.5	15.9	8.4
01:15 - 01:30	42.8	56.3	39.8	53.7	49.5	44.4	39.6	38.0	32.0	24.4	14.9	8.4
01:30 - 01:45	43.5	57.0	40.2	53.0	49.3	45.5	39.9	38.9	33.2	26.2	14.9	8.4
01:45 - 02:00	65.5	86.0	61.9	65.2	67.1	66.5	61.7	58.9	57.4	54.7	50.2	40.0
02:00 - 02:15	65.1	80.7	62.9	62.1	62.6	62.1	59.7	58.9	58.3	56.0	51.6	40.6
02:15 - 02:30	47.7	62.6	44.5	54.8	51.5	48.4	42.9	42.5	39.7	35.8	30.0	17.3
02:30 - 02:45	47.0	70.7	41.6	54.3	49.4	45.6	42.1	42.4	38.4	37.5	25.7	14.1
02:45 - 03:00	45.4	61.0	41.6	50.7	47.8	43.9	39.8	41.9	37.6	31.4	23.9	12.7
03:00 - 03:15	45.3	60.5	41.9	51.3	49.0	44.6	40.6	41.5	37.1	29.6	21.8	11.7
03:15 - 03:30	44.2	59.0	41.0	48.4	47.9	43.6	38.9	40.5	36.3	28.4	20.2	10.9
03:30 - 03:45	47.0	67.9	41.7	50.6	49.8	46.3	42.3	43.4	38.8	31.0	22.1	10.9
03:45 - 04:00	44.4	62.4	42.0	47.7	48.4	45.7	40.8	39.5	35.1	27.8	18.9	10.1
04:00 - 04:15	44.8	62.5	41.3	50.1	48.8	45.3	40.8	40.4	36.3	28.8	19.9	10.1
04:15 - 04:30	45.1	61.1	41.7	50.5	50.0	46.3	40.5	40.9	36.4	29.0	19.5	10.0
04:30 - 04:45	45.7	64.5	41.6	51.2	50.1	46.0	41.6	41.7	36.7	30.6	20.8	10.4
04:45 - 05:00	48.6	76.0	40.7	52.7	52.5	48.5	47.6	43.6	36.2	29.1	20.3	9.8
05:00 - 05:15	41.7	51.0	39.6	47.8	47.5	42.9	38.0	37.1	32.3	25.2	17.1	9.4
05:15 - 05:30	44.3	69.5	40.8	51.5	48.2	47.5	41.3	39.5	33.0	27.0	17.7	9.0
05:30 - 05:45	42.3	52.9	40.5	49.1	47.5	44.6	37.9	37.3	32.8	25.2	15.9	8.8
05:45 - 06:00	44.3	60.8	40.8	49.5	49.2	45.3	40.1	40.1	35.1	27.8	19.1	9.4
06:00 - 06:15	45.2	67.0	40.4	50.5	49.2	46.5	40.9	40.9	36.5	29.3	20.7	9.4
06:15 - 06:30	46.2	67.5	41.3	50.9	49.5	48.4	42.1	42.2	36.0	27.4	19.0	9.7
06:30 - 06:45	45.1	61.5	41.7	50.9	49.5	47.2	41.9	40.2	35.2	27.8	18.6	9.3
06:45 - 07:00	51.7	77.2	42.6	54.3	52.9	54.7	48.2	45.7	43.9	36.6	24.7	10.6

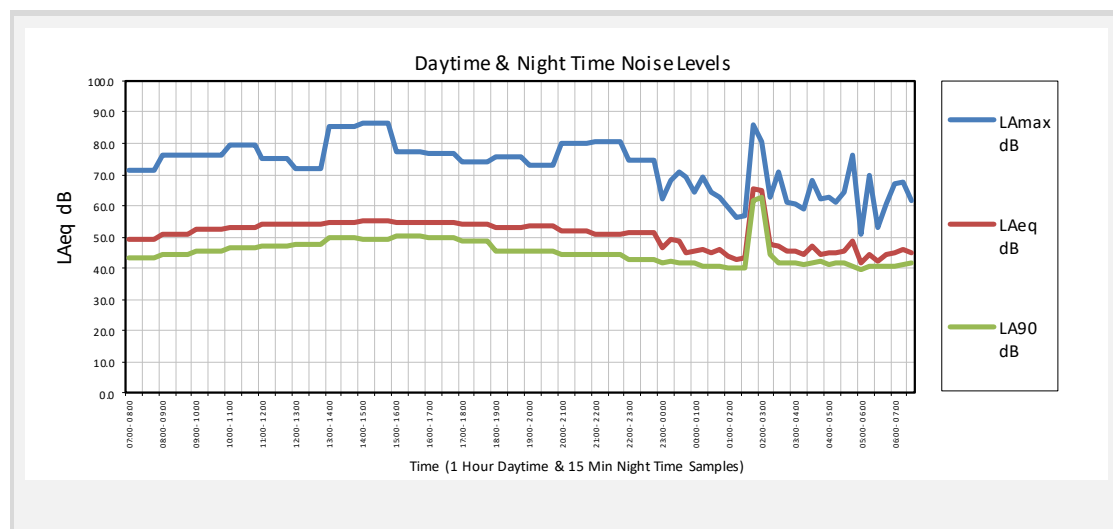


11.4 8th – 9th September 2024

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 LAeq 16 HOUR & Corresponding LAmx 16 HOUR	55.6	83.7	44.0	58.7	56.6	54.5	51.0	50.5	48.5	44.2	38.5	26.7
NIGHTTIME 23:00 - 07:00 LAeq 8 HOUR & Corresponding LAmx 8 HOUR	48.1	75.3	41.0	53.6	51.6	48.8	44.8	43.5	39.0	33.2	25.8	13.4

DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	48.3	74.3	42.4	52.5	51.1	49.5	44.9	44.1	39.0	31.3	21.7	10.0
08:00 - 09:00	50.0	75.3	44.2	54.4	53.7	51.7	47.1	45.1	40.8	32.9	22.6	10.5
09:00 - 10:00	50.7	72.7	44.4	56.2	54.0	51.5	47.4	46.4	41.5	34.4	26.5	11.0
10:00 - 11:00	54.0	76.6	46.9	59.8	59.0	57.2	50.0	48.9	44.1	36.2	26.8	13.1
11:00 - 12:00	53.9	72.1	47.6	58.9	56.8	55.2	50.8	49.5	44.6	37.1	27.6	13.9
12:00 - 13:00	63.8	77.1	61.3	60.2	58.9	58.9	56.7	57.8	58.0	54.6	49.7	38.2
13:00 - 14:00	58.9	83.7	52.6	61.8	61.3	58.8	55.3	53.6	51.1	46.6	39.5	25.8
14:00 - 15:00	56.1	73.6	50.6	62.6	58.0	54.1	51.1	51.2	49.0	45.0	38.0	24.2
15:00 - 16:00	54.7	77.9	48.1	58.9	55.5	53.2	50.9	50.9	46.5	39.6	30.8	16.5
16:00 - 17:00	54.4	74.8	47.6	59.3	55.3	53.2	50.9	50.6	45.9	38.7	29.5	15.0
17:00 - 18:00	53.5	73.1	46.4	59.0	54.8	52.8	50.8	49.3	44.6	37.0	27.6	15.7
18:00 - 19:00	52.9	72.1	45.0	57.4	54.8	52.8	49.8	48.5	44.5	36.6	28.0	14.0
19:00 - 20:00	53.4	78.2	45.3	57.7	57.2	55.1	50.1	48.7	44.3	36.2	26.8	13.1
20:00 - 21:00	51.0	76.2	44.8	56.1	53.5	50.6	47.5	47.1	42.5	34.3	26.3	14.1
21:00 - 22:00	50.1	78.7	43.9	57.2	57.0	52.8	46.9	44.4	38.8	30.1	21.6	10.0
22:00 - 23:00	48.0	71.9	43.6	53.7	52.1	49.7	44.9	43.7	37.9	28.2	18.6	9.3

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES				Octave Band Centre Frequency (Hz)								
Date / Time	LAeq	LAmx	LA90	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	45.2	60.6	41.9	53.3	51.2	47.4	41.7	40.5	34.8	26.6	16.9	8.5
23:15 - 23:30	46.5	66.3	43.0	51.9	50.6	47.4	43.0	42.3	37.2	28.4	17.8	8.7
23:30 - 23:45	45.0	65.5	41.6	51.9	50.3	47.1	42.3	39.8	34.3	26.0	16.3	8.5
23:45 - 00:00	47.8	65.7	42.2	53.1	51.3	48.6	44.8	43.4	38.8	29.5	18.9	9.1
00:00 - 00:15	45.7	67.3	41.6	56.4	53.8	47.5	41.7	40.3	34.9	26.7	17.0	8.7
00:15 - 00:30	46.1	68.1	41.5	57.9	50.7	47.3	43.3	41.2	36.2	26.7	16.7	8.9
00:30 - 00:45	44.6	59.2	41.6	51.1	50.1	46.5	41.1	39.8	35.0	27.0	17.9	9.2
00:45 - 01:00	43.6	59.3	40.7	50.7	49.2	45.6	40.2	38.6	33.7	25.9	17.9	9.1
01:00 - 01:15	43.6	61.9	40.9	50.7	49.4	45.3	40.3	39.0	33.7	24.7	15.2	8.4
01:15 - 01:30	41.2	48.9	40.0	50.1	48.7	44.6	38.2	35.2	28.7	21.3	13.1	8.3
01:30 - 01:45	41.3	58.2	39.8	49.5	48.5	44.3	38.5	35.5	29.3	22.2	14.6	8.7
01:45 - 02:00	44.3	69.4	41.4	49.9	49.7	45.8	40.8	40.1	33.5	25.4	16.5	9.0
02:00 - 02:15	44.4	64.5	40.9	50.1	50.3	46.1	40.9	40.1	34.0	24.9	15.6	8.7
02:15 - 02:30	41.6	45.7	40.6	49.0	49.2	44.7	38.7	35.6	29.1	22.1	13.8	8.4
02:30 - 02:45	43.8	60.9	41.0	50.8	50.1	45.7	40.4	38.6	34.1	26.7	18.5	10.0
02:45 - 03:00	41.6	50.0	40.1	48.9	48.7	44.9	38.6	35.7	29.3	22.2	13.4	8.3
03:00 - 03:15	41.6	53.3	40.5	49.6	48.7	44.7	38.8	35.8	29.5	22.2	13.4	8.3
03:15 - 03:30	43.6	55.6	41.7	50.9	50.5	46.3	40.7	38.0	32.4	24.5	14.1	8.3
03:30 - 03:45	41.8	47.0	40.6	49.5	49.1	44.8	38.9	36.1	29.5	22.0	13.5	8.3
03:45 - 04:00	42.3	61.4	40.5	49.3	48.7	45.0	39.4	37.3	30.8	22.6	14.1	8.3
04:00 - 04:15	42.9	57.9	41.3	50.4	48.7	44.9	39.9	37.9	32.4	24.7	15.3	8.3
04:15 - 04:30	42.9	59.5	41.0	49.2	49.2	45.0	39.7	38.0	32.1	24.4	15.2	8.6
04:30 - 04:45	48.0	64.2	43.9	53.3	50.6	51.2	43.9	42.4	38.4	31.6	25.3	11.5
04:45 - 05:00	47.3	63.1	42.9	51.5	51.6	50.4	43.9	41.8	37.2	29.1	20.4	9.8
05:00 - 05:15	49.2	71.6	44.6	56.0	52.9	50.9	46.4	43.7	39.7	34.4	25.9	12.3
05:15 - 05:30	56.1	73.8	49.6	58.8	55.3	53.9	53.1	52.1	48.0	41.4	32.6	19.2
05:30 - 05:45	51.1	72.1	45.8	57.5	53.8	51.1	48.3	46.2	42.9	36.4	27.6	11.8
05:45 - 06:00	52.8	73.5	45.7	57.0	55.6	53.5	50.4	48.4	42.8	35.6	27.1	13.3
06:00 - 06:15	49.8	66.1	45.9	54.6	53.3	50.2	46.4	45.8	40.1	32.9	23.4	10.1
06:15 - 06:30	53.1	68.8	48.3	54.8	53.4	52.7	48.1	48.2	45.1	42.3	36.1	22.8
06:30 - 06:45	49.7	62.7	47.6	54.5	52.6	48.8	44.8	44.7	41.7	39.2	33.5	20.6
06:45 - 07:00	52.8	75.3	47.1	56.9	55.9	53.0	48.7	48.8	43.7	37.1	29.5	14.9

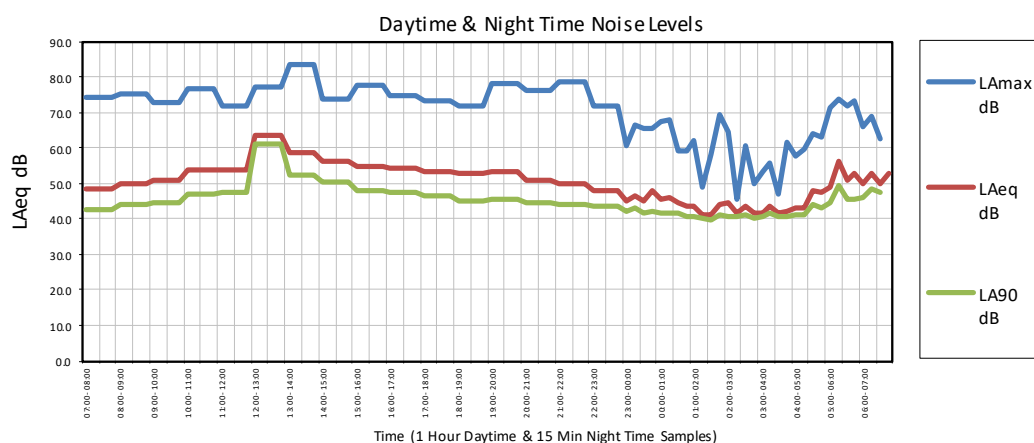


11.5 9th – 10th September 2024

NOISE LEVEL SUMMARY ASSESSMENT				Octave Band Centre Frequency (Hz)								
Date / Time	L _{Aeq}	L _{Amax}	L _{A90}	63	125	250	500	1.0k	2.0k	4.0k	8.0k	16.0k
DAYTIME 07:00 - 23:00 L_{Aeq} 16 HOUR & Corresponding L_{Amax} 16 HOUR	55.0	88.3	51.0	59.5	56.3	54.3	51.5	50.9	46.8	40.4	31.0	15.9
NIGHT TIME 23:00 - 07:00 L_{Aeq} 8 HOUR & Corresponding L_{Amax} 8 HOUR	48.1	76.5	42.0	55.0	52.9	49.6	45.1	43.7	37.8	29.4	20.1	9.1


DAYTIME NOISE LEVELS 07:00 - 23:00 1 HOUR SAMPLES												
Date / Time	L _{Aeq}	L _{Amax}	L _{A90}	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
07:00 - 08:00	53.5	82.1	47.7	57.4	54.7	53.0	49.8	49.6	45.0	37.8	28.8	14.3
08:00 - 09:00	53.7	74.6	49.2	58.1	55.5	53.2	49.7	50.2	45.1	36.8	27.8	15.7
09:00 - 10:00	59.9	88.3	51.1	61.3	57.0	55.3	55.4	56.3	52.7	46.2	37.4	21.1
10:00 - 11:00	55.0	77.9	50.7	60.1	57.6	56.6	51.8	50.5	45.3	37.3	28.9	15.6
11:00 - 12:00	60.0	86.7	51.3	61.1	59.1	58.3	55.8	55.8	52.8	46.6	38.8	20.0
12:00 - 13:00	54.9	84.9	51.2	61.2	57.9	55.7	51.3	49.5	45.7	43.3	29.1	17.1
13:00 - 14:00	54.4	78.3	50.7	59.3	56.7	56.3	51.8	49.5	44.3	36.1	26.4	13.3
14:00 - 15:00	54.0	72.3	50.0	60.0	55.9	54.0	51.0	49.2	45.0	42.0	27.9	12.9
15:00 - 16:00	53.5	75.1	48.3	60.0	57.1	53.5	50.3	49.4	44.5	36.7	27.0	17.5
16:00 - 17:00	53.6	70.9	48.4	61.1	56.6	53.2	50.3	49.5	44.8	36.8	27.0	14.2
17:00 - 18:00	53.7	76.1	47.3	59.3	55.2	52.5	50.6	49.9	45.0	36.9	27.4	13.6
18:00 - 19:00	54.5	82.9	47.1	60.0	56.8	54.1	51.7	50.3	45.6	38.0	28.1	12.8
19:00 - 20:00	53.1	71.7	46.1	58.5	54.9	52.4	50.1	49.2	44.3	35.8	26.2	11.2
20:00 - 21:00	51.7	71.1	45.1	56.4	55.2	51.5	48.6	47.8	42.7	33.8	22.7	16.6
21:00 - 22:00	50.4	70.7	44.4	56.7	53.9	51.5	47.4	46.1	40.7	31.6	21.5	9.8
22:00 - 23:00	48.9	67.9	43.0	55.3	52.4	48.8	46.4	44.8	39.0	30.0	20.0	9.0

NIGHT TIME NOISE LEVELS 23:00 - 07:00 15 MINUTE SAMPLES												
Date / Time	L _{Aeq}	L _{Amax}	L _{A90}	63	125	250	500	1.0 k	2.0 k	4.0 k	8.0 k	16.0 k
23:00 - 23:15	49.4	68.8	43.8	54.7	55.5	51.5	46.5	44.0	38.3	30.0	20.4	8.9
23:15 - 23:30	47.4	60.8	44.0	53.8	52.7	48.1	45.0	43.0	37.2	28.5	18.4	8.8
23:30 - 23:45	49.9	64.8	46.9	55.6	54.4	50.0	46.3	45.5	42.1	31.9	22.3	9.4
23:45 - 00:00	46.0	62.9	43.8	52.0	52.9	47.7	43.4	41.3	34.4	24.8	14.7	8.3
00:00 - 00:15	44.8	53.8	43.7	52.4	53.2	46.6	43.0	39.7	32.1	22.3	14.1	8.3
00:15 - 00:30	44.7	59.7	42.8	52.2	52.1	46.2	42.3	39.9	32.8	23.0	14.2	8.3
00:30 - 00:45	44.6	62.2	42.2	51.9	51.0	46.4	42.1	40.1	32.8	23.3	14.2	8.3
00:45 - 01:00	46.1	67.8	42.0	53.1	51.2	46.9	42.9	42.1	36.0	26.0	16.3	8.5
01:00 - 01:15	45.6	64.2	41.9	58.5	51.6	46.5	43.0	40.9	35.3	26.6	16.2	8.4
01:15 - 01:30	43.7	60.5	42.1	55.3	51.6	46.2	41.3	37.9	31.1	24.7	17.4	8.5
01:30 - 01:45	45.9	65.3	41.6	54.7	51.5	47.0	42.2	41.1	37.5	28.4	18.6	8.9
01:45 - 02:00	42.8	56.1	40.9	54.9	51.2	45.1	39.7	37.3	30.9	23.3	14.2	8.3
02:00 - 02:15	43.2	48.1	42.1	52.8	52.3	45.9	40.3	37.7	29.7	21.8	13.1	8.2
02:15 - 02:30	42.8	47.4	41.7	52.1	52.1	45.7	40.1	36.8	28.5	20.6	12.8	8.2
02:30 - 02:45	43.6	52.3	42.4	53.6	53.5	46.4	40.8	37.8	29.0	20.9	12.9	8.2
02:45 - 03:00	44.7	61.0	42.9	55.5	54.2	46.9	41.7	39.5	31.4	22.6	13.8	8.3
03:00 - 03:15	45.1	62.6	43.1	55.4	53.6	46.8	42.0	40.0	34.0	26.4	17.1	8.5
03:15 - 03:30	44.5	62.5	43.0	55.6	51.0	46.5	41.9	39.7	32.9	24.6	14.3	8.3
03:30 - 03:45	46.3	68.0	42.8	54.1	53.7	47.1	42.6	42.6	35.0	24.5	14.8	8.4
03:45 - 04:00	43.4	51.1	42.2	51.1	48.9	46.0	41.1	38.7	29.5	20.6	12.9	8.2
04:00 - 04:15	47.1	72.5	42.0	52.8	50.1	47.6	44.6	42.9	37.4	29.9	22.7	9.5
04:15 - 04:30	48.8	70.1	43.1	53.7	51.1	49.9	45.0	45.0	39.4	29.7	20.6	11.6
04:30 - 04:45	49.1	63.0	45.0	52.4	51.7	52.8	45.4	43.8	38.3	30.8	25.0	11.9
04:45 - 05:00	46.2	62.3	44.4	52.7	51.4	47.6	43.4	42.1	34.5	26.4	17.6	8.9
05:00 - 05:15	49.8	71.1	45.2	54.9	52.8	52.0	47.0	45.1	39.8	32.4	22.1	9.8
05:15 - 05:30	48.6	65.3	45.8	54.5	51.7	49.1	46.5	44.5	37.3	29.4	19.0	8.5
05:30 - 05:45	49.6	72.2	46.1	54.9	52.9	51.4	47.6	45.2	37.3	29.1	17.9	8.4
05:45 - 06:00	53.7	75.8	50.1	57.5	56.8	56.5	50.4	49.0	44.1	36.6	26.7	11.4
06:00 - 06:15	51.7	74.6	47.3	56.8	53.7	52.1	48.9	47.7	41.7	34.3	23.9	9.5
06:15 - 06:30	51.6	69.7	46.9	58.5	54.3	52.7	48.8	47.5	41.7	33.7	23.2	9.7
06:30 - 06:45	50.5	69.1	47.3	58.5	53.6	50.8	46.7	46.5	41.8	31.9	22.0	9.1
06:45 - 07:00	52.3	76.5	47.1	57.4	55.4	52.8	48.8	48.8	42.0	33.0	25.1	10.6

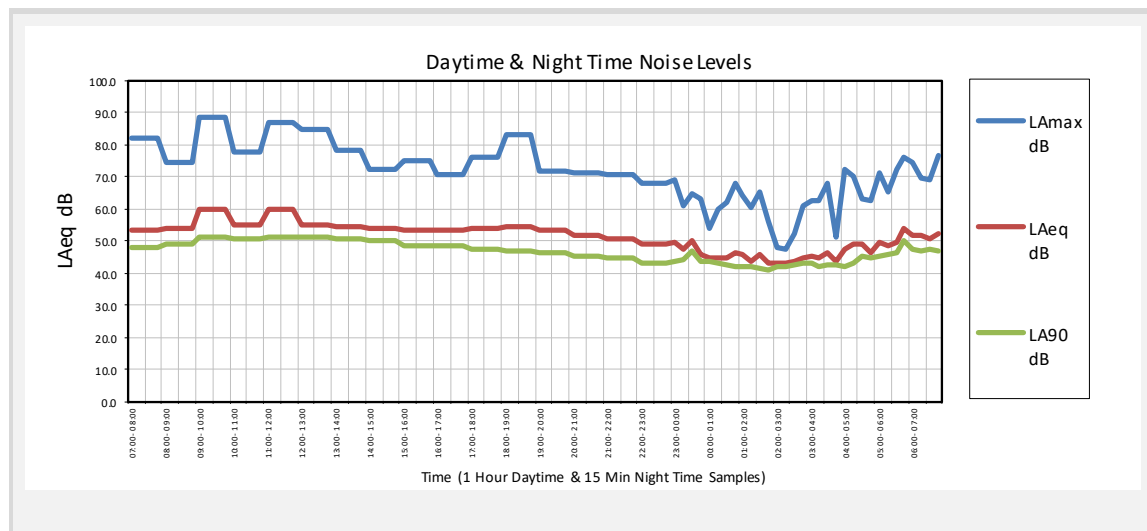

12 APPENDIX C – WEATHER CONDITIONS

12.1 5th – 10th September 2024

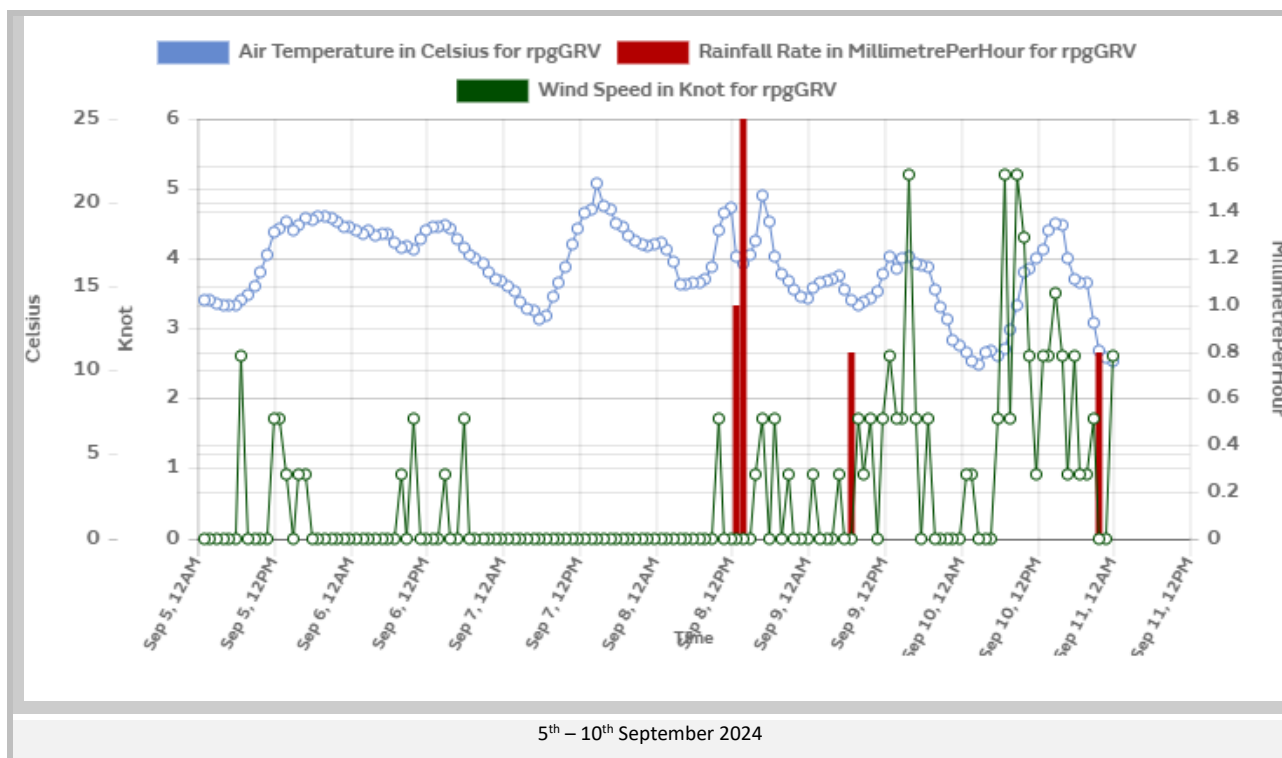

13 APPENDIX D – BS 4142:2019+A1:2019 INFORMATION

In accordance with BS 4142:2014:A1:2019, section 12, the following information is provided.

13.1 Professional Competence

Acoustic Consultant	Mr Brian Scrivener MIOA
Qualifications	Member of the Institute of Acoustics (MIOA)
Date Certified	June 2003
Time Operating as an active Noise Consultant	Permanently Since June 2003
Professional Position	Owner of Sound Advice Acoustics Ltd & Sound Advice Engineering Managing Director & Share Holder
Professional Status	Noise Consultant
Professional Statement	
I have been active within the field of noise consultancy and noise control engineering since I joined the company in April 1997. Working my way through the company and gaining experience in this specialist field, I qualified as a noise consultant in June 2003 when I passed my Diploma in Noise Control & Engineering from Epsom College under the tutor of Dr Latha Vesudevan. Subsequently I was awarded the status of 'Member of the Institute of Acoustics (MIOA)'. Since then I have taken over the company and continued to work and develop my professional competence within the field of acoustic consultancy, engineering and noise control.	

13.2 Site Status

Site Attended By	Mr Brian Scrivener MIOA
Baseline Measurements Conducted by	Mr Brian Scrivener MIOA
Site Source Measurements Conducted By	Mr Brian Scrivener MIOA

13.3 Measurement Information – Location 1

Details & Justification	Measurement position 1 was located at the rear of the existing premises, representative of the Nearest Noise Sensitive Premises
Height from Ground	1.5m
Reflective Surfaces	None (Free Field)
Distance to NSP	2m
Distance to Source	2m
Topographical Change (m)	None
Ground between Source and Receiver	100% Hard surface from kitchen extract louvre to residential flats above
Windshield Information	Norsonic Outdoor Microphone Protection Kit Model No: 1212
Distance from Proposed Source to Receiver	2m
NSP* - Noise Sensitive Premises	

END OF REPORT