
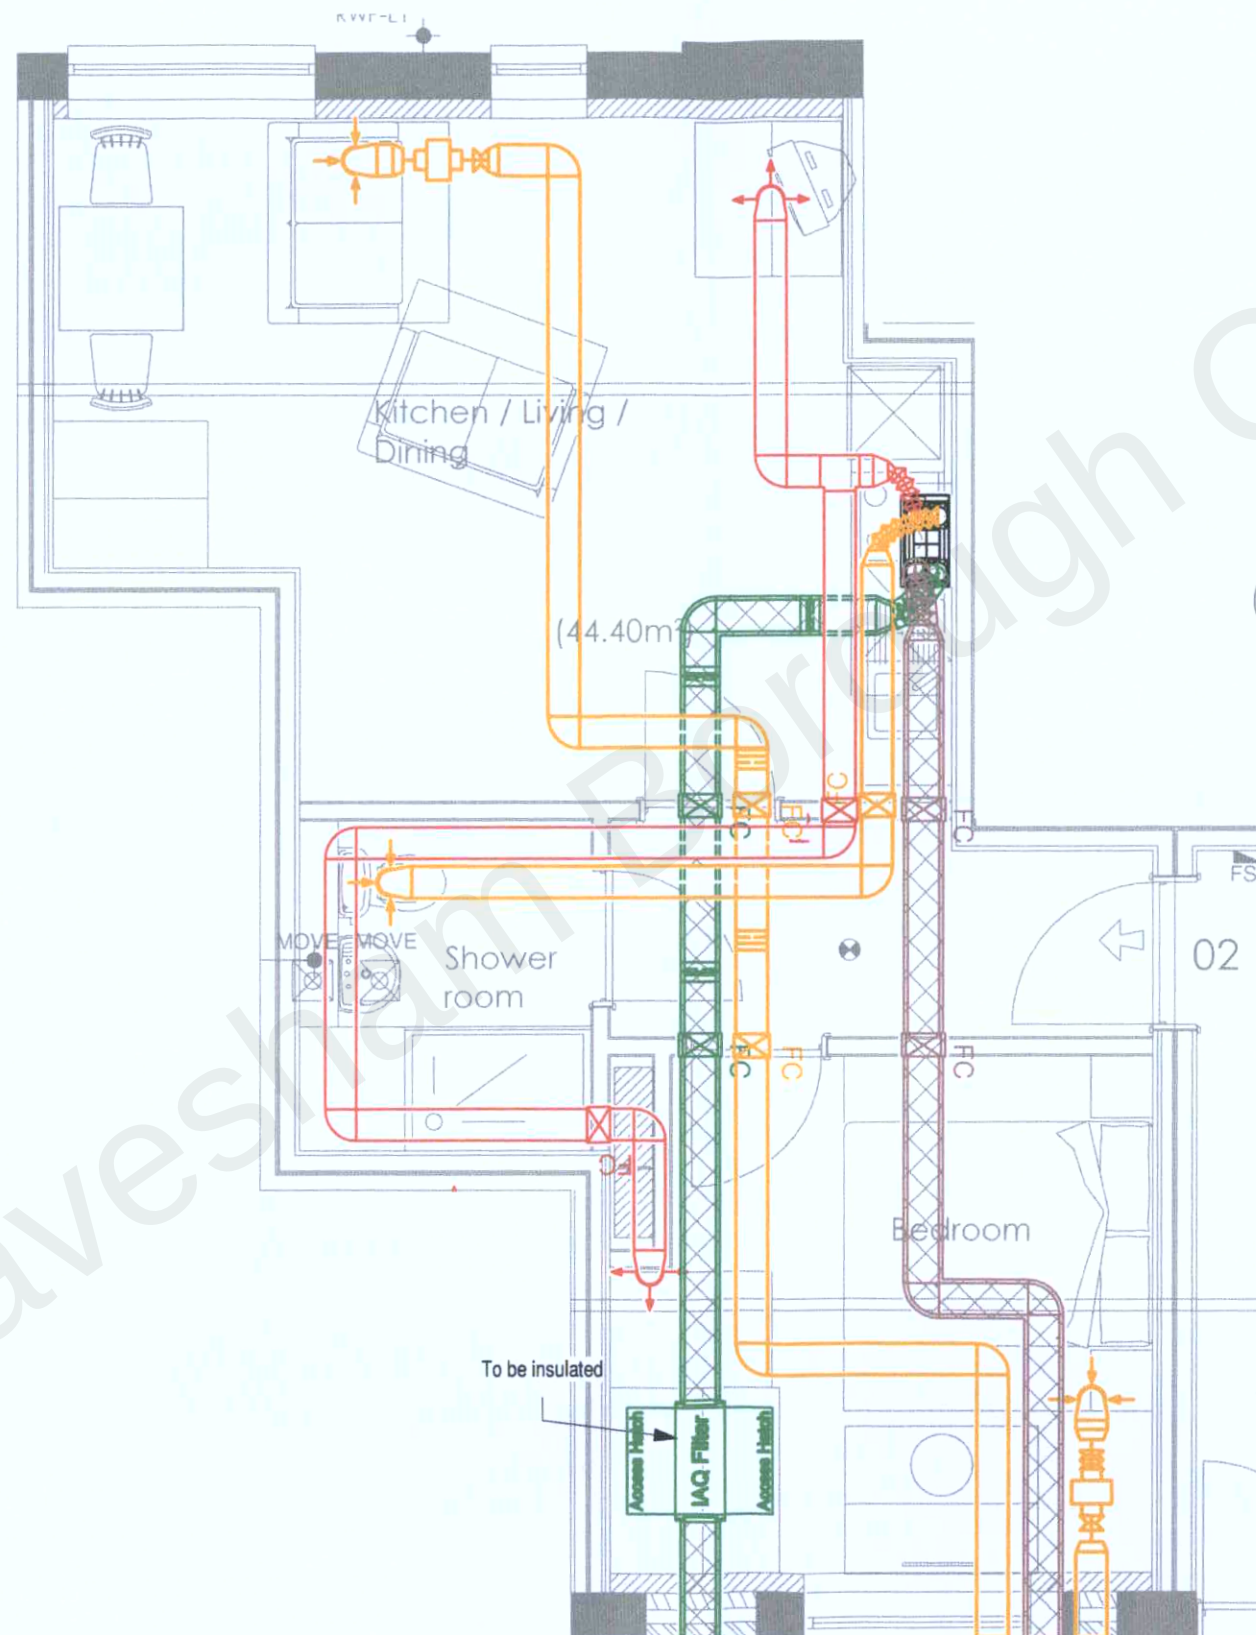


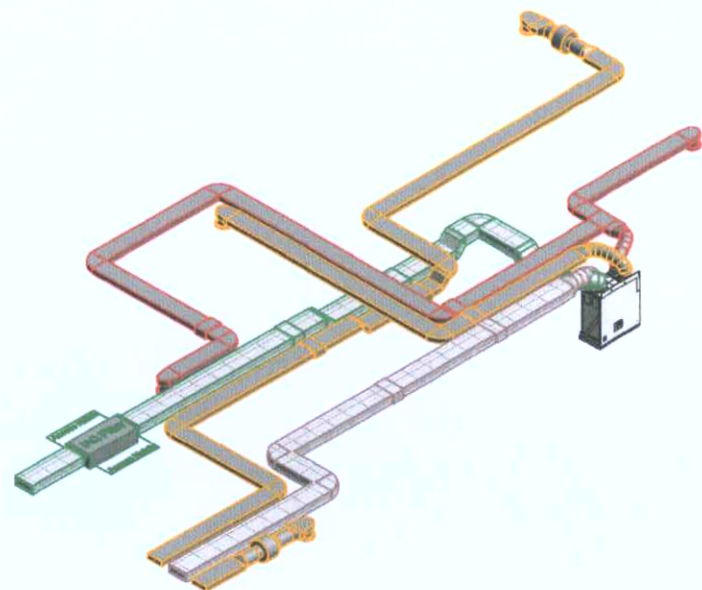

COMMISSIONING TABLE (l/s)

EXTRACT	Purge	Boost	Trickle
Kitchen	N/A	13.0	8.1
Bathroom	N/A	8.0	5.0
	N/A	21.0	13.1
SUPPLY	Purge	Boost	Trickle
Living Area	39.5	13.8	8.6
Bedroom 1	29.3	10.3	6.4
	68.8	24.1	15.0

(Flow rates to Doc F Building Regs)

NOTES:

THIS SYSTEM PROPOSAL HAS BEEN DESIGNED TO COMPLY WITH THE CURRENT BUILDING REGULATIONS - MEANS OF VENTILATION.

THE SYSTEM MUST BE INSTALLED AND COMMISSIONED WITH GOOD INSTALLATION PRACTICE AND AS PER THE DESIGN SPECIFICATION.

VENT-AXIA CANNOT GUARANTEE SYSTEM COMPLIANCE IF ALTERNATIVE DESIGN IS USED OR INSTALLED BY OTHERS. THE COMMISSIONED SYSTEM MUST COMPLY WITH THE LATEST EDITION I.E. BS7171 WIRING REGULATIONS.

VENT-AXIA WILL NOT BE RESPONSIBLE FOR CONSEQUENCES OUTSIDE OUR CONTROL, CAUSED BY THE SYSTEM INSTALLATION E.G. PROPERTY ACoustics, STRUCTURAL INTEGRITY ETC.

THIS DESIGN PROPOSAL HAS BEEN PRODUCED IN GOOD FAITH BUT IS SUBJECT TO APPROVAL BY THE PROJECT CLIENT.

THE DESIGN IS SUBJECT TO COPYRIGHT AND MUST NOT BE ALTERED, AMENDED OR INCORPORATED IN ANYWAY WHATSOEVER, NOR SHALL IT BE REPRODUCED IN WHOLE OR IN PART WITHOUT THE EXPRESS PERMISSION OF VENT-AXIA.

UNIT IS TO RUN AT CONTINUOUS TRICKLE WITH BOOST BEING ACTIVATED VIA A TRICKLE / BOOST CONTROLLER AND LOCAL BOOST SWITCHES (E.G. LIGHTS) IN ALL WET ROOMS. IF SWITCHING VIA LIGHTS, DOUBLE POLE SWITCHES OR RELAYS (E.G. VA 44200) WILL BE REQUIRED. LOCAL SWITCHING NOT SPECIFICALLY REQUIRED FOR INTERNAL HUMIDITY AT UNIT.

EXHAUST AND INTAKE DUCTING TO AND FROM ATMOSPHERE AND ALL DUCTING IN COLD ROOF SPACE TO BE DUCTED VIA PULLY INSULATED RIGID PLASTIC DUCTING TO EXTERNAL TERMINATIONS (INSTALLED BY OTHERS).

ALL CENTRAL MVHR UNITS AND MEV UNITS IN COLD ROOF SPACES TO HAVE A CONDENSATE DRAIN TO RUN TO THE NEAREST INTERNAL WASTE SYSTEM (BY OTHERS).

THE DESIGN ASSUMES THAT THE CEILING WOODS ARE SUFFICIENT TO ACCOMMODATE THE DUCTING.



KINETIC COOKER HOOD UNIT



ACM 150 FAN UNIT



204x80 EXTRACT DUCT



204x80 SUPPLY DUCT



204x80 INSULATED EXHAUST DUCT



204x80 INSULATED INTAKE DUCT



125mm INSULATED INTAKE DUCT



204x100 ATTENUATOR WITH 204x80 CONNECTORS



204x80 PLENUM ELBOW WITH 125mm SPIGOT



125mm EXTRACT DIFFUSER WITHIN 204x80 PLENUM ELBOW



125mm SUPPLY DIFFUSER WITHIN 204x80 PLENUM ELBOW



204x80 FIRE COLLAR

G	17.01.19	WE	Plot 8 & 9 Changed
F	20.08.18	DGT	Plot 1-6 IAQ Filters added. Commissioning Tables amended
D	31.01.18	DGT	Terminations revised to back of apartments
C	05.10.17	DGT	Terminations revised
B	07.10.16	LC	Revised as per email, new floor plans.
A	19.08.15	AD	Revised as per meeting with Vent-Axia Weds 5th Aug'
Rev	Date	By	Description

Vent-Axia
New Build Residential

Fleming Way, Crawley West
Sussex
Tel: +44(0)1293 441520
Fax: +44(0)1293 539209

Project
Milton Road
Drawing
Apartment 02

Date	Scale	Design
07.10.16	1:50 @A3	LC
Drawing No.		Rev
CAS_4824 _02		G

20220399

RECEIVED

12 MAY 2016

SCANNED

