
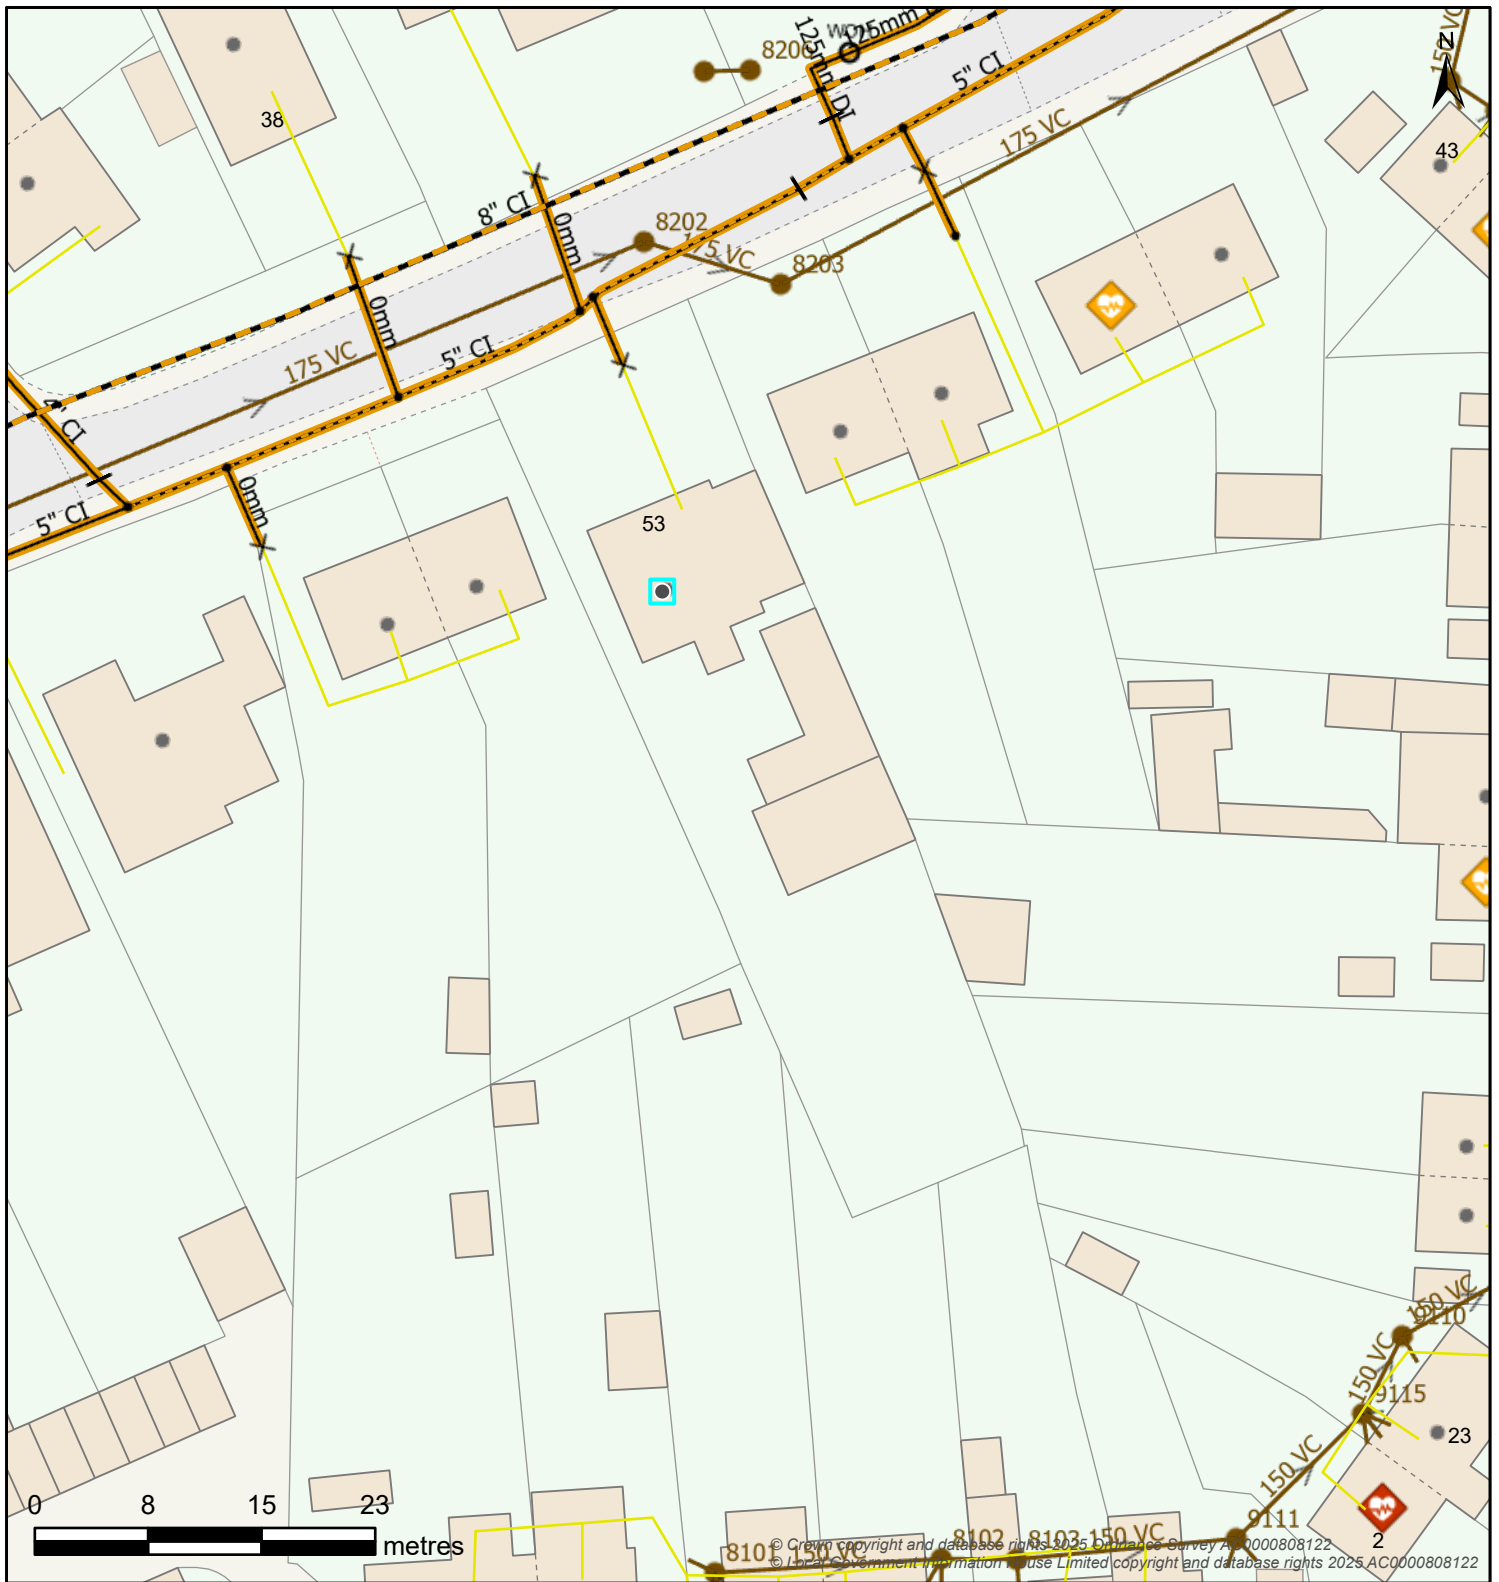







Boundary Box	Break Pressure Tank	Capped End	Hydrant			
 Boundary Box	 Break Pressure Tank	 Capped End	 Emptying Plug	 Fire Hydrant	 Washout Hydrant	
Pressure Monitoring	Service Reservoir		Meter	Valve - Controllable		
 Logger	 Covered	 Tower	 Meter	 Open Valve	 Closed Valve	 Stop Tap
Site			Valve - Flow			
 Abstraction Point	 Supply Works	 Air Valve	 Non-Return Valve	 Washout Empty Valve		
 Booster Station	 Transfer Station	Valve - Pressure			Pipe Bridge	
 Surface Reservoir	 Underground Source	 Pressure Reducing Valve	 Pressure Sustaining Valve	 Pipe Bridge		
Water Pipe			Water Area			
 Communication	 Trunk	 Decommissioned	 Water Supply Zone	 District Meter Area		
 Distribution	 Raw	 Discolouration				
 Non-Potable	 Private					

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 22/04/2025

Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

