

44-46 the Grove, Gravesend Kent

Noise Impact Assessment Report
Report 26800.NIA.02

Substantia Group Ltd.

Report 26800.NIA.02					
Revision History					
First Issue Date: 04/10/2024					
A			D		
B			E		
C			F		
Written by:		Checked by:		Approved by:	
Aidan Tolkien MIOA Associate Director		Daniel Stuart MIOA Senior Consultant		Steven Leslie MIOA Consultancy Manager	
Disclaimer KP Acoustics Ltd. has used reasonable skill and care to complete this technical document, within the terms of its brief and contract with the resources devoted to it by agreement with the client. We disclaim any responsibility to the client and others in respect of any matters outside the stated scope. This report is confidential to the client and we accept no responsibility to third parties to whom this report, or any part thereof, is made known. KP Acoustics Ltd. accepts no responsibility for data provided by other bodies and no legal liability arising from the use by other persons of data or opinions contained in this report. KP Acoustics Ltd. 2024					

Contents

1.0	INTRODUCTION.....	1
2.0	SITE SURVEYS	1
2.1	Site Description	1
2.2	Internal Noise Survey Procedure	1
2.3	Environmental Noise Survey Procedure	2
2.4	Measurement Positions	2
2.5	Equipment.....	3
3.0	RESULTS.....	4
3.1	Internal Noise Survey	4
3.2	External Noise Surveys.....	5
4.0	NOISE ASSESSMENT GUIDANCE.....	5
4.1	Permitted Development Rights.....	5
4.2	BS8233:2014	6
5.0	DISCUSSION.....	6
6.0	GLAZED EXTERNAL BUILDING FABRIC SPECIFICATION	6
7.0	CONCLUSION.....	8

List of Attachments

26800.TH3	Internal Noise Time History
26800.TH1-2	External Environmental Noise Time Histories
Appendix A	Glossary of Acoustics Terminology

1.0 INTRODUCTION

KP Acoustics Ltd has been commissioned by Substantia Group Ltd. to assess the suitability of the site at 44-46 The Grove, Gravesend, Kent DA12 1DF for a residential development in accordance with Permitted Development rights as outlined in Class MA (offices to dwelling/houses) of The Town and Country Planning (General Permitted Development) (England) Order 2021.

This report presents the results of an internal noise survey undertaken in order to measure the current internal noise climate for compliance with current guidance, and presents the results of the external environmental surveys undertaken in order to measure the prevailing background noise levels.

2.0 SITE SURVEYS

2.1 Site Description

The site is bounded by residential properties and Edwin Street to the north and west, a dental clinic to the south, and the Grove to the east. Entrance to the site is located via Edwin Street. At the time of the survey, the background noise climate was dominated by road traffic noise from the surrounding roads.

A visual inspection was undertaken on site and on Google Street View to locate any nearby commercial premises. There is an adult learning centre opposite the development site on the east facade overlooking the Grove, and a dental clinic to the south of the site.

2.2 Internal Noise Survey Procedure

A noise survey was undertaken within the ground floor internal area of the building in order to assess worst-case levels with the current external building fabric configuration.

Continuous automated monitoring was undertaken for the duration of the survey between 14:00 on 13/10/2024 and 11:30 on 18/10/2024.

A microphone was installed internally and was positioned within the diffuse field of the room, ensuring the microphone was at least 1.5m from any reflective surface. The Noise measurement position is detailed in Table 2.1 and shown in Figure 2.1.

2.3 Environmental Noise Survey Procedure

External noise surveys were undertaken on the proposed site as shown in Figure 2.1. The location was chosen in order to collect data representative of the worst-case levels expected on the site due to all nearby sources, including those from nearby commercial premises.

Continuous automated monitoring was undertaken for the duration of the survey between 14:00 on 13/10/2024 and 11:30 on 18/10/2024.

Weather conditions were generally dry with light winds and therefore suitable for the measurement of environmental noise. The measurement procedure complied with ISO 1996-2:2017 Acoustics '*Description, measurement and assessment of environmental noise - Part 2: Determination of environmental noise levels*'.

2.4 Measurement Positions

Measurement positions are as described within Table 2.1 and shown within Figure 2.1.

Icon	Descriptor	Location Description
①	Noise Measurement Position 1	The microphone was installed on a boom extended from a window on the first floor of the building overlooking the Grove. The microphone was located within 1.5 metres of the nearest surface and therefore includes local reflections.
②	Noise Measurement Position 2	The microphone was installed on a tripod on a ground floor roof terrace on the west elevation of the building. The microphone was located within 1.5 metres of the nearest surface and therefore includes local reflections.
Ⓐ	Internal Noise Measurement Position A	The microphone was located on the ground floor of the building within a room overlooking the Grove. The microphone was installed on a tripod at a distance of 1.5m from the window on the external façade and positioned at 1.5m above ground floor

Table 2.1 Measurement positions and descriptions

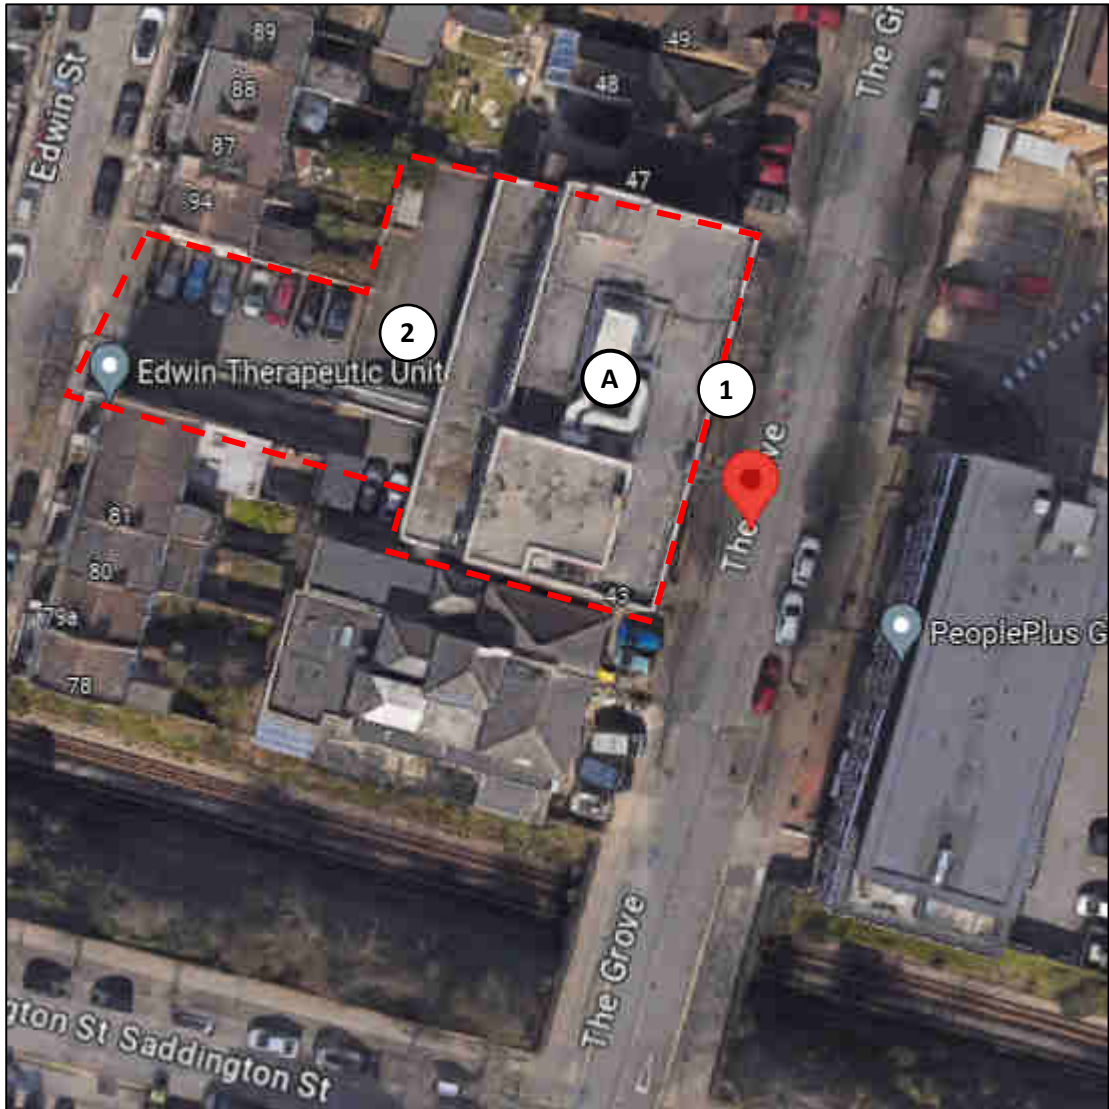


Figure 2.1 Site measurement positions (Image Source: Google Maps)

2.5 Equipment

The equipment calibration was verified before and after use and no abnormalities were observed. The equipment used is described within Table 2.2.

Measurement instrumentation		Serial no.	Date	Cert no.
Noise Kit 25	NTI Audio XL2 Class 1 Sound Level Meter	A2A-21141-E0	22/07/2024	TCRT24/1567
	Free-field microphone NTI Acoustics MC230A	A23583		
	Preamp NTI Acoustics MA220	10992		
	NTI Audio External Weatherproof Shroud	-	-	-
Noise Kit 26	NTI Audio XL2 Class 1 Sound Level Meter	A2A-21130-E0	23/07/2024	TCRT24/1572
	Free-field microphone NTI Acoustics MC230A	A25902		
	Preamp NTI Acoustics MA220	5522		
	NTI Audio External Weatherproof Shroud	-	-	-
Noise Kit 27	NTI Audio XL2 Class 1 Sound Level Meter	A2A-21174-E0	23/07/2024	TCRT24/1570
	Free-field microphone NTI Acoustics MC230A	A23366		
	Preamp NTI Acoustics MA220	11034		
	NTI Audio External Weatherproof Shroud	-	-	-
B&K Type 4231 Class 1 Calibrator		2147411	14/06/2024	UKAS24/06438

Table 2.2 Measurement instrumentation

3.0 RESULTS

3.1 Internal Noise Survey

The $L_{Aeq: 5min}$ and $L_{Amax: 5min}$ acoustic parameters were measured throughout the duration of the internal noise survey. Measured levels are shown as time histories in Figures 26800.TH3 for internal monitoring position 1.

Measured noise levels are representative of noise exposure levels expected to be experienced in all spaces on all façades of the development, and are shown in Table 3.1.

Time Period	Internal Noise Measurement Position 1 (Measured Noise level – dBA)
Daytime $L_{Aeq,16hour}$	25
Night-time $L_{Aeq,8hour}$	23

Table 3.1 Current internal average noise levels for daytime and night time

3.2 External Noise Surveys

The $L_{Aeq: 5min}$, $L_{Amax: 5min}$, $L_{A10: 5min}$ and $L_{A90: 5min}$ acoustic parameters were measured throughout the duration of the survey. Measured levels are shown as time histories in Figures 26800.TH1-2.

Measured noise levels are representative of noise exposure levels expected to be experienced by the all façades of the proposed development, and are shown in Table 3.1.

Time Period	External Noise Measurement Position 1 (Measured Noise level – dBA)	External Noise Measurement Position 2 (Derived Noise level – dBA)
Daytime $L_{Aeq,16hour}$	55	50
Night-time $L_{Aeq,8hour}$	51	46

Table 3.2 Site average noise levels for daytime and night time

4.0 NOISE ASSESSMENT GUIDANCE

4.1 Permitted Development Rights

It is understood that the office development would be converted into residential units under the Permitted Development Rights. Therefore, this assessment would be targeted to demonstrate the noise requirement as per Citation “*Amendments in relation to change of use of offices to dwelling houses*” of The Town and Country Planning (General Permitted Development) (England) (Amendment) Order 2021:

“(2) Before beginning development under Class MA, the developer must apply to the local planning authority for a determination as to whether the prior approval of the authority will be required as to –

(a) transport impacts of the development, particularly to ensure safe site access;

(b) contamination risks in relation to the building;

(c) flooding risks in relation to the building;

(d) impacts of noise from commercial premises on the intended occupiers of the development;”

The measurements undertaken on site would not only encompass noise generated by any nearby commercial units, but it would also encompass the full spectrum of noise sources in the area affecting the premises.

In order to demonstrate if the current external building fabric of the site would be sufficient to protect the future residents, the measured internal noise levels would be assessed against the recommendations of the British Standard BS8233:2014 *“Sound insulation and noise reduction for buildings”*.

4.2 BS8233:2014

BS8233:2014 *‘Sound insulation and noise reduction for buildings’* describes recommended internal noise levels for residential spaces. These levels are shown in Table 4.1.

Activity	Location	07:00 to 23:00	23:00 to 07:00
Resting	Living Rooms	35 dB(A)	-
Dining	Dining Room/area	40 dB(A)	-
Sleeping (daytime resting)	Bedrooms	35 dB(A)	30 dB(A)

Table 4.1 BS8233 recommended internal background noise levels

5.0 DISCUSSION

As shown in Table 3.1, internally measured noise levels would be commensurate with the design criteria of BS8233:2014.

If the surrounding area were to remain unchanged, the existing external building fabric would be sufficient in controlling noise break-in from commercial sources and would provide a suitable residential environment.

It should be noted that the existing glazed elements of the building are single glazed, which may not be suitable for use in a residential development, for non-acoustic reasons.

If modern, double-glazed units or secondary glazing are required throughout the development, the glazing system should be upgraded as outlined within Section 6.0.

6.0 GLAZED EXTERNAL BUILDING FABRIC SPECIFICATION – IF REQUIRED

It should be noted that the existing glazing is suitable from an acoustic perspective. Should modifications to the glazing be required for non-acoustic reasons, the following advice should be followed.

To provide appropriate specifications, sound reduction performance calculations have been undertaken in order to specify the required performance from glazed elements in order to

achieve the recommended internal noise levels shown in Table 4.1, taking into account average and maximum noise levels monitored during the environmental noise survey as well as the non-glazed external building fabric construction.

6.1 New Primary Glazing System

Should the existing glazing be removed and a new primary glazing system be installed, the new system should comply with the acoustic specification given below.

Minimum octave band sound reduction index (SRI) values required for all glazed elements to be installed are shown in Table 6.1. The performance is specified for the whole window unit, including the frame, seals, etc. as appropriate. Sole glass performance data would not demonstrate compliance with this specification.

Elevation	Octave band centre frequency SRI, dB						$R_w(C;C_{tr})$, dB
	125Hz	250Hz	500Hz	1kHz	2kHz	4kHz	
All Elevations	24	20	25	34	37	35	31 (-2;-4)

Table 6.1 Required glazing performance

All major building elements should be tested in accordance with the BS EN ISO 10140 series of standards.

Independent testing at a UKAS accredited laboratory will be required in order to confirm the performance of the chosen system for an 'actual' configuration.

6.2 Secondary Glazing System

If changes to the external building fabric cannot be made under permitted development rights, the existing windows would need to be upgraded internally to meet the recommended internal noise levels stipulated in BS8233:2014 and meet the minimum octave band sound reduction values outlined in Table 6.1.

If this is the case, we would recommend that a secondary glazing system is installed, such as those provided by SelectaGlaze, who provide several systems which would achieve the project requirements:

- S20 Vertical Sliding System, comprised of 50mm cavity from the existing window system, with 4-6.4mm standard glass (Provides 39dB R_w with primary window)
- or
- HS10 Horizontal Sliding System, comprised of 50mm cavity from the existing window system, 4-6.4mm standard glass (Provides 39dB R_w with primary window)

7.0 CONCLUSION

An Internal noise survey and environmental noise surveys have been undertaken at 44-46 The Grove, Gravesend, Kent DA12 1DF allowing the assessment of daytime and night-time levels likely to be experienced by the proposed development.

Noise levels measured internally demonstrate that the existing external building fabric would be sufficient in providing a suitable residential environment, and existing noise levels meet the design criteria of BS8233:2014, with consideration of the surrounding commercial noise sources.

No further mitigation measures should be required in order to protect the proposed habitable spaces from external noise intrusion. However, acoustic specifications have been given for new or additional glazing should it be required for non-acoustic purposes.

44-46 the Grove, Gravesend, Kent - Position 3 - Internal
Environmental Time History
13/09/2024 to 18/09/2024

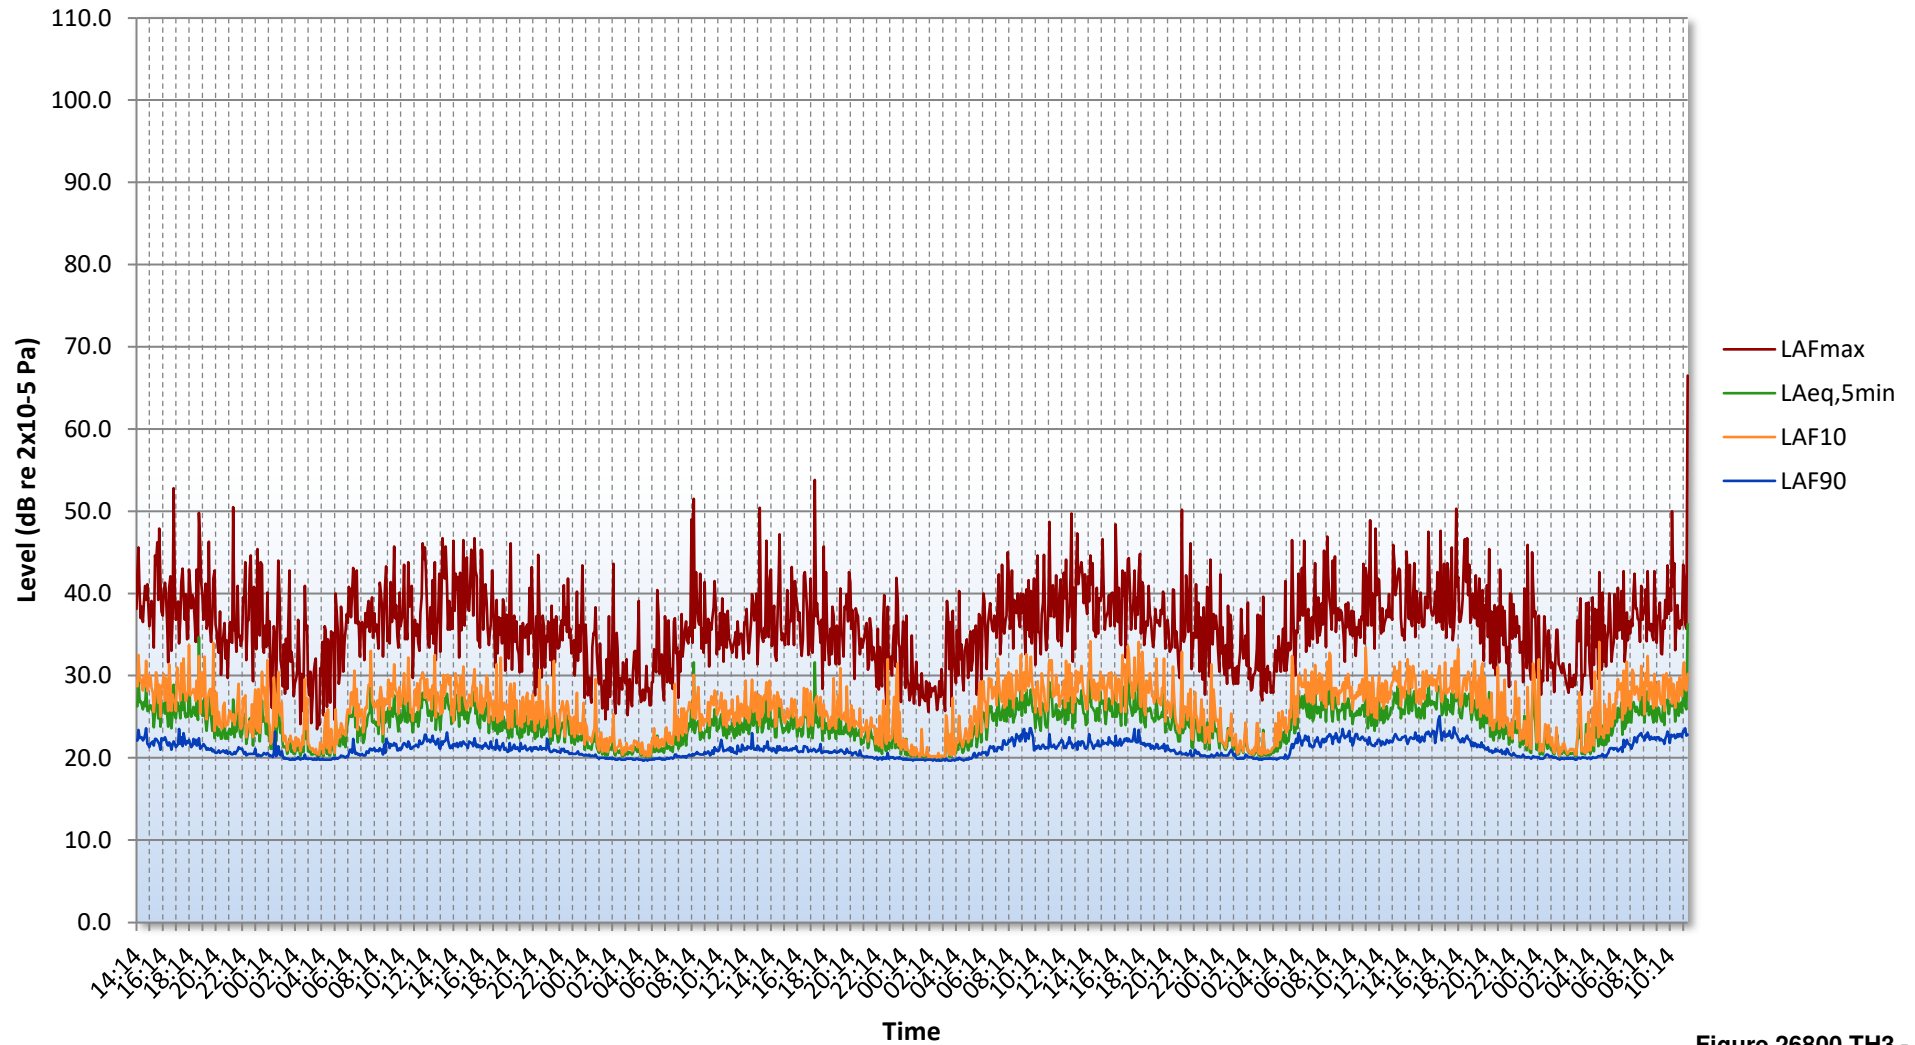


Figure 26800.TH3 -
Internal

44-46, the Grove, Gravesend, Kent - Position 1
Environmental Time History
13/09/2024 to 18/09/2024

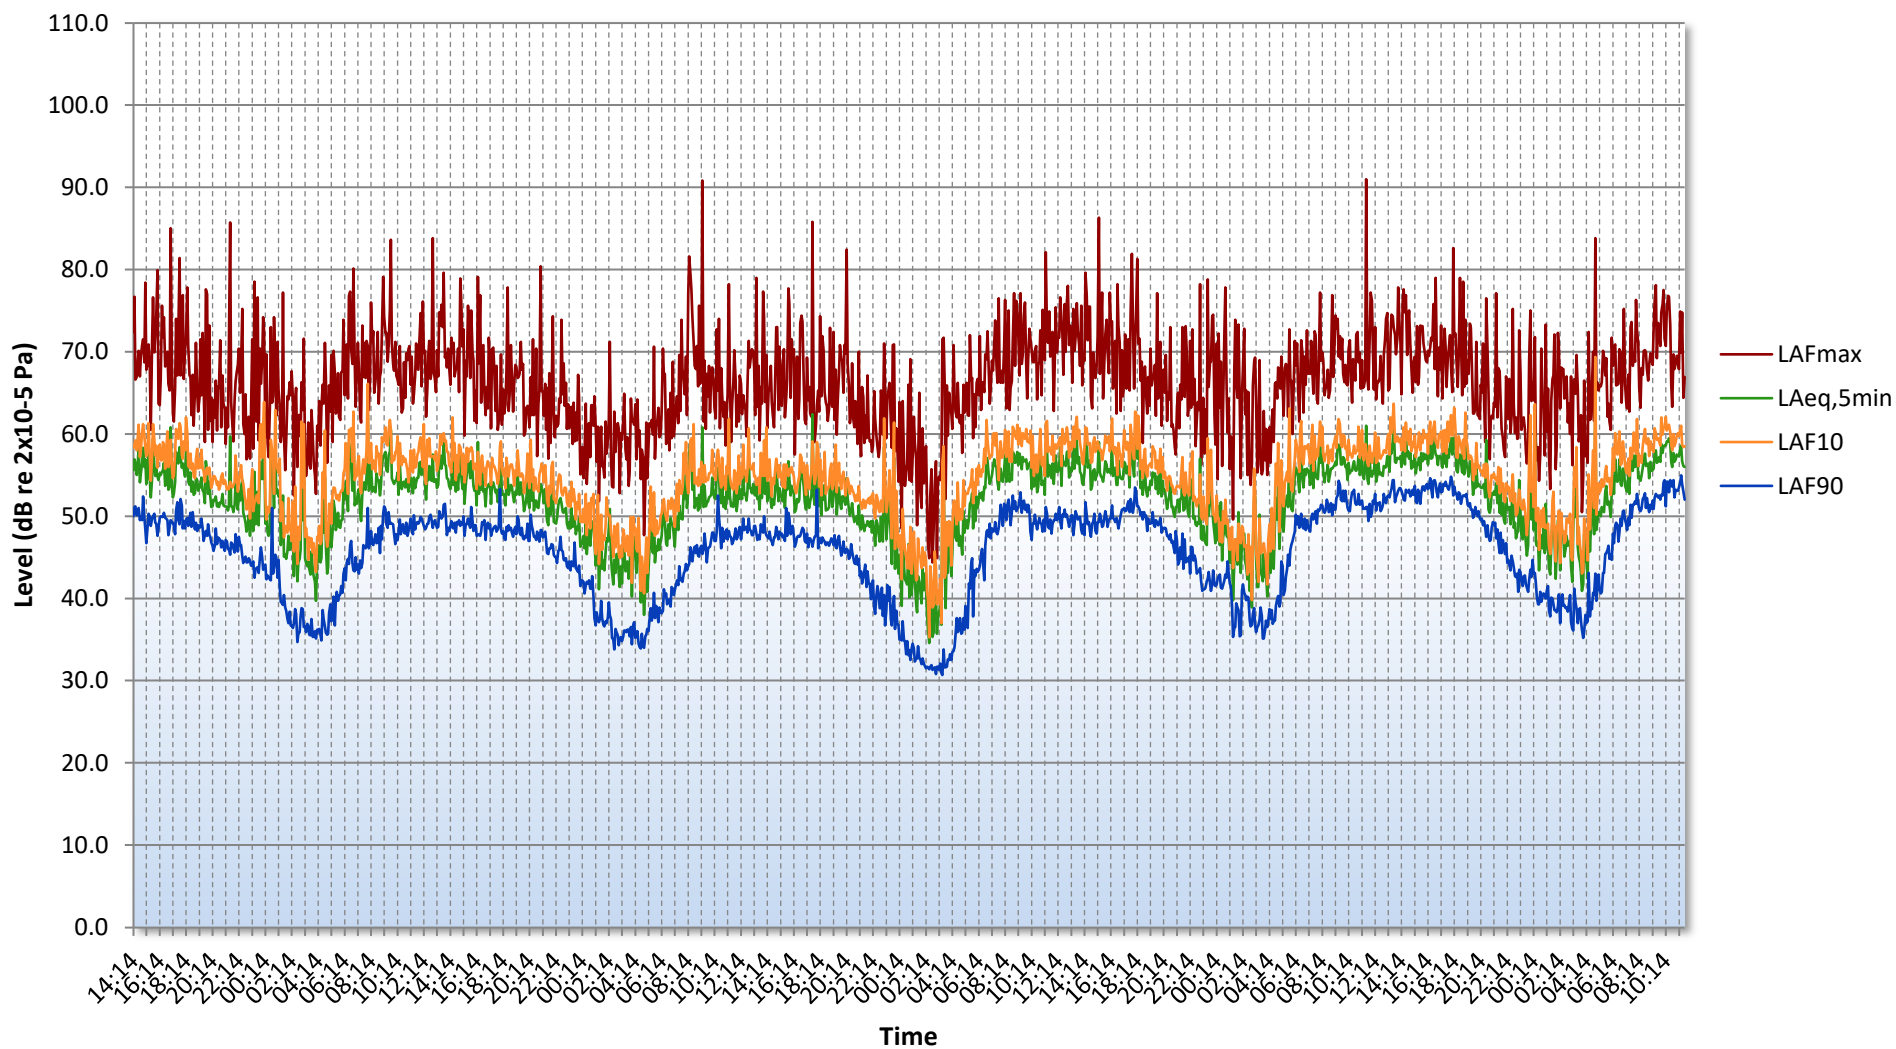


Figure 26800.TH1

44-46 the Grove, Gravesend, Kent - Position 2
Environmental Time History
13/09/2024 to 18/09/2024

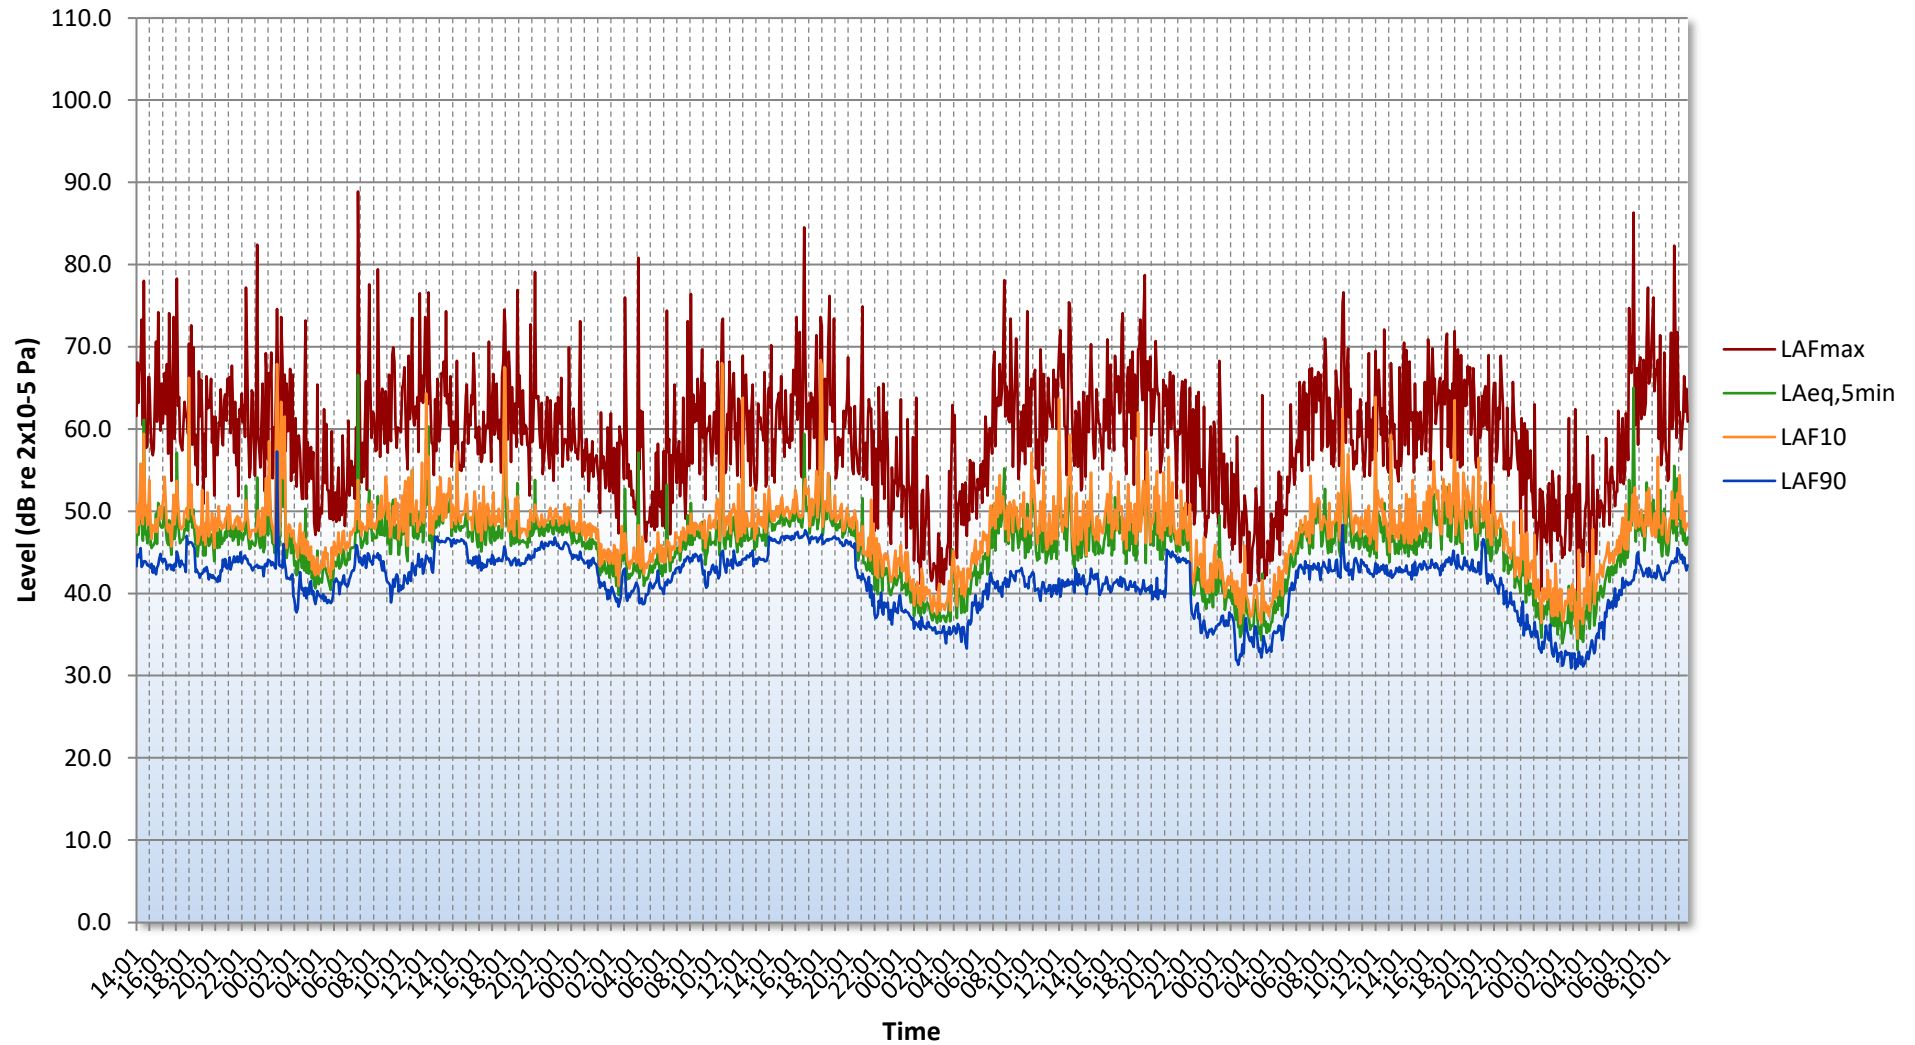


Figure 26800.TH2

GENERAL ACOUSTIC TERMINOLOGY

Decibel scale - dB

In practice, when sound intensity or sound pressure is measured, a logarithmic scale is used in which the unit is the 'decibel', dB. This is derived from the human auditory system, where the dynamic range of human hearing is so large, in the order of 10^{13} units, that only a logarithmic scale is the sensible solution for displaying such a range.

Decibel scale, 'A' weighted - dB(A)

The human ear is less sensitive at frequency extremes, below 125Hz and above 16Khz. A sound level meter models the ears variable sensitivity to sound at different frequencies. This is achieved by building a filter into the Sound Level Meter with a similar frequency response to that of the ear, an A-weighted filter where the unit is dB(A).

L_{eq}

The sound from noise sources often fluctuates widely during a given period of time. An average value can be measured, the equivalent sound pressure level L_{eq} . The L_{eq} is the equivalent sound level which would deliver the same sound energy as the actual fluctuating sound measured in the same time period.

L_{10}

This is the level exceeded for no more than 10% of the time. This parameter is often used as a "not to exceed" criterion for noise.

L_{90}

This is the level exceeded for no more than 90% of the time. This parameter is often used as a descriptor of "background noise" for environmental impact studies.

L_{max}

This is the maximum sound pressure level that has been measured over a period.

Octave Bands

In order to completely determine the composition of a sound it is necessary to determine the sound level at each frequency individually. Usually, values are stated in octave bands. The audible frequency region is divided into 11 such octave bands whose centre frequencies are defined in accordance with international standards. These centre frequencies are: 16, 31.5, 63, 125, 250, 500, 1000, 2000, 4000, 8000 and 16000 Hertz.

Environmental noise terms are defined in BS7445, *Description and Measurement of Environmental Noise*.

APPLIED ACOUSTIC TERMINOLOGY

Addition of noise from several sources

Noise from different sound sources combines to produce a sound level higher than that from any individual source. Two equally intense sound sources operating together produce a sound level which is 3dB higher than a single source and 4 sources produce a 6dB higher sound level.

Attenuation by distance

Sound which propagates from a point source in free air attenuates by 6dB for each doubling of distance from the noise source. Sound energy from line sources (e.g. stream of cars) drops off by 3dB for each doubling of distance.

Subjective impression of noise

Hearing perception is highly individualised. Sensitivity to noise also depends on frequency content, time of occurrence, duration of sound and psychological factors such as emotion and expectations. The following table is a guide to explain increases or decreases in sound levels for many scenarios.

Change in sound level (dB)	Change in perceived loudness
1	Imperceptible
3	Just barely perceptible
6	Clearly noticeable
10	About twice as loud

Transmission path(s)

The transmission path is the path the sound takes from the source to the receiver. Where multiple paths exist in parallel, the reduction in each path should be calculated and summed at the receiving point. Outdoor barriers can block transmission paths, for example traffic noise. The effectiveness of barriers is dependent on factors such as its distance from the noise source and the receiver, its height and construction.

Ground-borne vibration

In addition to airborne noise levels caused by transportation, construction, and industrial sources there is also the generation of ground-borne vibration to consider. This can lead to structure-borne noise, perceptible vibration, or in rare cases, building damage.

Sound insulation - Absorption within porous materials

Upon encountering a porous material, sound energy is absorbed. Porous materials which are intended to absorb sound are known as absorbents, and usually absorb 50 to 90% of the energy and are frequency dependent. Some are designed to absorb low frequencies, some for high frequencies and more exotic designs being able to absorb very wide ranges of frequencies. The energy is converted into both mechanical movement and heat within the material; both the stiffness and mass of panels affect the sound insulation performance.