

RSPB Higham Marshes Habitat Enhancement Project



Water Vole (Rob Budgen, 2016)

Services and Line Search
Planning Application Proposal Supporting Documentation
Author: Will Tofts



Our Ref: 25407026 Higham Marshes

Friday, 22 April 2022

William Tofts
RSPB Northward Hill Bromhey Farm, Cooling,
Rochester
Kent
ME3 8DS

National Gas Emergency Number:
0800 111 999*

Gas Emergency Number:
0800 40 40 90*

*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgrid.com

Asset Protection
Gas Transmission
National Grid
Warwick
CV34 6DA
Email: assetprotection@nationalgrid.com

National Grid Gas – No Assets Affected Letter

Dear Sir/ Madam,


An assessment has been carried out with respect to National Grid Gas Transmission plc's apparatus and the proposed work location. Based on the location entered into the system for assessment the area has been found to not affect any of National Grid Gas Transmission plc's apparatus.

If you have any questions, or suspect for any reason that the above may be incorrect, please don't hesitate to contact us at assetprotection@nationalgrid.com, or call us on 01926 654844.

Please note this response and any attached map(s) are valid for 28 days

Yours sincerely

Asset Protection Team

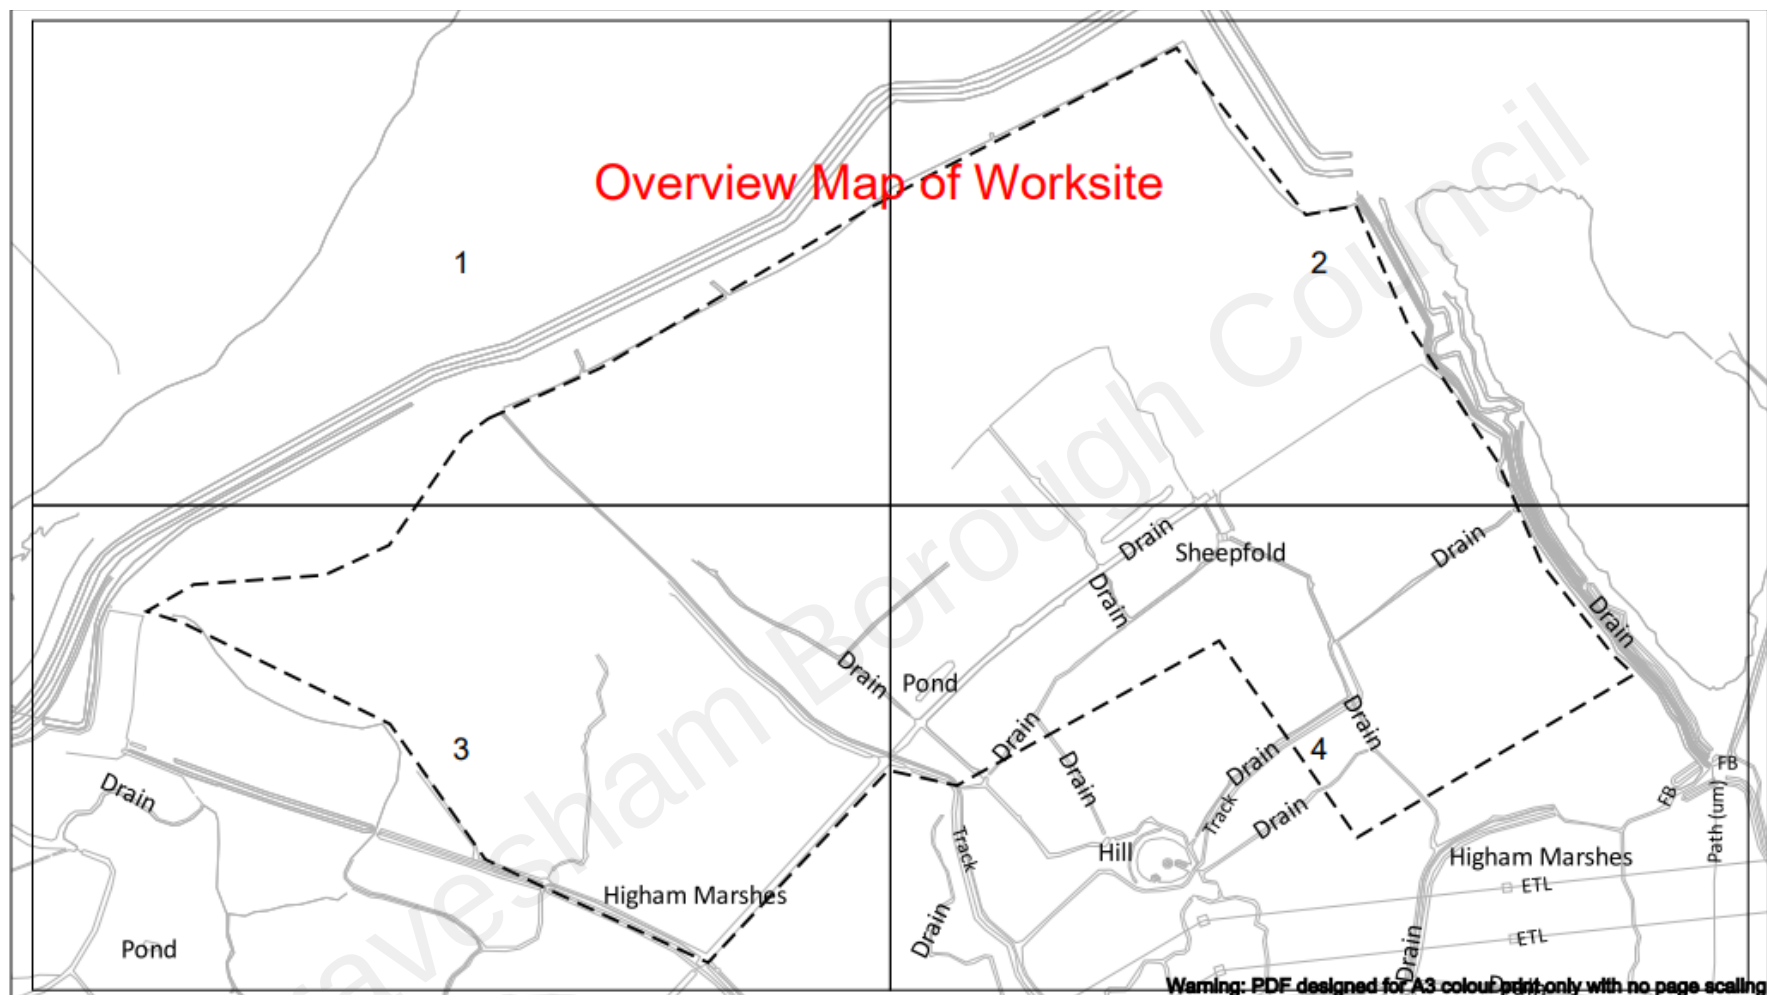

Warning: PDF designed for A3 colour print only with no page scaling

Date Requested: 22/04/2022 Job Reference: 25407026 Site Location: 570799 175090 Requested by: Mr William Tofts Your Scheme/Reference: Higham Marshes Scale: 1:5125 (When plotted at A3)	IMPORTANT NOTICES This plan shows those pipes owned by National Grid Limited in its role as a licensed Gas Transporter (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc., are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Limited or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HSG47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (whether direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	National Grid Gas Emergency Number: 0800 40 40 90 Available 24 hours, 7 days/week. Calls may be recorded and monitored Warning: PDF designed for colour print only with no page scaling Dig Sites Area: Line: NHP Mains	nationalgrid National Grid House Warwick Technology Park Gallows Hill Warwick CV34 6DA AssetProtection@NationalGrid.com
---	---	---	---



Our Ref: 25407026 Higham Marshes

Friday, 22 April 2022

William Tofts
RSPB Northward Hill Bromhey Farm, Cooling,

Kent
ME3 8DS

National Grid House
Warwick Technology Park
Gallows Hill, Warwick
CV34 6DA

Electricity Emergency Number:
0800 40 40 90*

*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgrid.com

Asset Protection
Gas Transmission
National Grid
Warwick
Email: assetprotection@nationalgrid.com

National Grid Electricity – No Assets Affected


Dear Sir/ Madam,

An assessment has been carried out with respect to National Grid Electricity Transmission plc's apparatus and the proposed work location. Based on the location entered into the system for assessment the area has been found to not affect any National Grid Electricity Transmission plc's apparatus.

Please note this response and any attached map(s) are valid for 28 days

Yours sincerely

Asset Protection Team

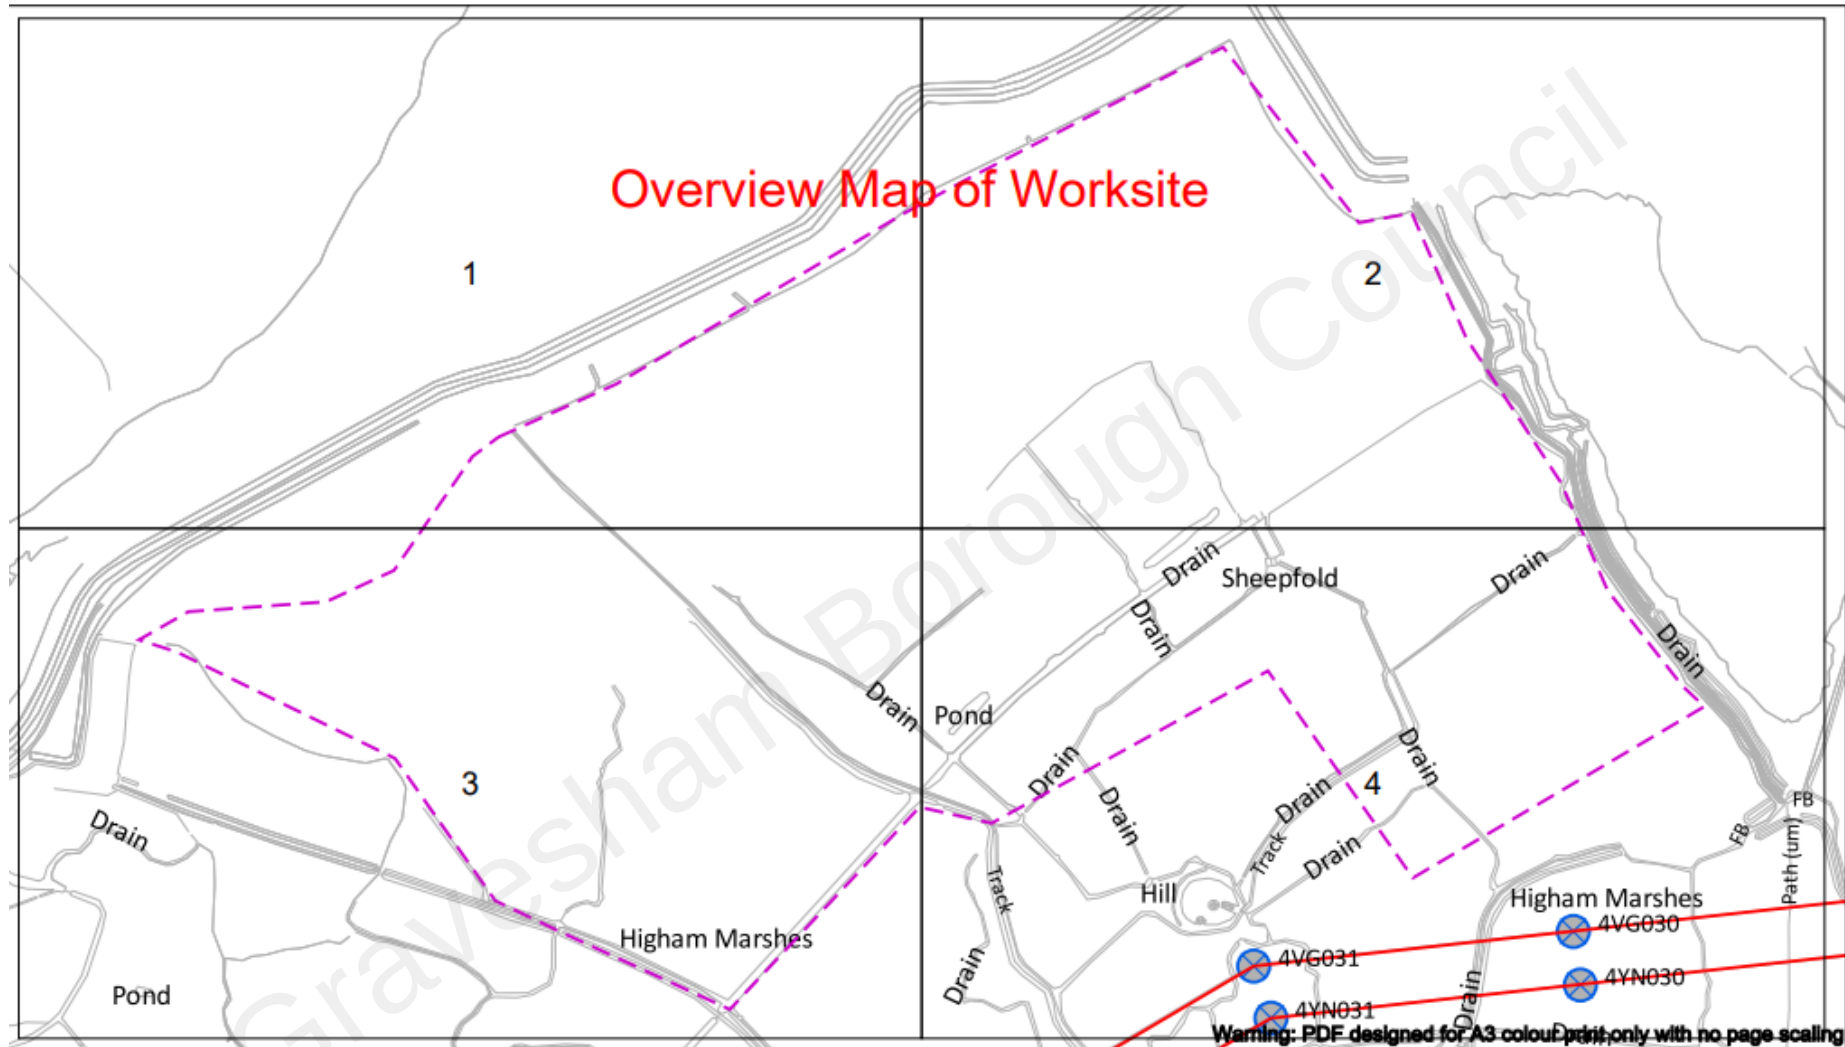

Warning: PDF designed for A3 colour print only with no page scaling

File Requested: 22/04/2022
Job Reference: 25407026
File Location: 570799 175090
Requested by:
Mr William Tolls
Our Scheme/Reference:
Higham Marshes

Scale: 1:5125 (When plotted at A3)

EXTREME CAUTION - HIGH VOLTAGE
****RISK OF DEATH OR SERIOUS INJURY****

IMPORTANT NOTICES

This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (LET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HSG47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

National Grid Electricity Emergency Number: 0800 40 40 90
Available 24 hours, 7 days/week. Calls may be recorded and monitored

Warning: PDF designed for colour print only with no page scaling

Dig Sites Area: Line:

Underground Cables

Overhead Lines

Fibre Cables

nationalgrid

NationalGrid House
Warwick Technology Park
Gallows Hill
Warwick
CV34 6DA

AssetProtection@NationalGrid.com

