




Section 1 (Scale 1/50)

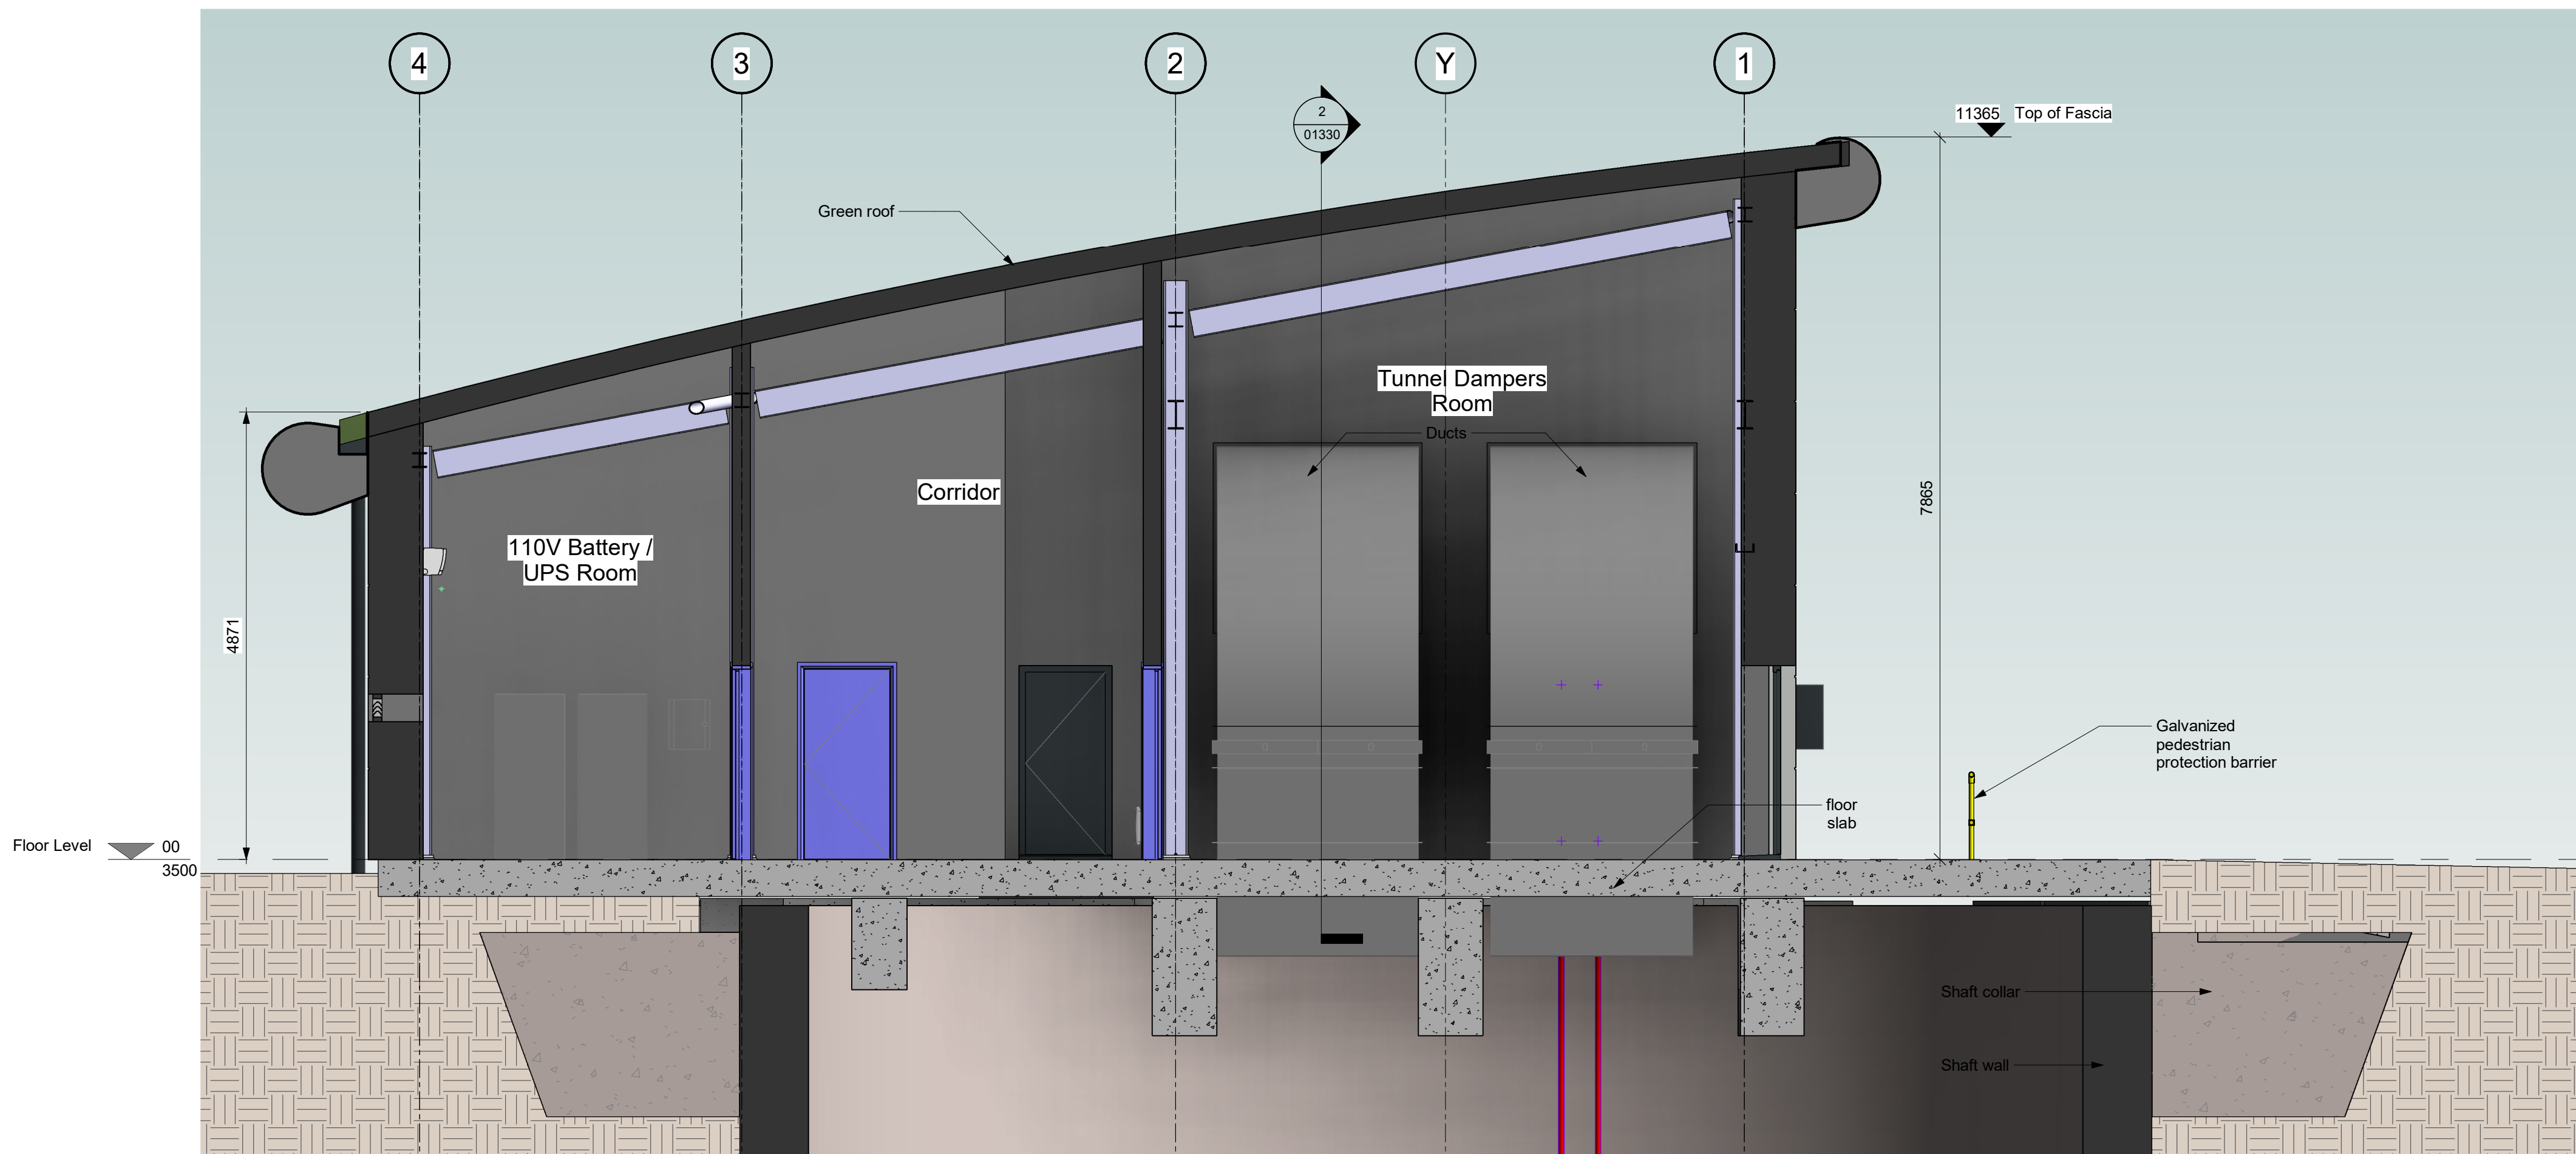

Section 2 (Scale 1/50)

NOTES

1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE STATED
2. ALL LEVELS ARE IN METERS ABOVE ORDANANCE DATUM (mAOD)
3. FOR GRAVESEND SHAFT SEE PDD-100116-LAY-123
4. SHAFT CENTRE POINT AT, East = 567427.615, North = 174094.990
5. ROAD AND FOOTPATH ALIGNMENTS SHOWN ARE INDICATIVE ONLY
6. SVP - SOIL & VENT PIPE
RWP - RAINWATER PIPE
UPS - UNINTERRUPTED POWER SUPPLY


REFERENCE DRAWINGS

PDD-100116-LAY-106 - New Gravesend 400kV Cable Sealing End Compound HV Plant Plan Drawing

PDD-100116-LAY-102 - CSE Layout with cable termination arrangement (Gravesend site) (A784/A785)

PDD-100116-LAY-208 - GRAVESEND HEADHOUSE CONCEPT PROPOSAL

PDD-100116-LAY-123 - GRAVESEND SHAFT GENERAL ARRANGEMENT



Scale 1: 50 @ A0 (1: 100 @ A3)

P03	Updated with structural and services information	RW	JK	NS	04/12/23
P02	Updated to comments received	RO	RW	JK	21/09/23
P01	Initial Issue	RO	RW	JK	07/09/23
Rev	Description	Cre'd	Chk'd	App'd	Date

nationalgrid

Master Scheme No:	Sub-Scheme No:	Site:
100116	-	NEW GRAVESEND CSEC

Scheme Name:
TKRE GRAIN-TILBURY AND KINGSNORTH-TILBURY 400kV UPRATING

Document Title:

Gravesend Headhouse - Planning - Proposed Sections

Created by:	Date:	Checked by:	Date:	Approved by:	Date:
RO	07/09/23	RW	07/09/23	JK	07/09/23
Development Eng:	Document Type:	Scale:	Format:	Sheet(s):	Rev:
BT	Drawing	1 : 50	A1	1 of 1	P03

National Grid Document Number:
PDD-100116-LAY-057

FEED Document Number:
30003364-BHK-XX-XX-DR-A-01407