




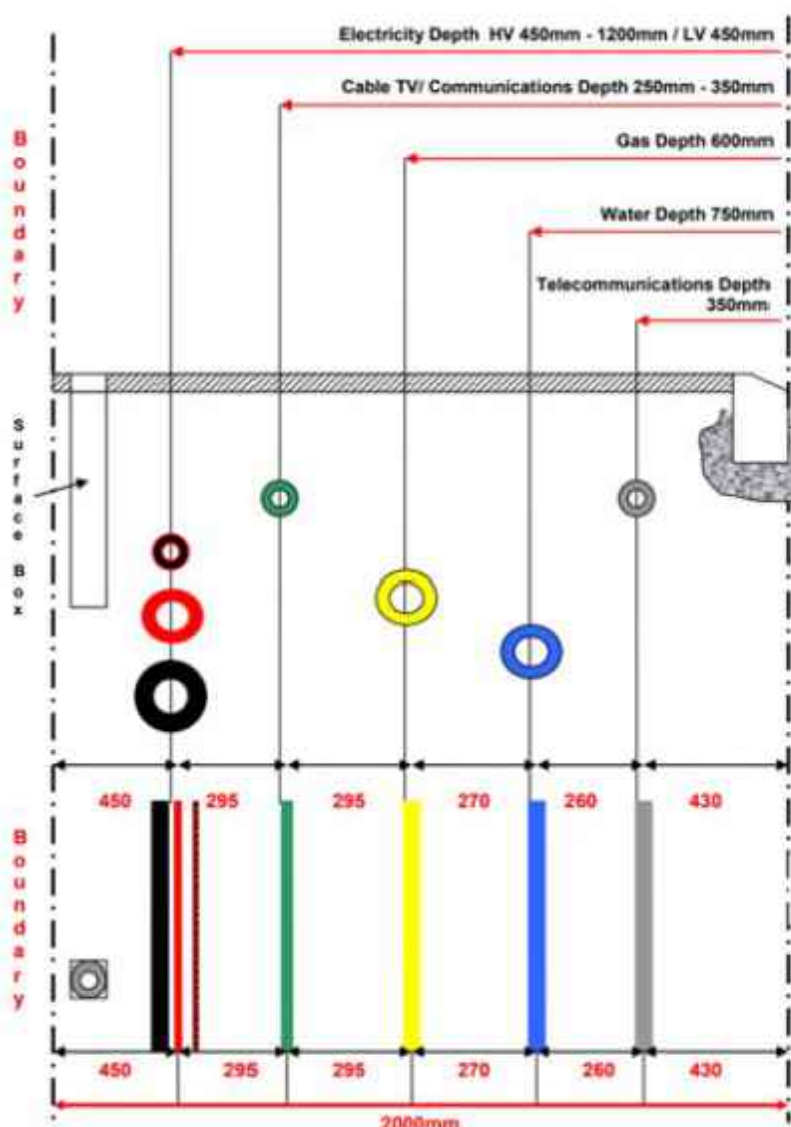

NUJG SERVICES HEIGHT DETAIL

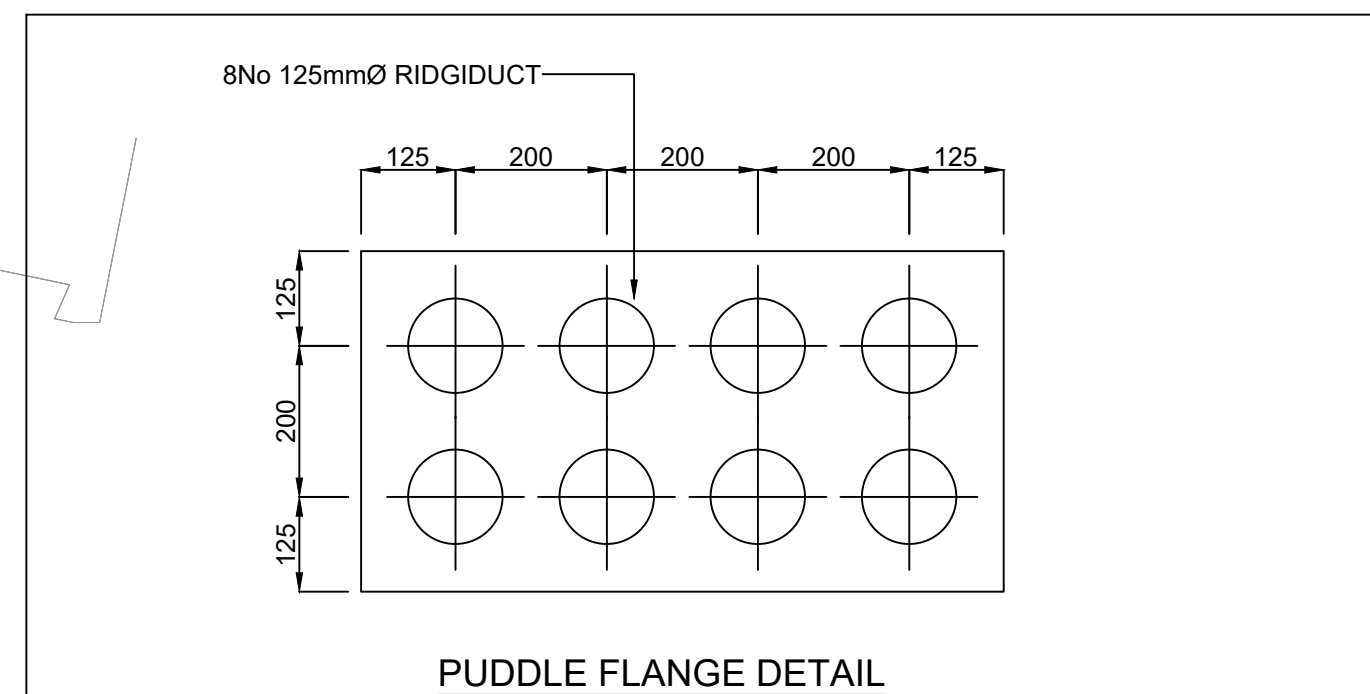

PUDDLE FLANGE DETAIL

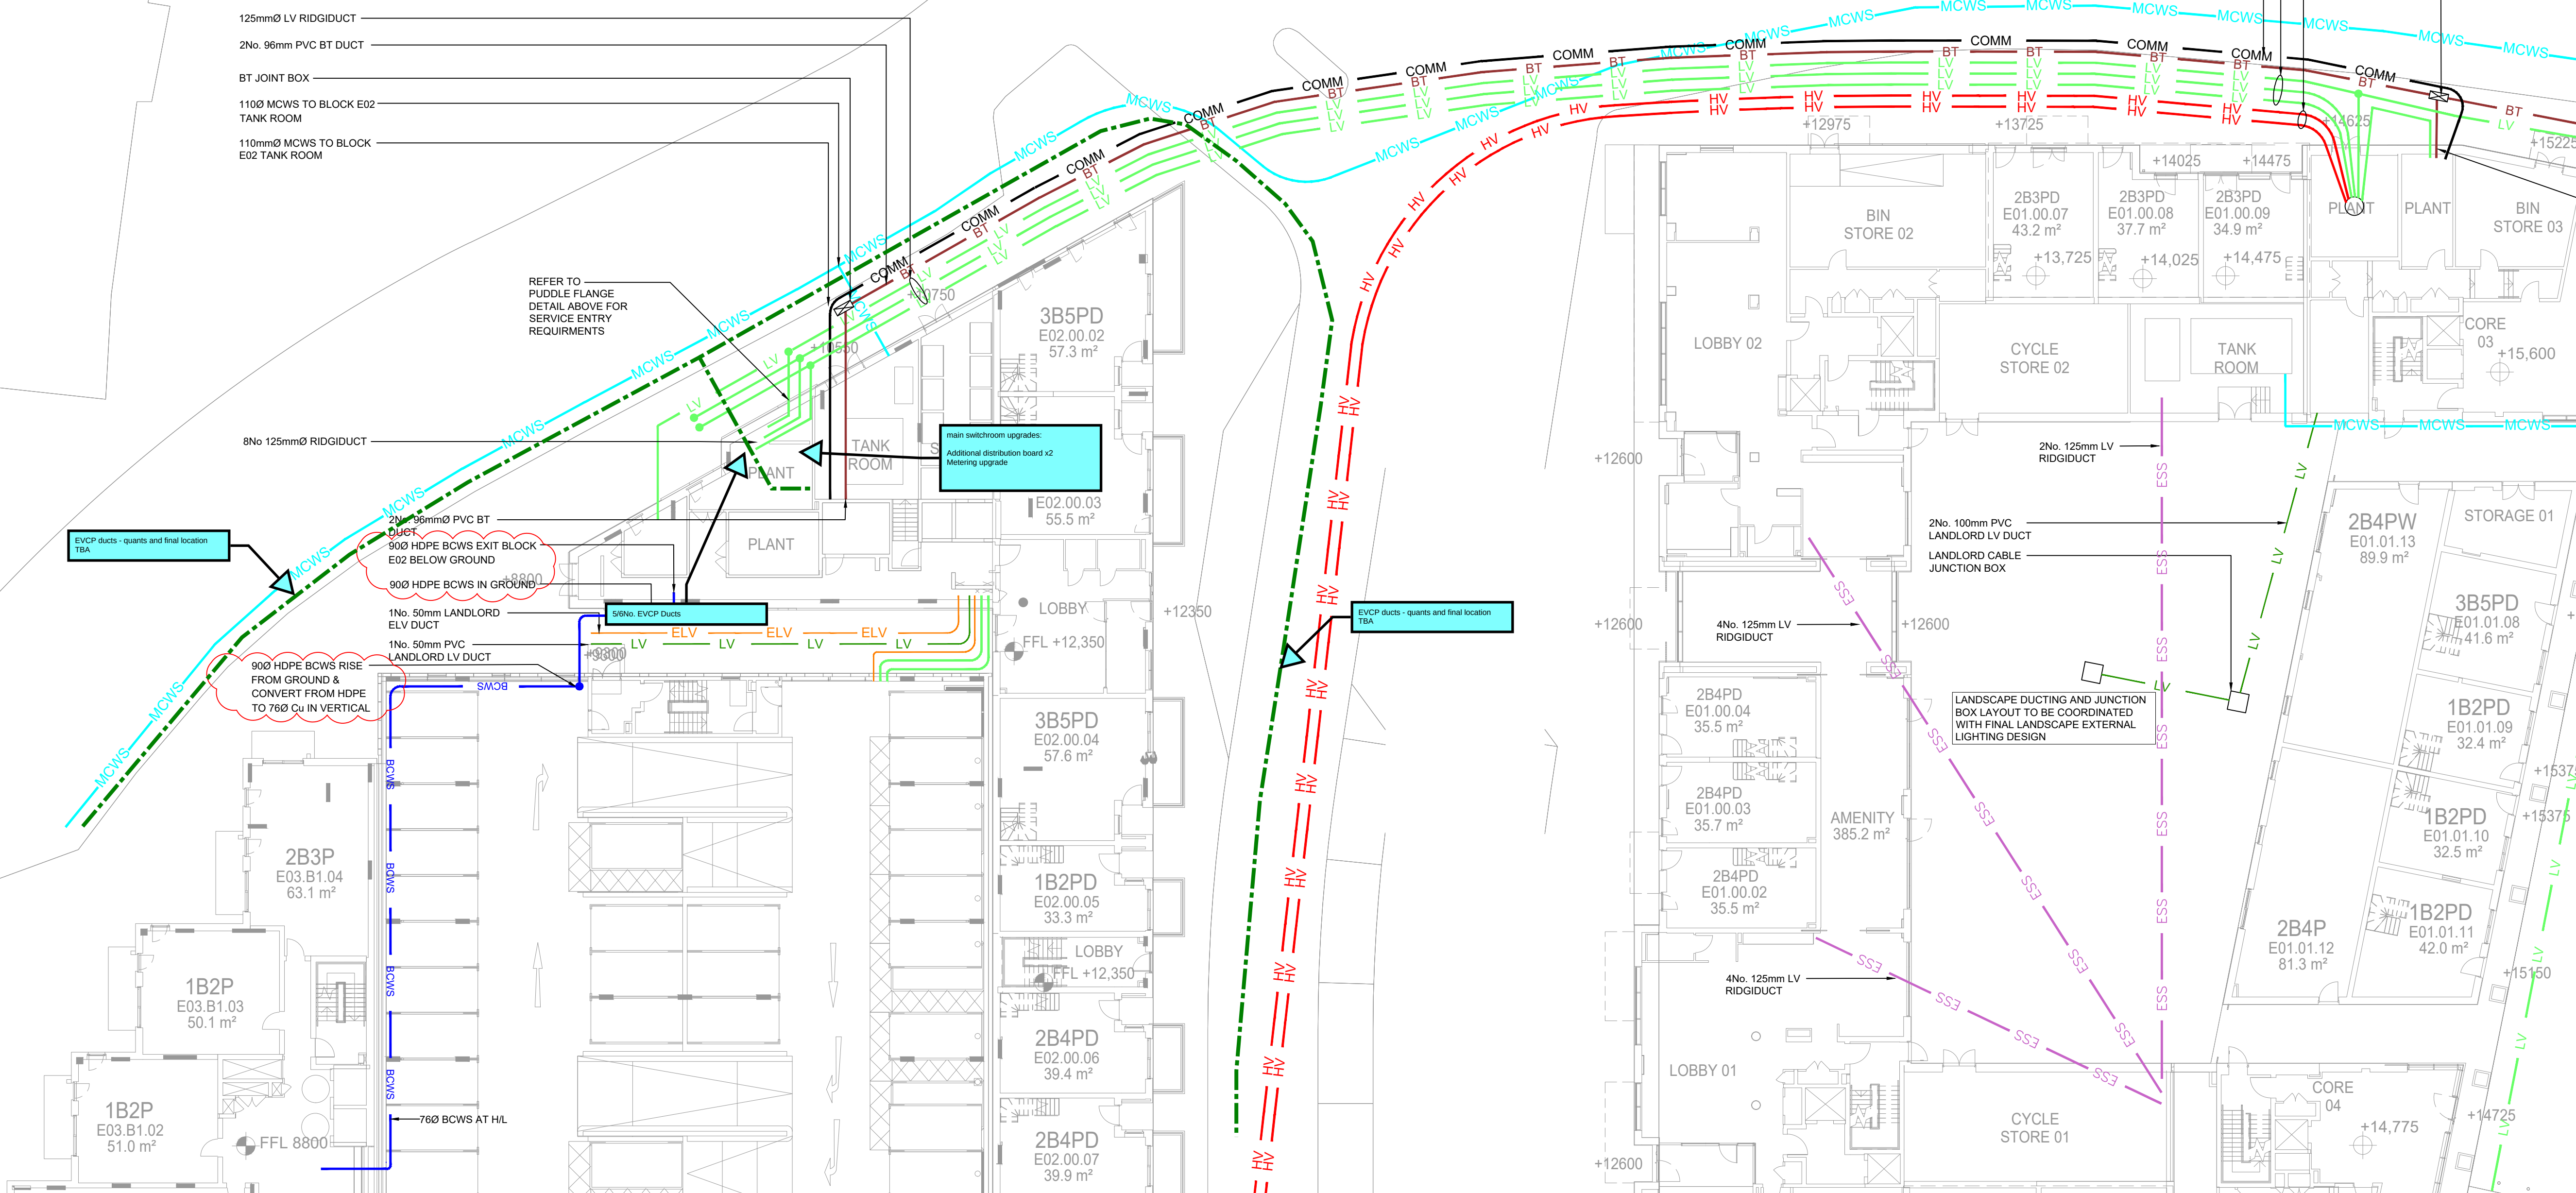

96mmØ PVC GUIDE COMMS DUCT
125mmØ LV RIDGIDUCT
HV POINT OF CONNECTION
TBC BY UTILITY PROVIDER
BT JOINT BOX

- CONTRACTOR TO CONFIRM EXACT POINT OF CONNECTION TO WATER MAINS PIPE WITH UTILITY PROVIDER AND COORDINATE APPROPRIATELY TO ROUTE SHOWN BELOW
- 110mmØ MCWS TO BLOCK E01 TANK ROOM
96mmØ PVC BT DUCT
SITE PICK UP POINT TBC BY GUIDE / BT OPENREACH
- LEGEND
- MCWS MAIN COLD WATER PIPEWORK
 - BT BOOSTED COLD WATER PIPEWORK
 - LTHWLF HEATING FLOW PIPEWORK
 - LTHWR HEATING RETURN PIPEWORK
 - DHR DISTRICT HEATING RETURN PIPEWORK
 - DHF DISTRICT HEATING FLOW PIPEWORK
 - ELV ELV PIPEWORK

