


form new 850 mm wide staircase upto loft  
ensure 50 mm minimum tread width at  
narrow end

remove existing wall form new timber stud wall with  
12.5 mm fireline plasterboard & skim either side &  
fit FD20 door & frame

Hard wired smoke detectors (with battery back up) are required and to  
be located in the hall at ground, first and second floor levels. A fire alarm  
will require an installation & commissioning certificate & the building occupier  
should be provided with information on the use of the equipment and on the  
maintenance. This should include manufacturers instructions.

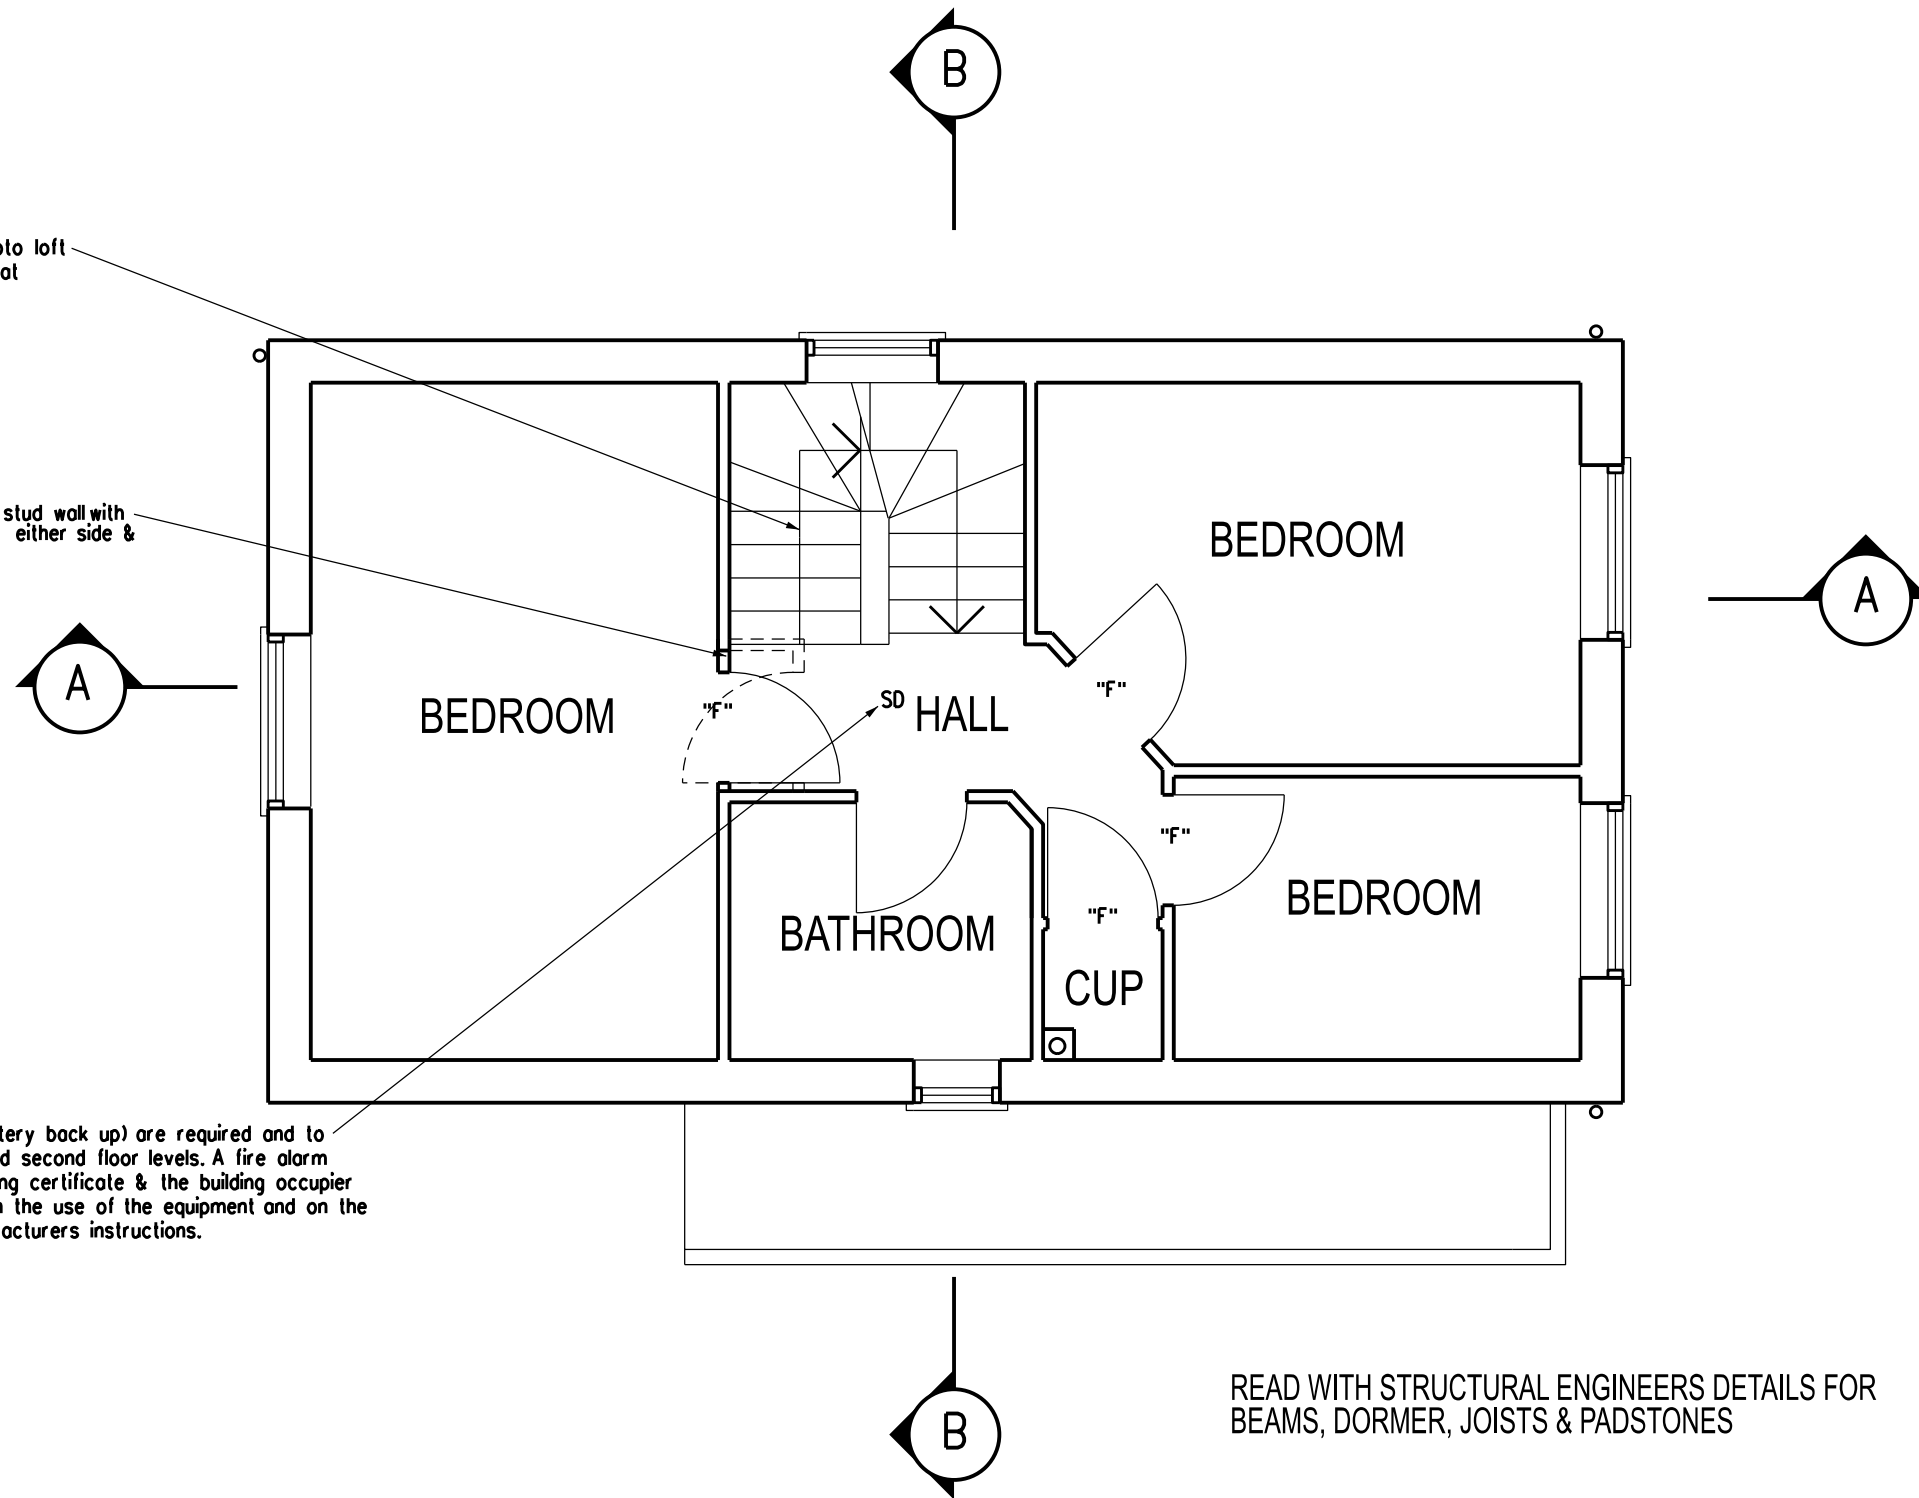

READ WITH STRUCTURAL ENGINEERS DETAILS FOR  
BEAMS, DORMER, JOISTS & PADSTONES

## PLANNING APPLICATION

REVISION DATE

ARCHITECT  
TA ARCHITECTS  
11 JOYDENS WOOD ROAD BEXLEY  
KENT DA5 2HS Tel 07905 130591  
ta140256@googlemail.com

JOB  
PROPOSED LOFT EXTENSION  
AT 1 GALLEON MEWS  
NORTHFLEET DA11 9EE

DRAWING  
PROPOSED FIRST FLOOR PLAN

SCALE 1:50 AT A3 DATE APRIL 2025

DRAWING NO.  
GR/04

