



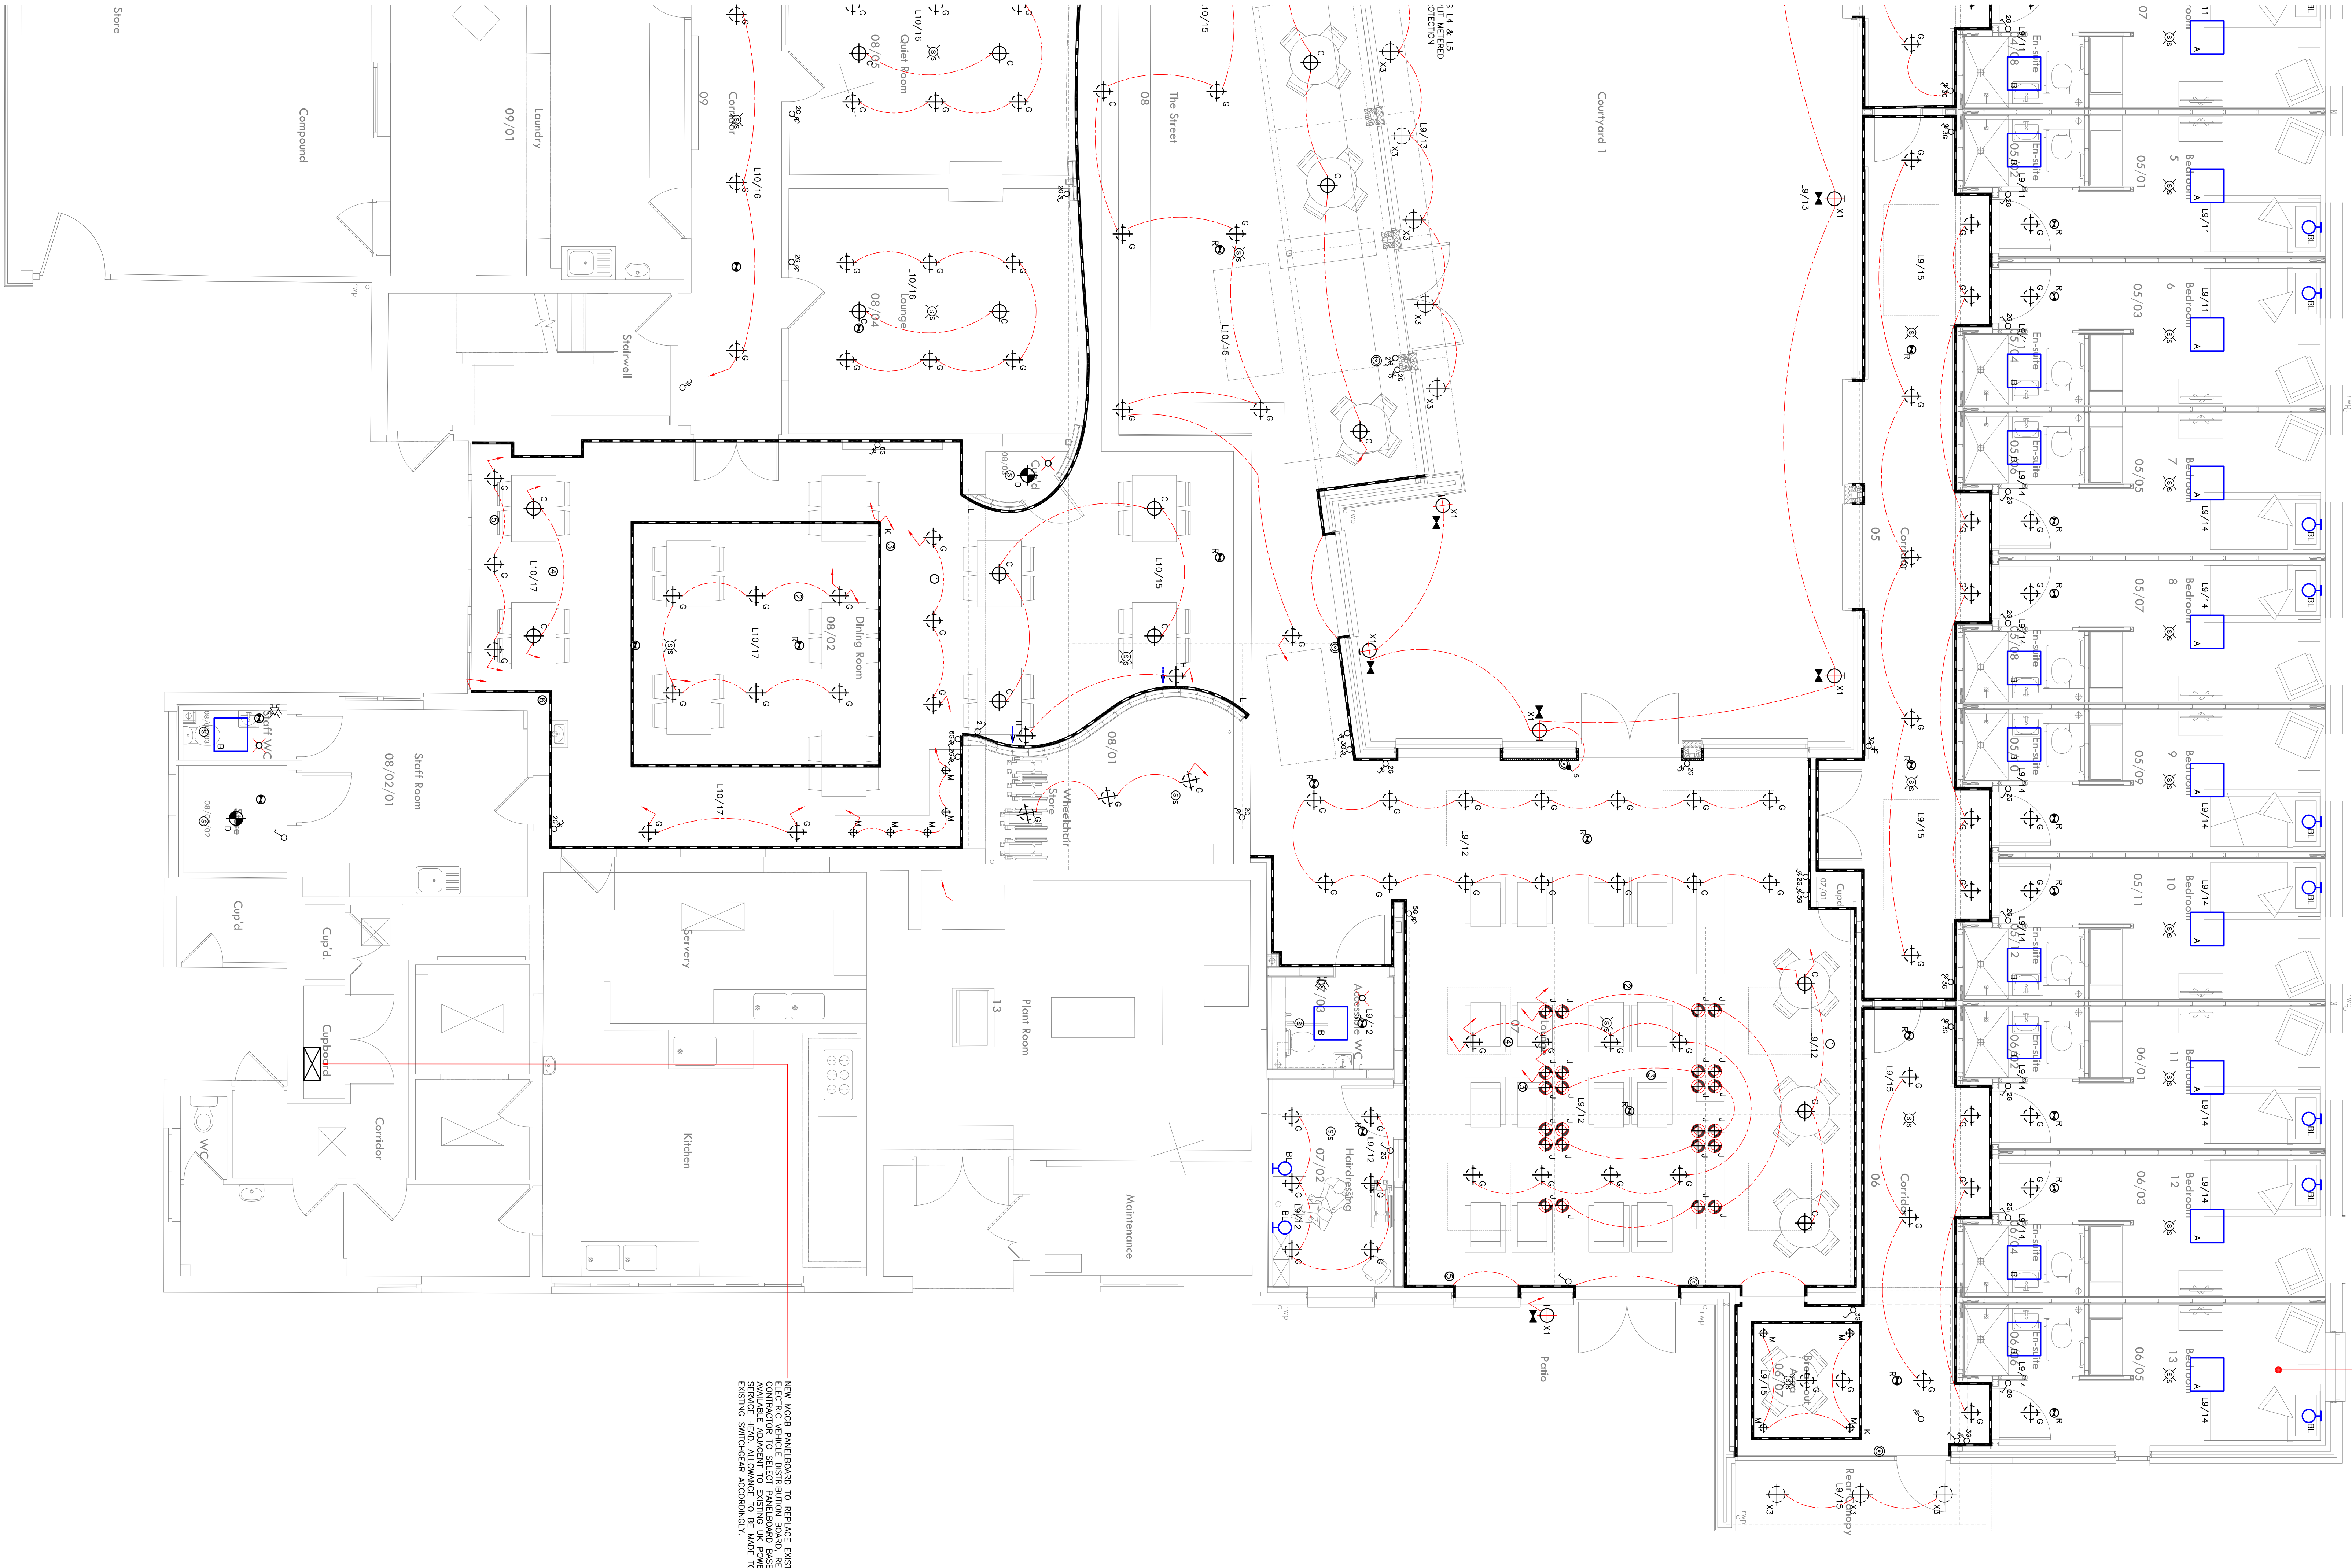

FOR CONTINUATION SEE DRG. No. EBS 2022/3

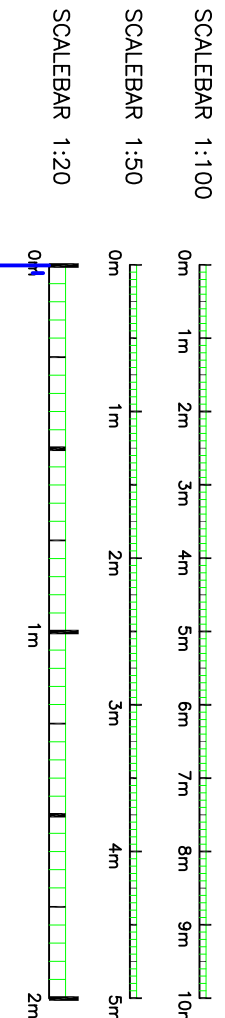

NOTES
1. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH THE SPECIFICATION AND ALL OTHER ENGINEERING AND ARCHITECTURAL DRAWINGS.
2. EQUIPMENT TO BE ASSIGNED WITH THE ARCHITECT BEFORE THE INSTALLATION IS COMPLETED.

Notes

THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND SPECIFICATIONS FOR ARCHITECTURAL DRAWINGS.

2. EXACT POSITIONS AND DIMENDING HEIGHTS OF ALL ELEMENTS TO BE INSTALLED SHALL BE DETERMINED PRIOR TO THE INSTALLATION & MUST BE CORRECT BEFORE THE INSTALLATION IS COMPLETED.

Rev	Date	Notes	Drawn	Checked
T3	25/04/23	SCALEBAR(S) ADDED	NL	MD
T2	19/06/22	<u>TENDER ISSUE</u>	CH	MD
T1	23/07/22	<u>TENDER ISSUE</u>	AP	CB