
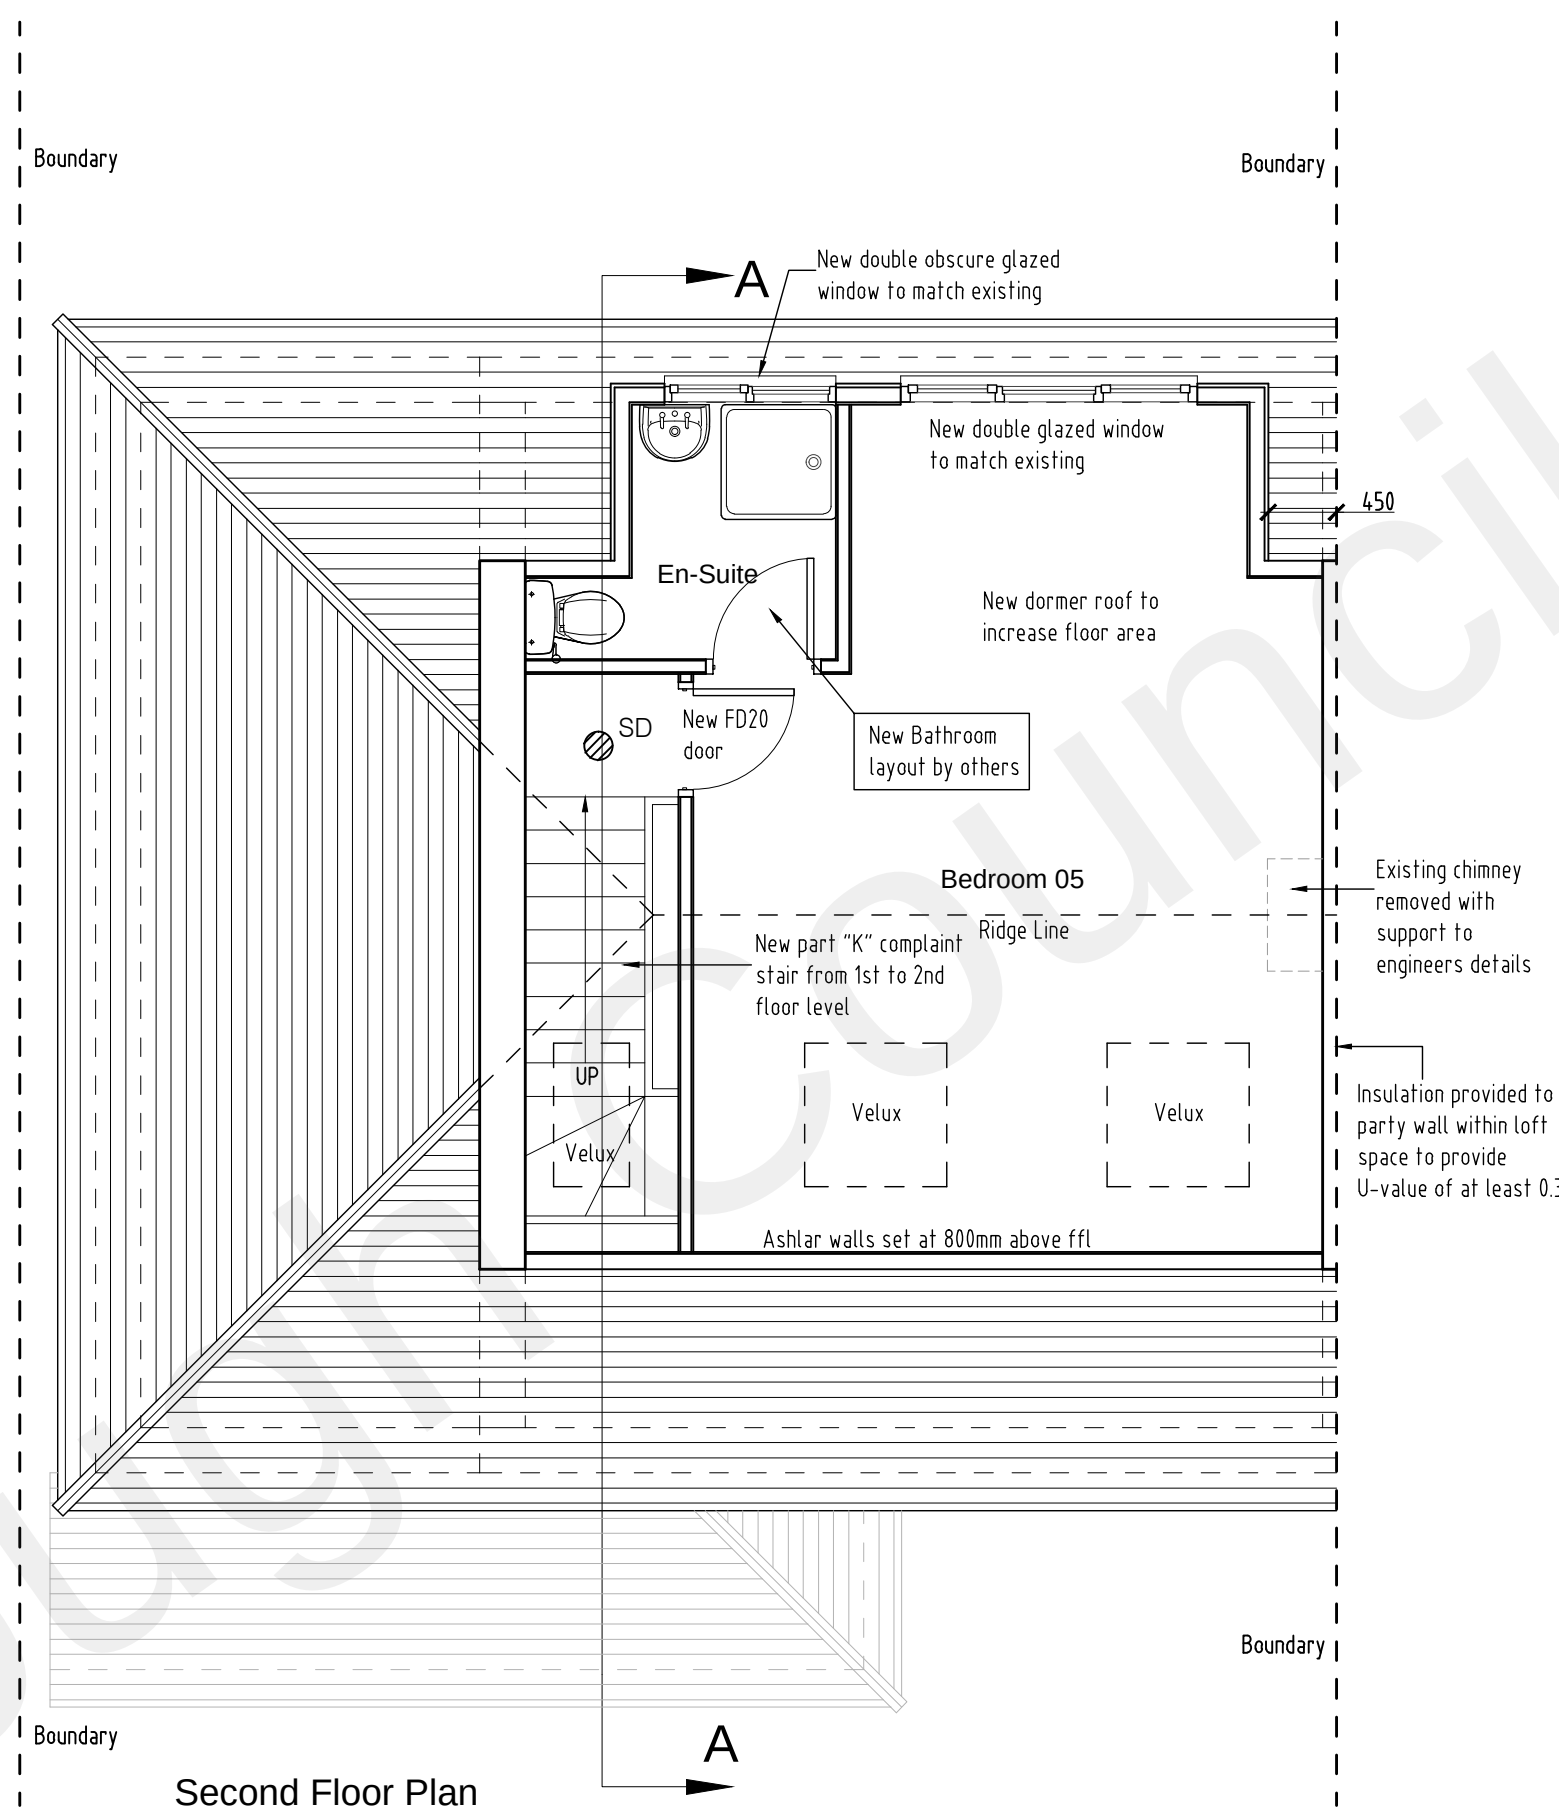


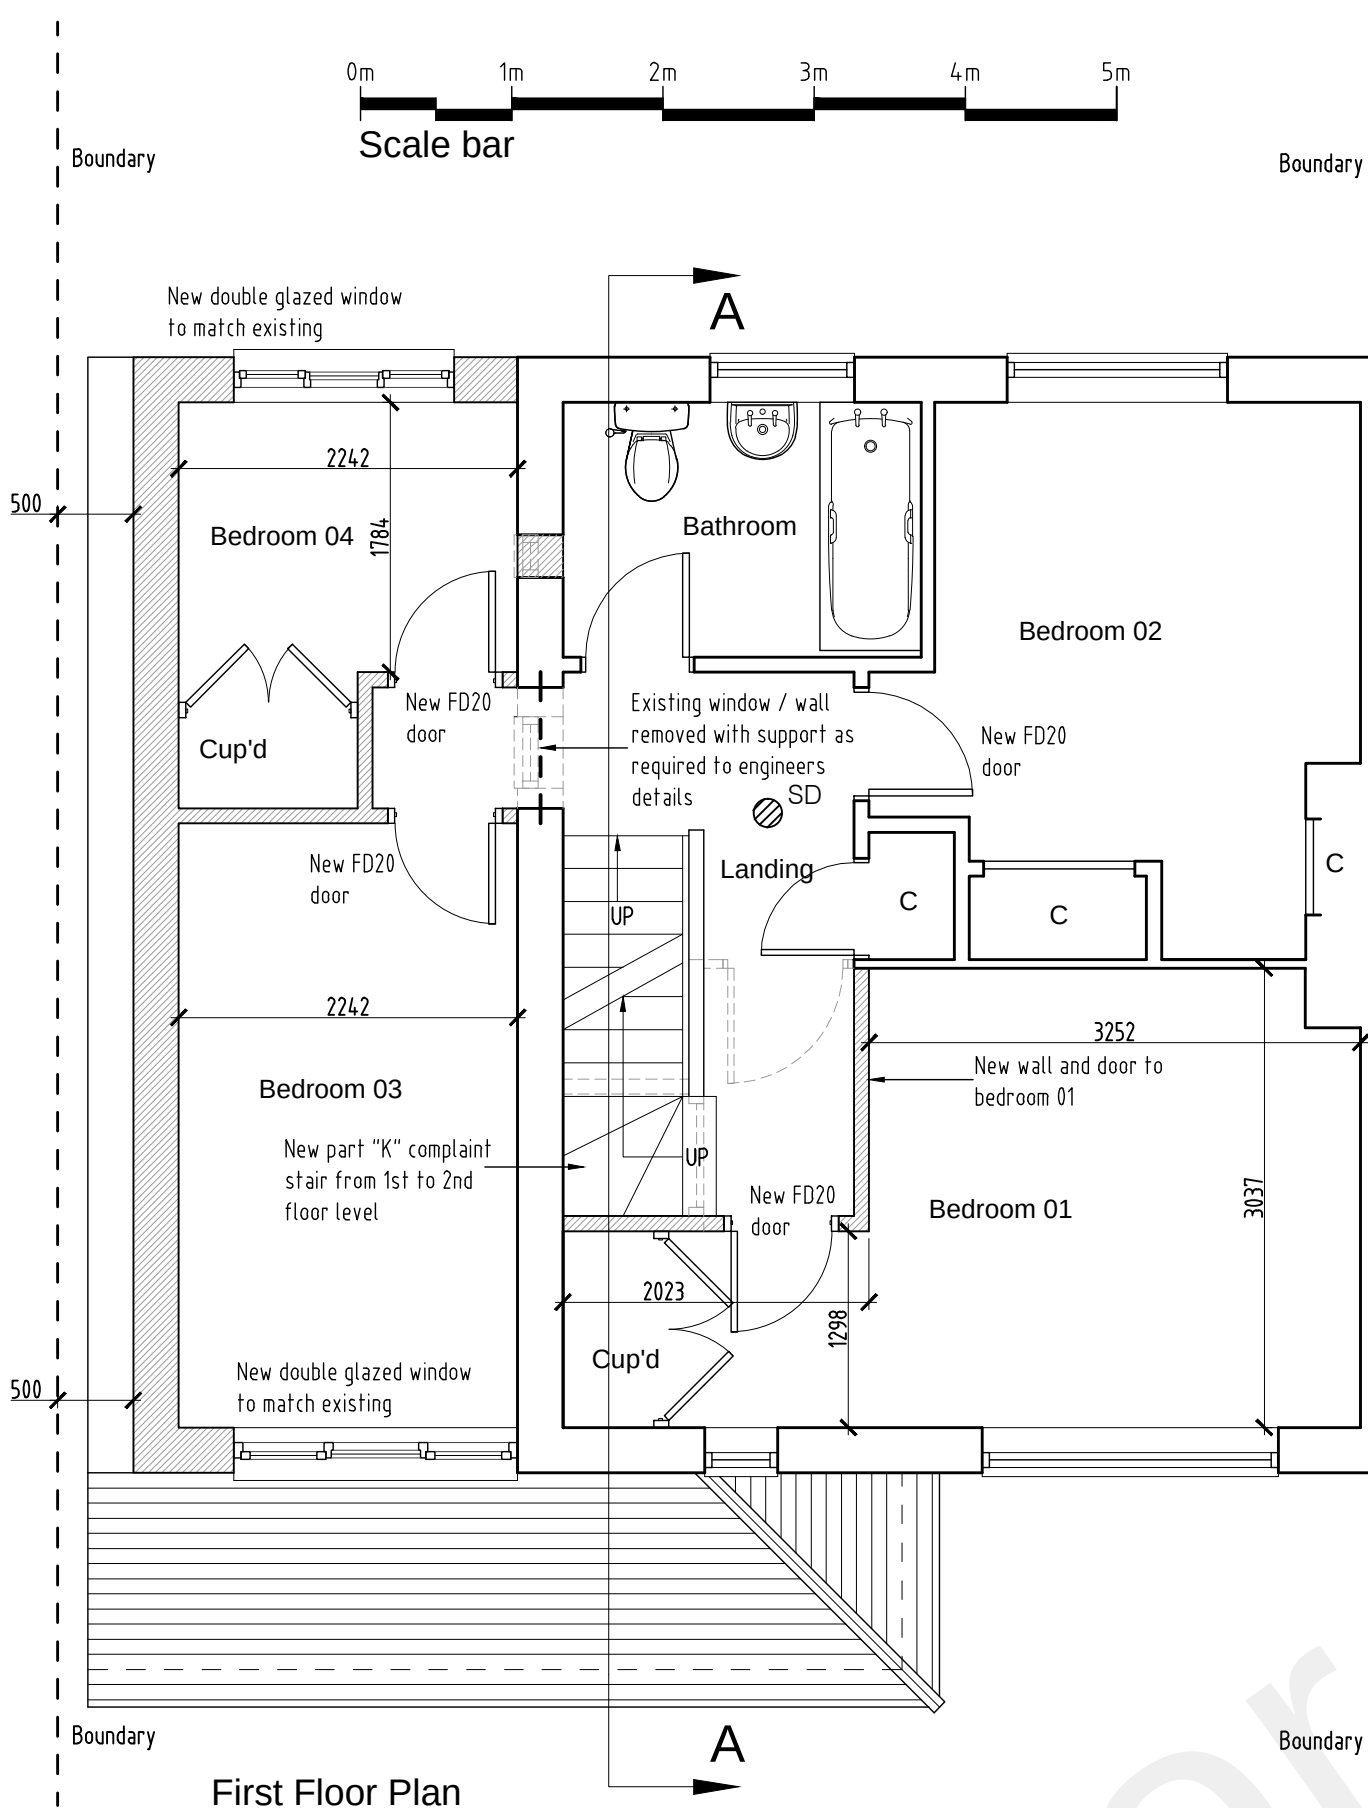

 SD Indicates smoke detector to conform to BS5446 and mains operated with a secondary power supply such as a rechargeable battery. Smoke alarm to be positioned in circulation space within 7.5 metres of the doors to habitable rooms and at each floor level. Installation and commissioning certificate is also required on completion of works.

Scale	Date	Drawn	Checked
1:50@A1	24.03.22	N/A	N/A
Project No:	Drawing No.	Revision	
2022-005	003	A	