


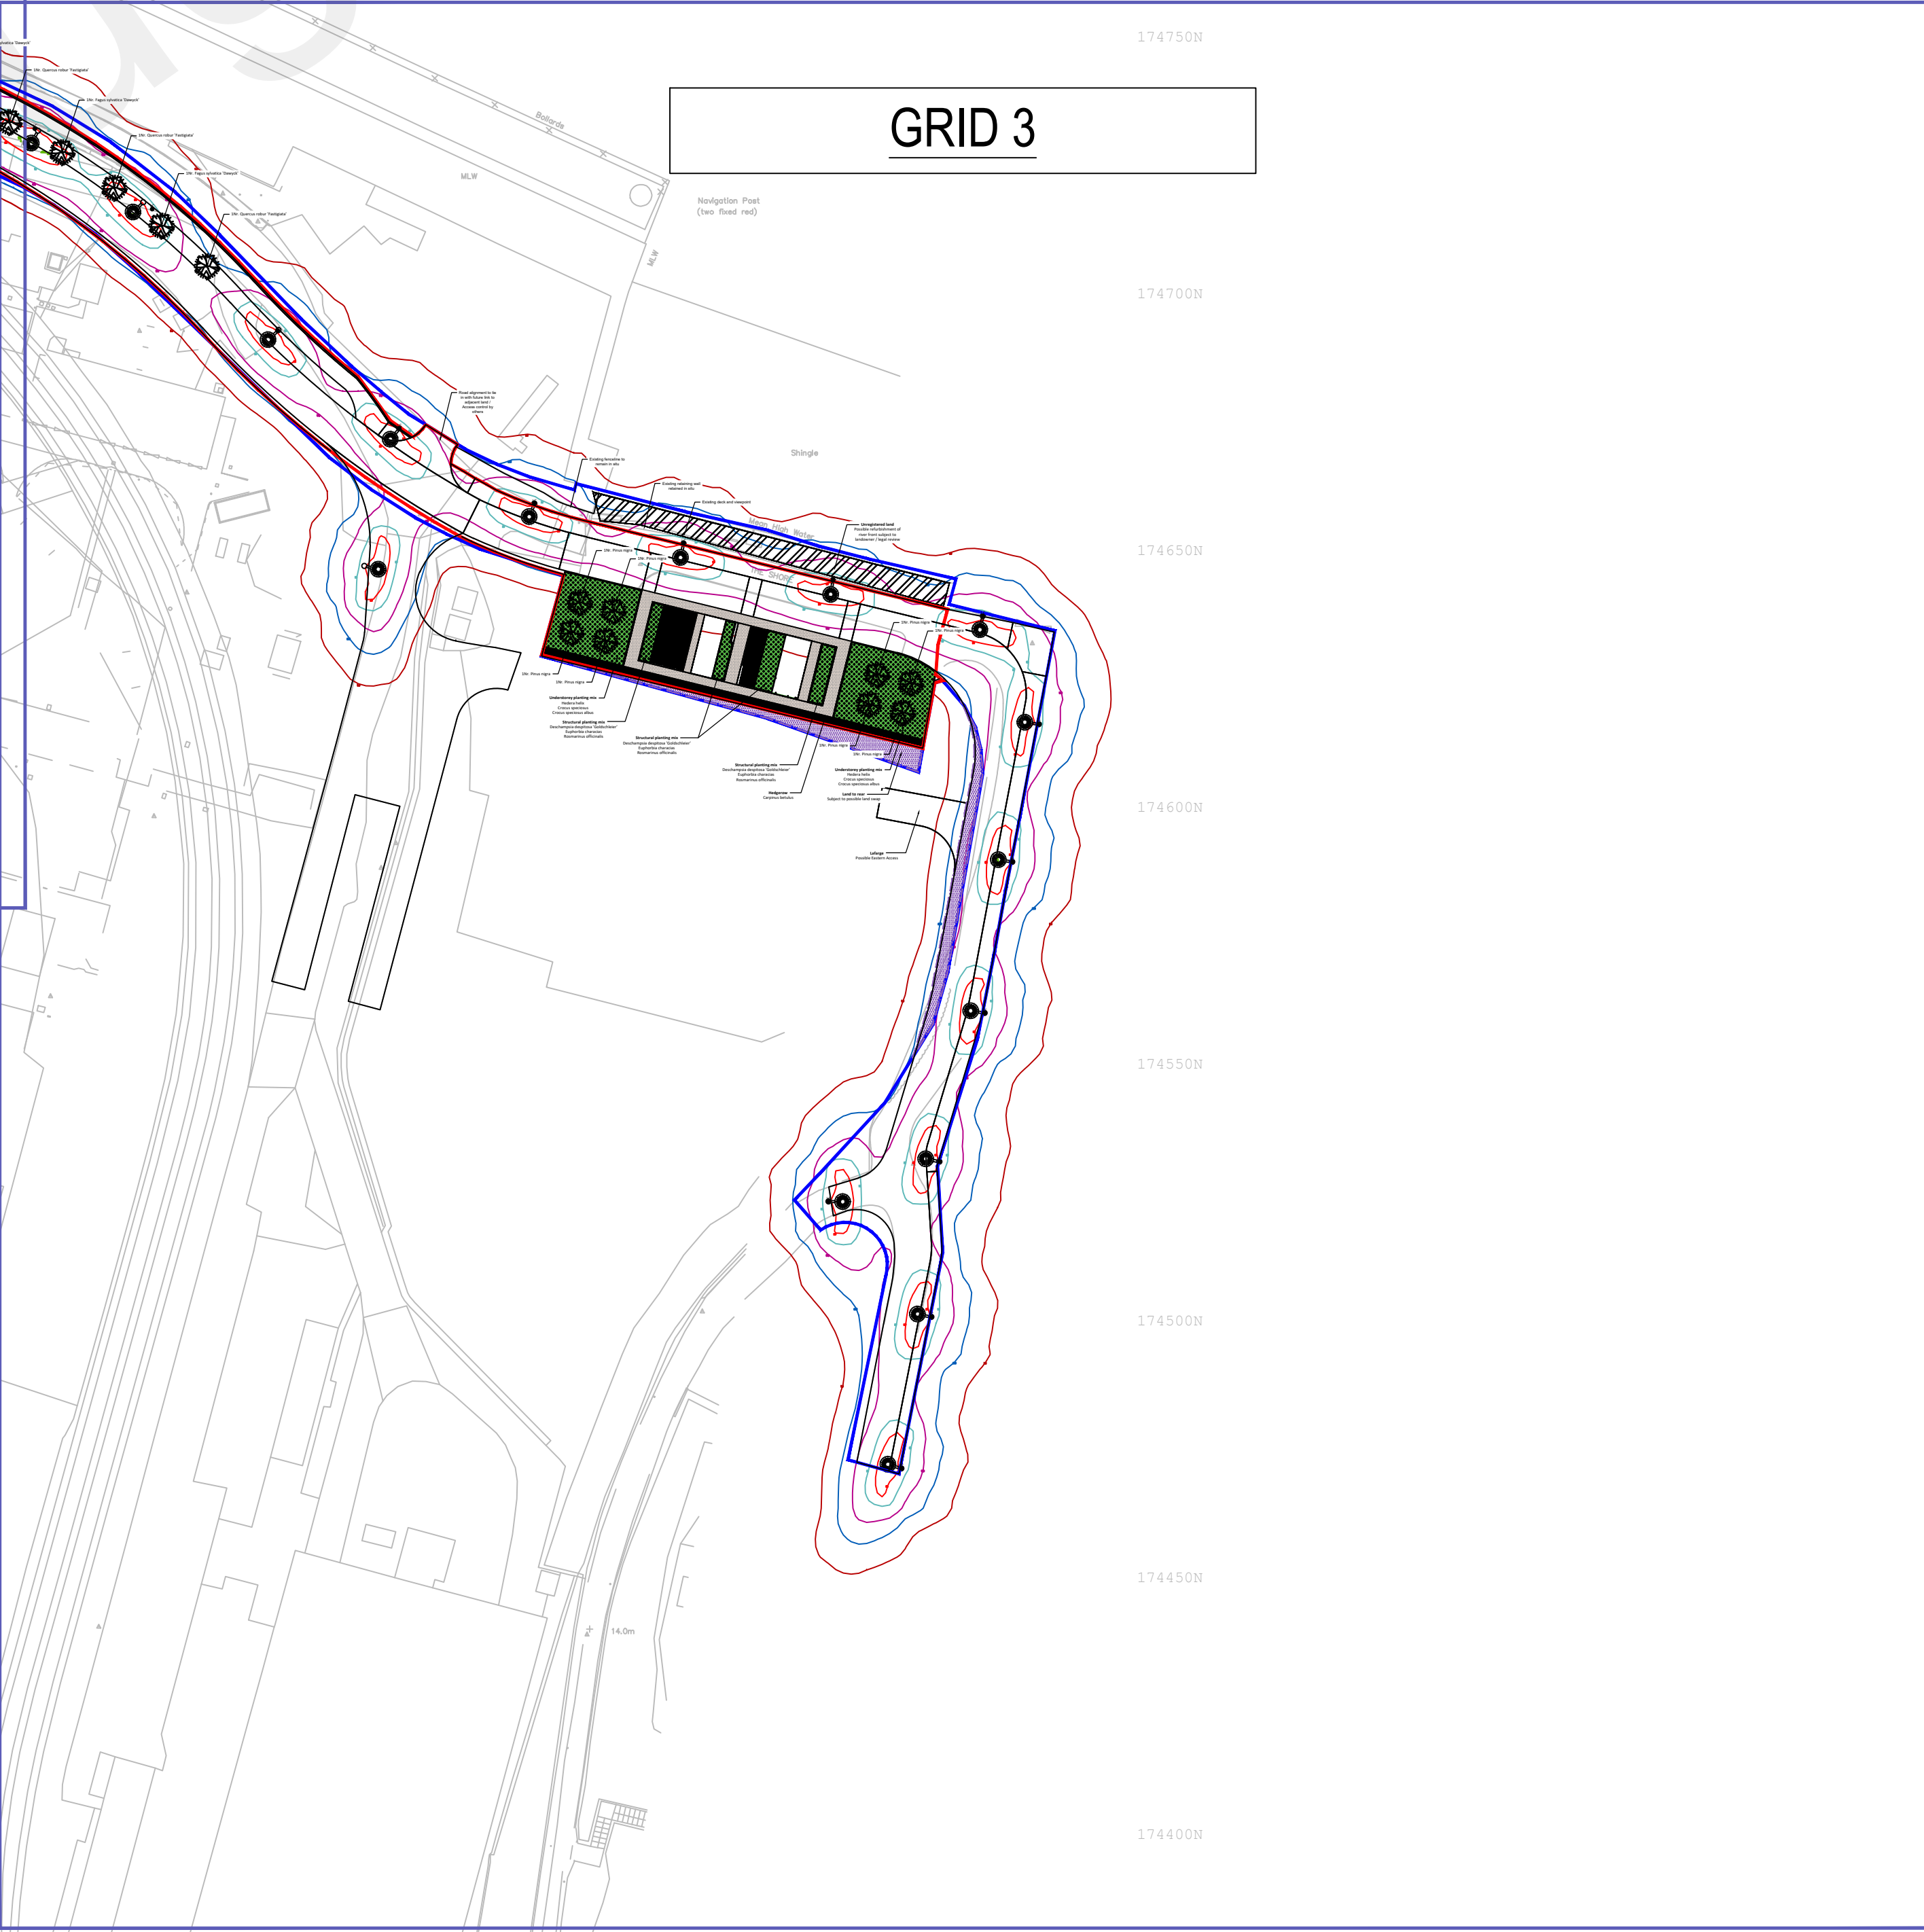

EQUIPMENT	8m COLUMNS TO BE GALVANIZED STEEL POST TOP COATING TO ACCORD TO COC. COASTAL SPECIFICATION, AS MANUFACTURED BY STANTON OR FARRAKAT COLUMNS TO BE INSTALLED TO COC/130002/130002. COLUMN FINISH TO BE CONFORMED BY EDC.
COLUMN	P805 12B-3/4-16X5-30W, CH PH50CO, 8" LENS, 31 WATTS, 5.41 KLM ALL LANTERNS TO BE POST TOP MOUNTED.
LANTERN (SINGLE)	
ISOLATOR	ISOLATOR: CHARLES EDDENCO LTD TO REF. L39FLNFK3 FUSE: SUITABLE 1 AMP 500V
CABLE	1.5mm pvc INSULATED AND SHEATHED FLEXIBLE STRAINED COPPER 1.5mm 3 CORE PVC FLEX WHITE 2.5mm TALS PER SET DOUBLE INSULATED FLEXIBLE PLAIN ANNEALED COPPER BLUE-BROWN, CABLES SHOULD BE ACORDED
LIGHTING CONTROL UNIT	LIGHTING CONTROL UNIT TO BE PHOTOCELL IN BEARDTH WITH APPENDIX 14.4 PHILIPS HARVARD OR ORSAM ELECTRONIC CONTROL GEAR WITH DIMMING CAPABILITY. PHOTOCELL, SET AT 30/18 LUX WITH 1 PIN NEMA SOCKET

UTILITIES NOTE: The position of any existing public or private sewers, utility services, plant or apparatus shown on this drawing is believed to be correct, but no warranty to this is expressed or implied. Other such plant or apparatus may also be present but not shown. The Contractor is therefore advised to undertake their own investigation where the presence of any existing sewers, services, plant or apparatus may affect their operations.

This document is suitable only for the purpose noted above. Use of this document for any other purpose is not permitted.

Client/Project
BELLWAY HOMES

HARBOUR VILLAGE, NORTHFLEET

PROPOSED STREET LIGHTING

Project No.

33241009

P03

Drawing No.

Scale

A1 @ 1:1000

410098/200.70

332410098/200.701/002