



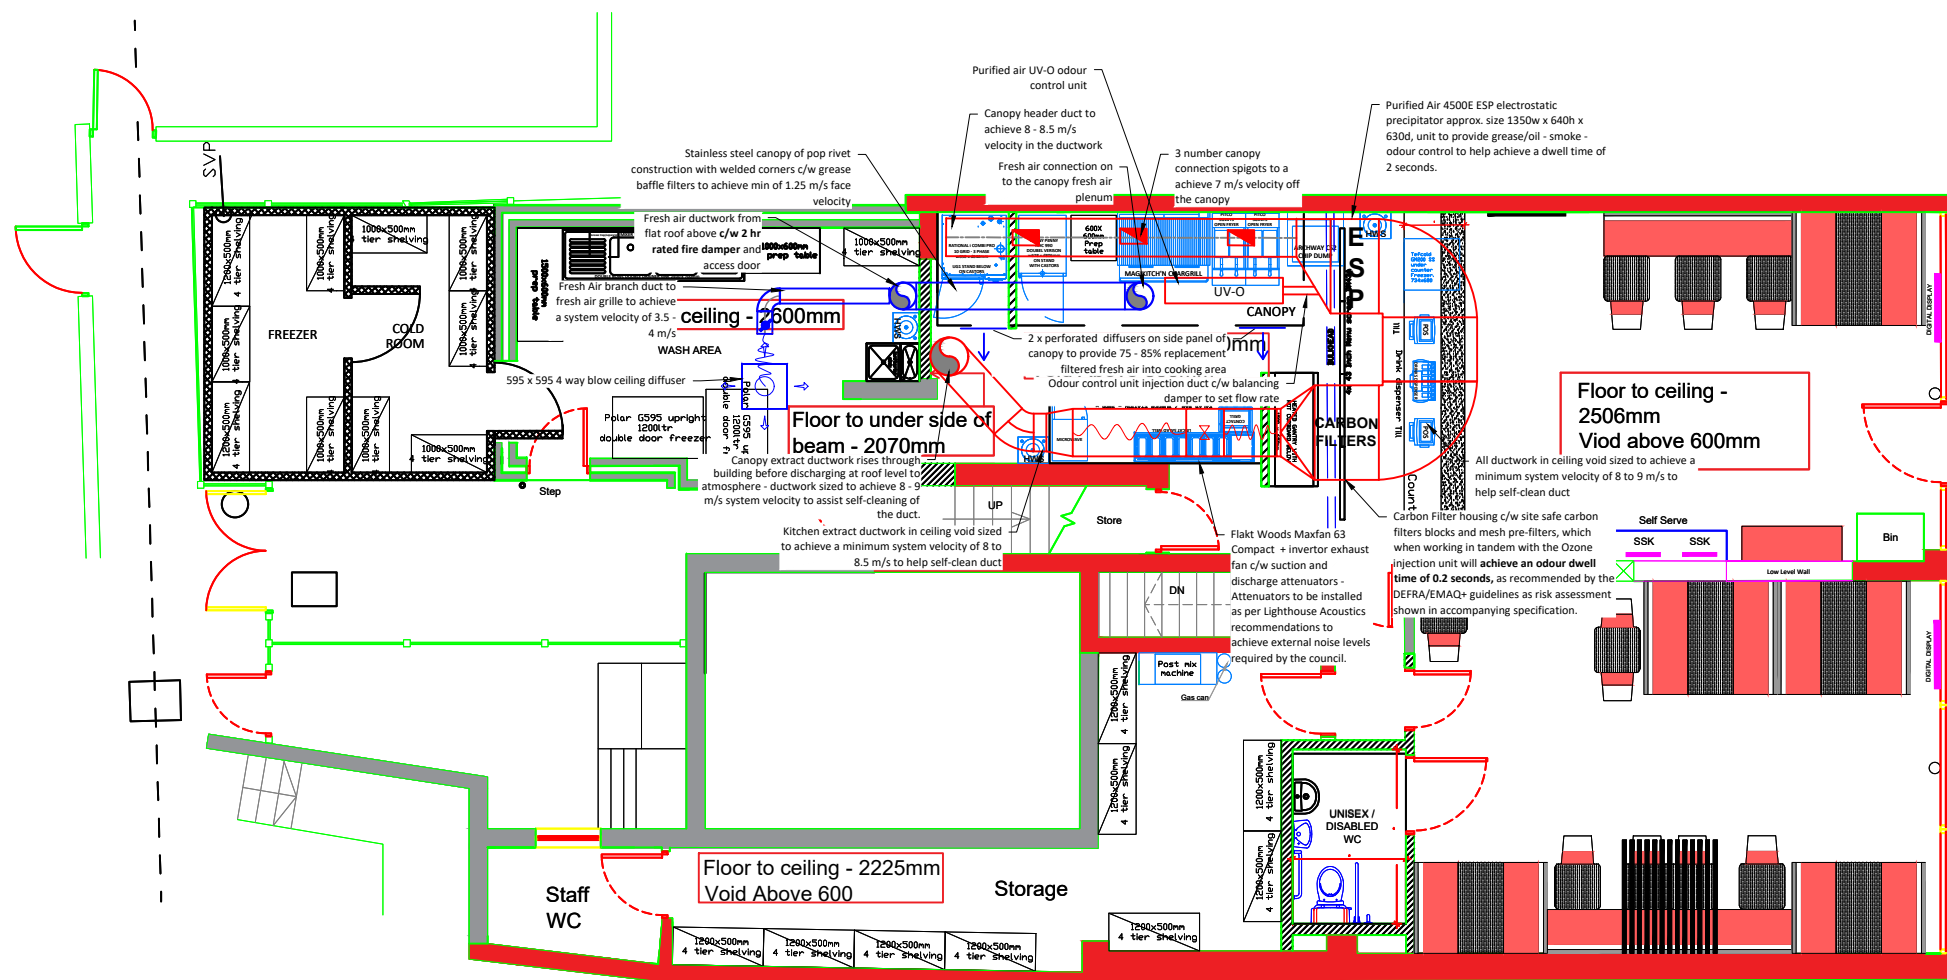


Proposed Ground Floor Plan 5

Fire Wall- 1 Hour Fire Rated

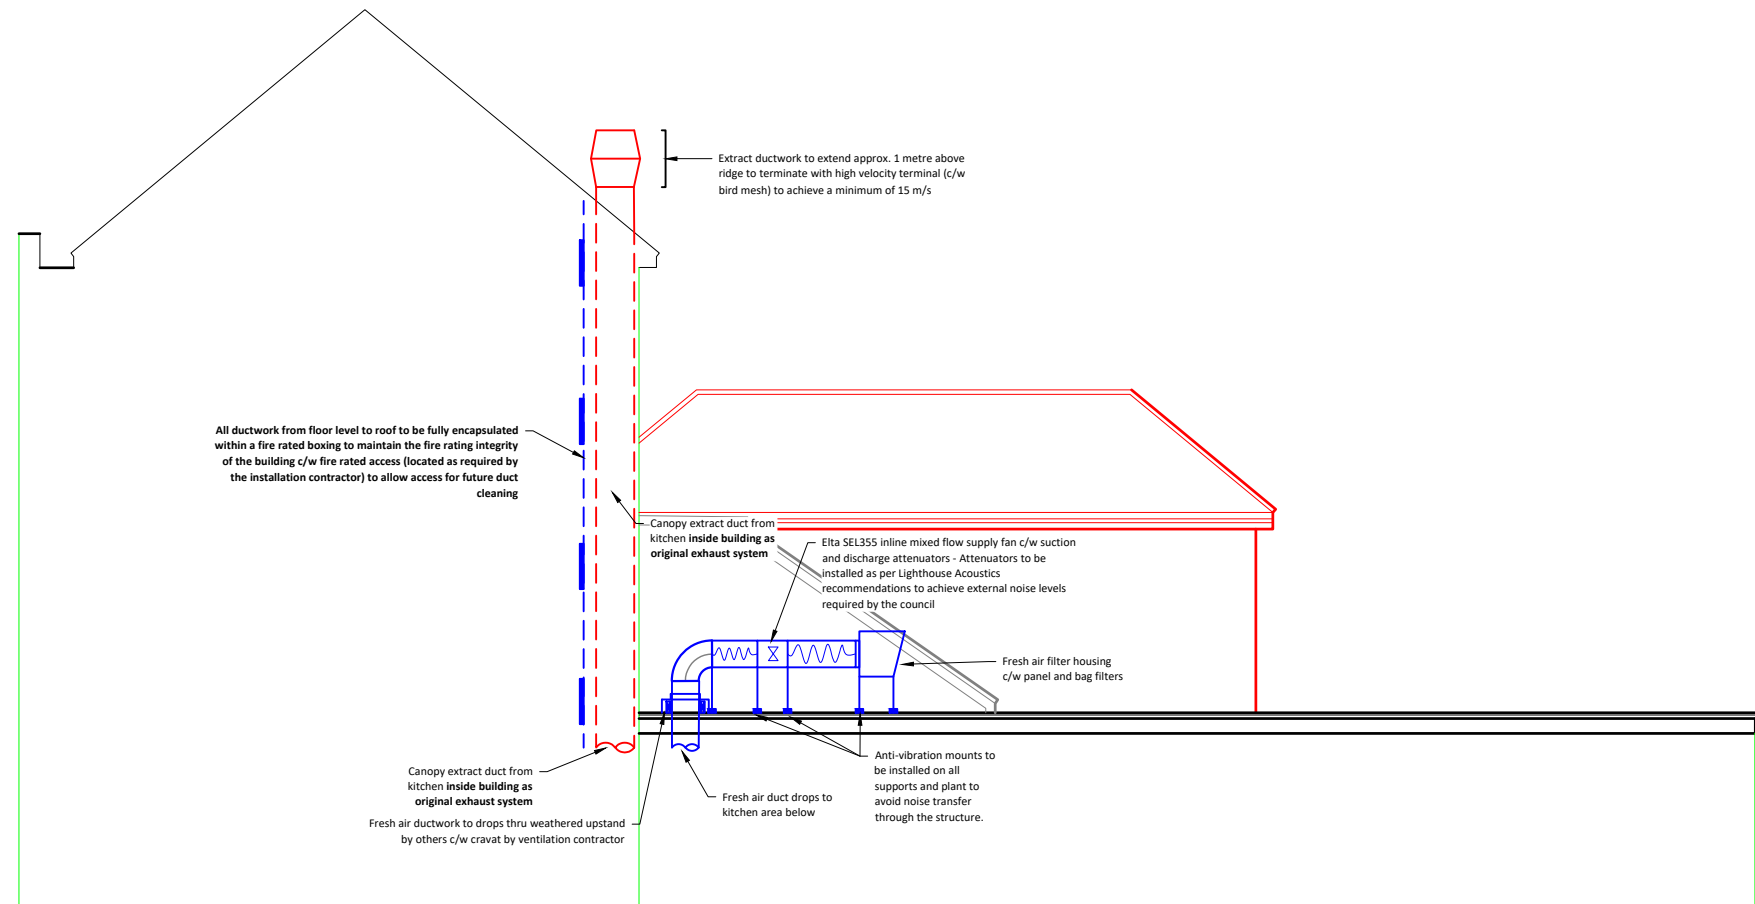

North Elevation

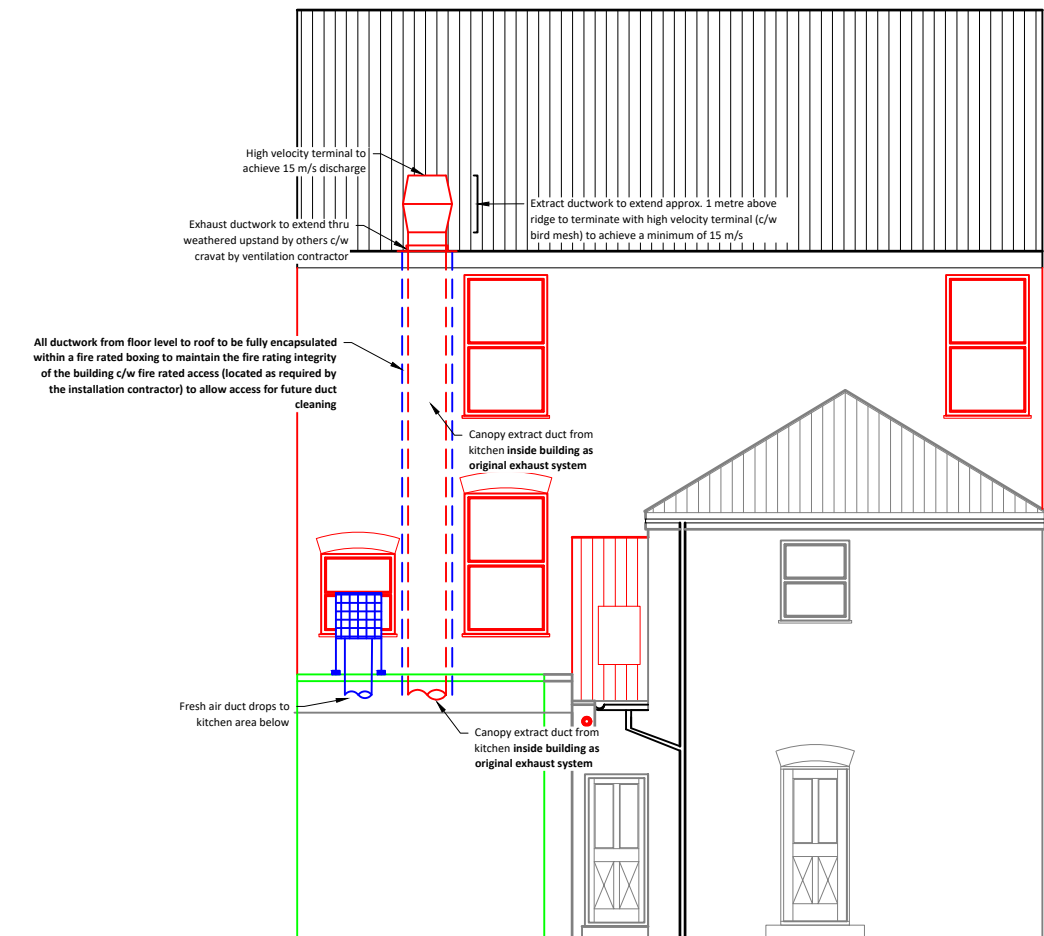

Proposed East Elevation

NOTE

A/D ACCESS DOORS TO BE INSTALLED ON THE DUCTWORK AT MAXIMUM 1-2 METRE CENTRES FOR FUTURE CLEANING OF THE SYSTEM.

ANTI-VIBRATION MOUNTS TO BE INSTALLED ON ALL SUPPORTS AND PLANT TO AVOID NOISE TRANSFER THROUGH THE STRUCTURE.

DUCT ROOF TO COMPRISE OF "H" FRAME (RECTANGULAR DUCT) OR SPIRAL BAND (SPIRAL DUCT) BRACKET WITH "TIGOT" PAD OR SIMILAR PAD ON ROOF TO PREVENT NOISE TRANSFER AND TEARING TO THE ROOF FINISH

SYSTEM CLEANING TO BE CARRIED OUT BY A BESA APPROVED CLEANING CONTRACTOR WHO SHOULD BE APPOINTED WITHIN 6 WEEKS OF THE STORE OPENING TO CARRY OUT A RISK ASSESSMENT FOR THE SYSTEM - SEE SPECIFICATION FOR RECOMMENDED MAINTENANCE INTERVALS, SEE ACCOMPANYING SPECIFICATION.

ROOF SUPPORTS FOR DUCT AND PLANT C/W "BIG FOOT" OR SIMILAR ROOF PROTECTION SYSTEM TO PREVENT DAMAGE TO THE ROOF AND HELP PREVENT NOISE TRANSFER.

All ductwork from floor level to roof to be fully encapsulated within a fire rated boxing to maintain the fire rating integrity of the building c/w fire rated access (located as required by the installation contractor) to allow access for future duct cleaning

COPYRIGHT: PLEASE NOTE THAT THIS DESIGN IS THE COPYRIGHT OF KRS STEEL SERVICES LTD AND MUST NOT BE COPIED IN PART OR IN FULL WITHOUT THE WRITTEN CONSENT OF KRS STEEL SERVICES LTD, NOR MUST THEY BE PASSED TO A THIRD PARTY IN ANY FORM, UNDER ANY CIRCUMSTANCES

Revision	F		
Revision	E		
Revision	D		
Revision	C		
Revision	B		
Revision	A		
Revision	Date	By	Note

KRS STEEL SERVICES LTD
UNIT 6, MEADWAY TRADING ESTATE
429 THE MEADWAY
KITTS GREEN
BIRMINGHAM B33 0DZ

Tel: 0121 783 7404 Fax: 0121 786 6803

CLIENT Sri Neelakanta Ltd

JOB TITLE

Pepes
170 - 171 Parrock Street
Gravesend
Kent
DA12 1ER

DRAWING

Proposed Canopy Extract and Fresh Air Supply
Ventilation Layout

SCALE 1:100 @ A1 DATE 18/01/2026 DRAWN JG

DRAWING NO. C7426(P)/M01

REV

VENTILATION LAYOUTS ARE INDICATIVE ONLY FINAL LAYOUT MAY DIFFER ONCE SITE MEASURED BUT EQUIPMENT SELECTIONS TO REMAIN AS DESIGN TO ENSURE NOISE AND ODOUR CONTROL ARE ACHIEVED IN LINE WITH PLANNING/LANDLORD APPROVAL