


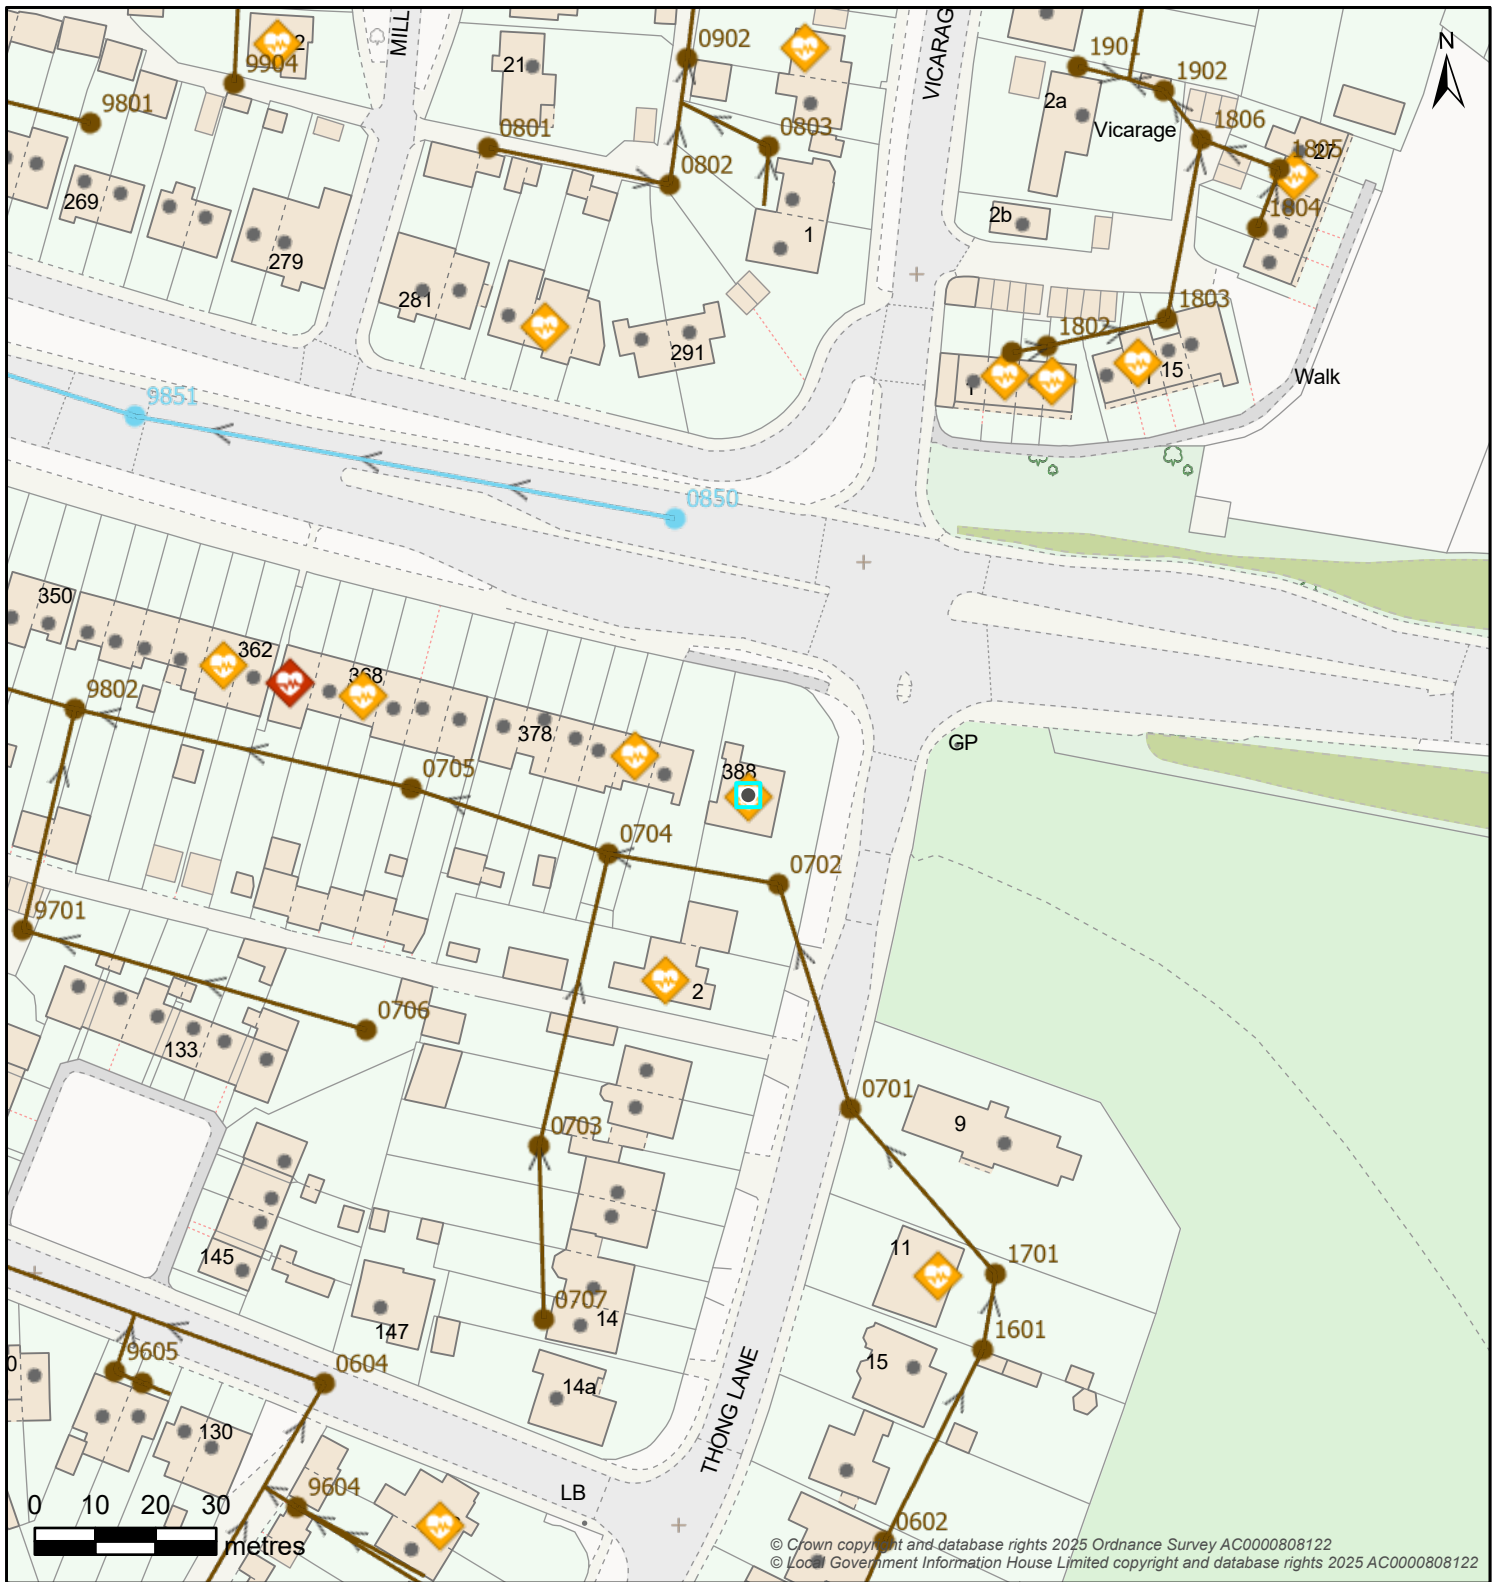

Boundary Box	Break Pressure Tank	Capped End	Hydrant			
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug	Fire Hydrant	WOH Washout Hydrant	
Pressure Monitoring	Service Reservoir		Meter	Valve - Controllable		
Logger	Covered	Tower	Meter	Open Valve	Closed Valve	
Site			Valve - Flow			
Abstraction Point	Supply Works	Air Valve	NRV	Non-Return Valve	WO	Washout Empty Valve
Booster Station	Transfer Station	Valve - Pressure			Pipe Bridge	
Surface Reservoir	Underground Source	PRV	Pressure Reducing Valve	PSV	Pressure Sustaining Valve	Pipe Bridge
Water Pipe			Water Area			
Communication	Trunk	Decommissioned	Water Supply Zone	District Meter Area		
Distribution	Raw	Discolouration				
Non-Potable	Private					

Map Title: SW Print

Printed By: Lia.Loversidge

Date Printed: 13/05/2025

Map Scale: 1250

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

