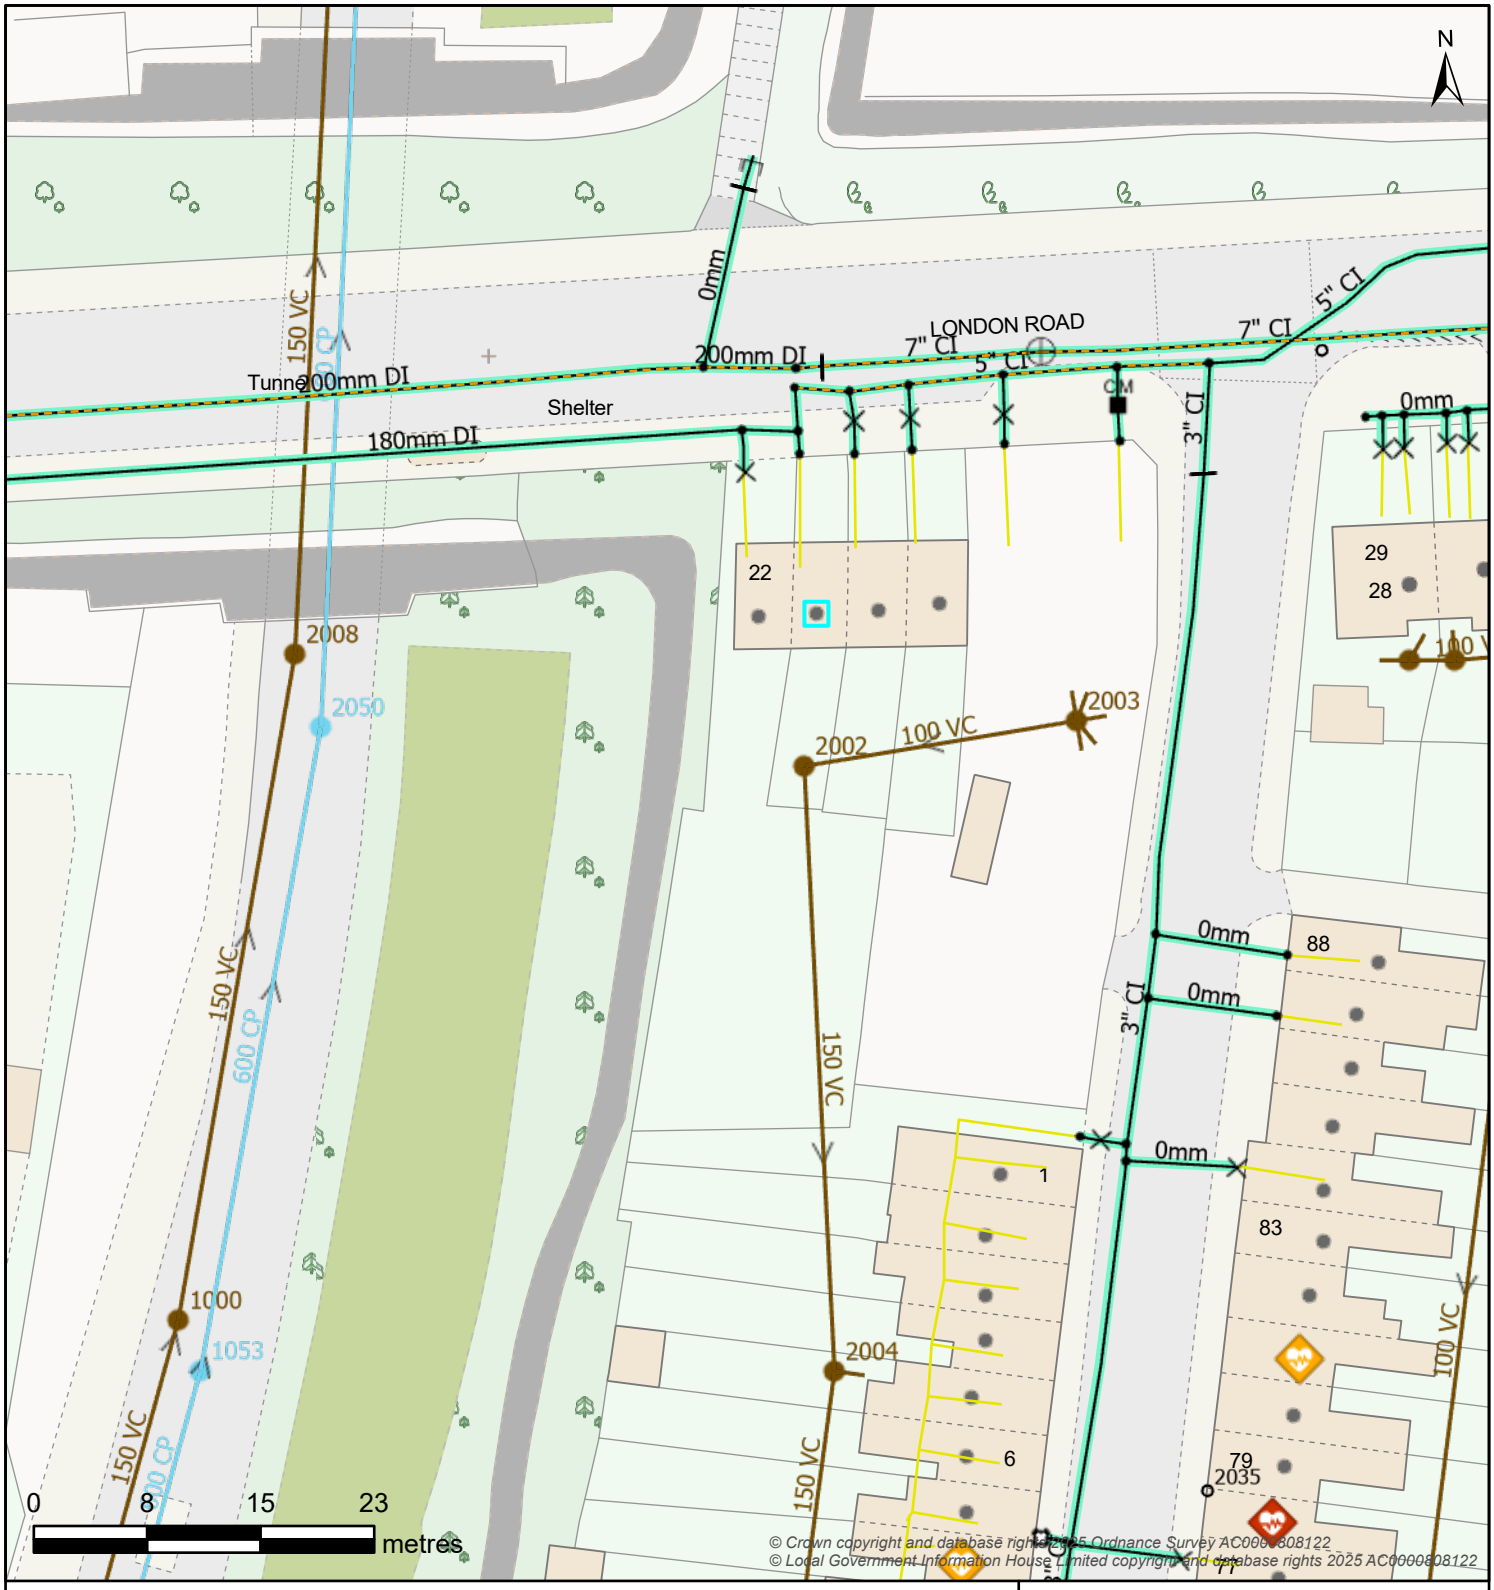


© Crown copyright and database rights 2025 Ordnance Survey AC0000808122
© Local Government Information House Limited copyright and database rights 2025 AC0000808122

Boundary Box	Break Pressure Tank	Capped End	Hydrant
Boundary Box	BPT Break Pressure Tank	Capped End	Emptying Plug; Fire Hydrant; WOH Washout Hydrant

Pressure Monitoring	Service Reservoir	Meter	Valve - Controllable
Logger	Covered; Tower	Meter	Open Valve; Closed Valve; Stop Tap

Site	Valve - Flow
Abstraction Point; Supply Works; Booster Station; Transfer Station; Surface Reservoir; Underground Source	AV Air Valve; NRV Non-Return Valve; WO Washout Empty Valve

Valve - Pressure	Pipe Bridge
PRV Pressure Reducing Valve; PSV Pressure Sustaining Valve	Pipe Bridge

Water Pipe	Water Area
Communication; Trunk; Decommissioned; Distribution; Raw; Discolouration; Non-Potable; Private	Water Supply Zone; District Meter Area

Map Title: SW Print

Printed By: Kelly.Donaldson

Date Printed: 03/02/2025

Map Scale: 500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.

WATER for LIFE from Southern Water