


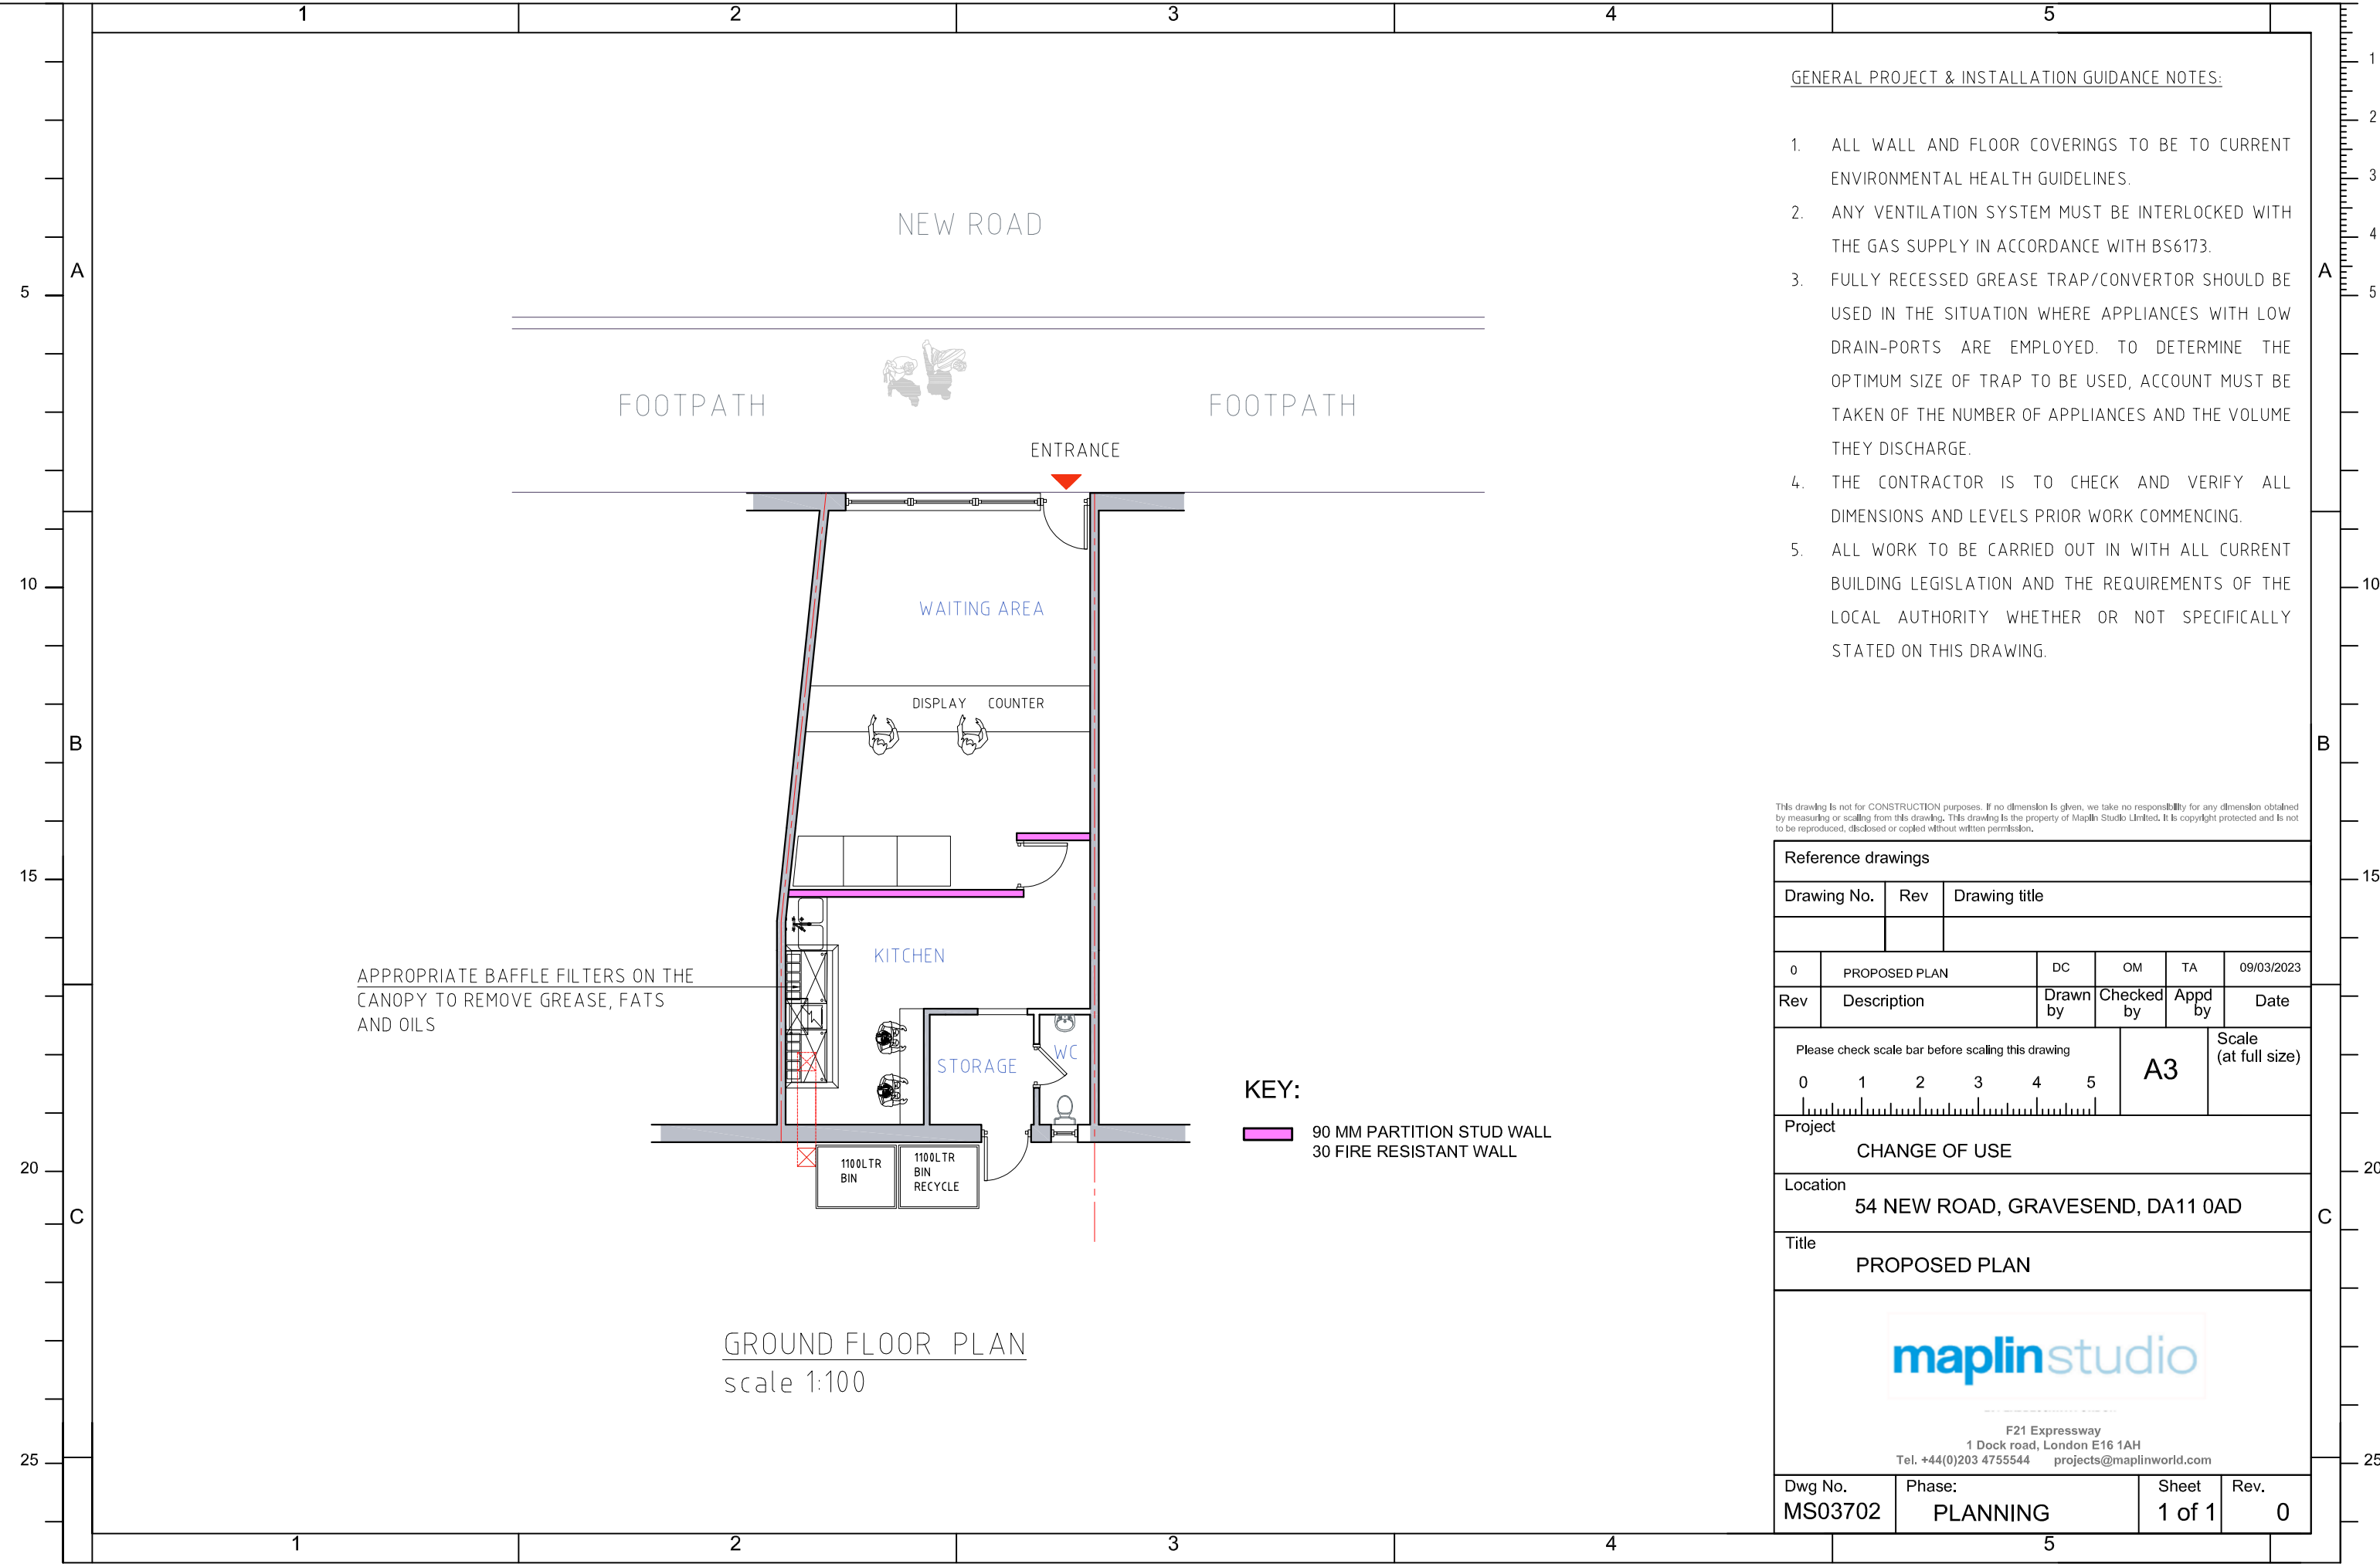

GENERAL PROJECT & INSTALLATION GUIDANCE NOTES:

1. ALL WALL AND FLOOR COVERINGS TO BE TO CURRENT ENVIRONMENTAL HEALTH GUIDELINES.
2. ANY VENTILATION SYSTEM MUST BE INTERLOCKED WITH THE GAS SUPPLY IN ACCORDANCE WITH BS6173.
3. FULLY RECESSED GREASE TRAP/CONVERTOR SHOULD BE USED IN THE SITUATION WHERE APPLIANCES WITH LOW DRAIN-PORTS ARE EMPLOYED. TO DETERMINE THE OPTIMUM SIZE OF TRAP TO BE USED, ACCOUNT MUST BE TAKEN OF THE NUMBER OF APPLIANCES AND THE VOLUME THEY DISCHARGE.
4. THE CONTRACTOR IS TO CHECK AND VERIFY ALL DIMENSIONS AND LEVELS PRIOR WORK COMMENCING.
5. ALL WORK TO BE CARRIED OUT IN WITH ALL CURRENT BUILDING LEGISLATION AND THE REQUIREMENTS OF THE LOCAL AUTHORITY WHETHER OR NOT SPECIFICALLY STATED ON THIS DRAWING.

This drawing is not for CONSTRUCTION purposes. If no dimension is given, we take no responsibility for any dimension obtained by measuring or scaling from this drawing. This drawing is the property of Maplin Studio Limited. It is copyright protected and is not to be reproduced, disclosed or copied without written permission.

Reference drawings						
Drawing No.	Rev	Drawing title				
0	PROPOSED PLAN	DC	OM	TA	09/03/2023	
Rev	Description	Drawn by	Checked by	Appd by	Date	
Please check scale bar before scaling this drawing				A3		Scale (at full size)
0	1	2	3	4	5	
Project						
CHANGE OF USE						
Location						
54 NEW ROAD, GRAVESEND, DA11 0AD						
Title						
PROPOSED PLAN						
maplinstudio						
F21 Expressway 1 Dock road, London E16 1AH Tel. +44(0)203 4755544 projects@maplinworld.com						
Dwg No. MS03702		Phase: PLANNING		Sheet 1 of 1		Rev. 0